




# OIL ANALYSIS REPORT

## Sample Rating Trend

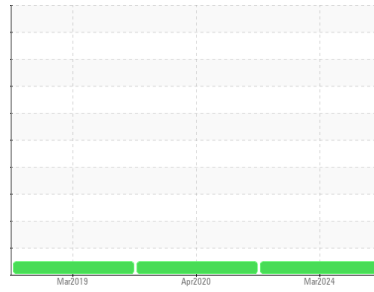

**NORMAL**



Machine Id  
**KAESER SM 8 1830084 (S/N 1153)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA013916</b>	KCP26322	KCP18736
Sample Date	Client Info			<b>25 Mar 2024</b>	21 Apr 2020	25 Mar 2019
Machine Age	hrs	Client Info		<b>10180</b>	9989	9984
Oil Age	hrs	Client Info		<b>6</b>	3	9984
Oil Changed	Client Info			<b>N/A</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	14	38
Copper	ppm	ASTM D5185m	>50	<b>0</b>	2	6
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	<1	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	<1	<1
Barium	ppm	ASTM D5185m	90	<b>93</b>	58	<1
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	1	0
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m	100	<b>80</b>	86	42
Calcium	ppm	ASTM D5185m	0	<b>3</b>	8	11
Phosphorus	ppm	ASTM D5185m	0	<b>1</b>	47	126
Zinc	ppm	ASTM D5185m	0	<b>0</b>	10	13
Sulfur	ppm	ASTM D5185m	23500	<b>21101</b>	17396	14852

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>2</b>	8	17
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	1
Water	%	ASTM D6304	>0.05	<b>0.023</b>	0.031	0.007
ppm Water	ppm	ASTM D6304	>500	<b>230</b>	315.3	70

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>282</b>	3555	989
Particles >6µm		ASTM D7647	>1300	<b>48</b>	474	236
Particles >14µm		ASTM D7647	>80	<b>5</b>	11	23
Particles >21µm		ASTM D7647	>20	<b>1</b>	2	6
Particles >38µm		ASTM D7647	>4	<b>0</b>	0	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>15/13/10</b>	16/11	15/12

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.41</b>	0.328	0.302


# OIL ANALYSIS REPORT

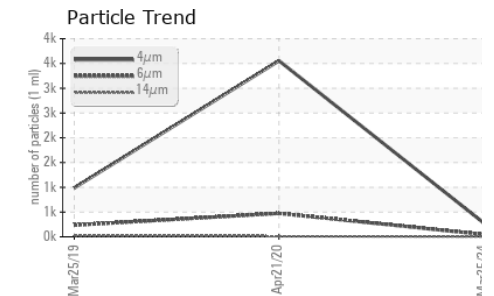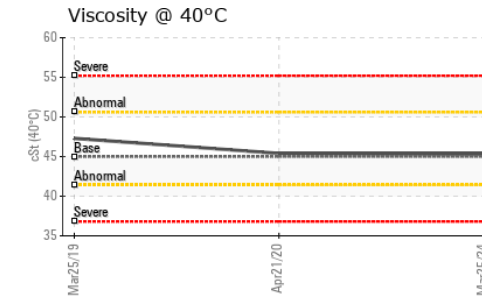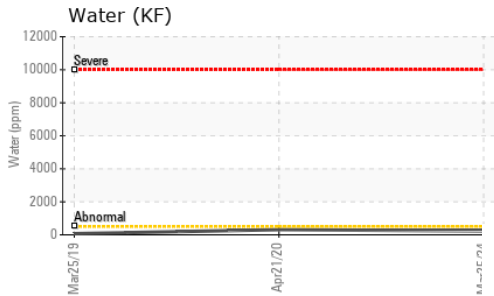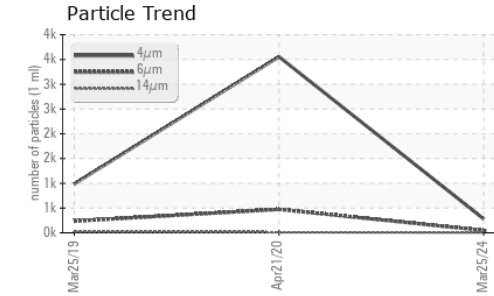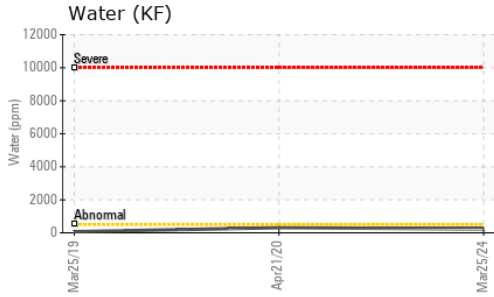






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	45.3	45.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

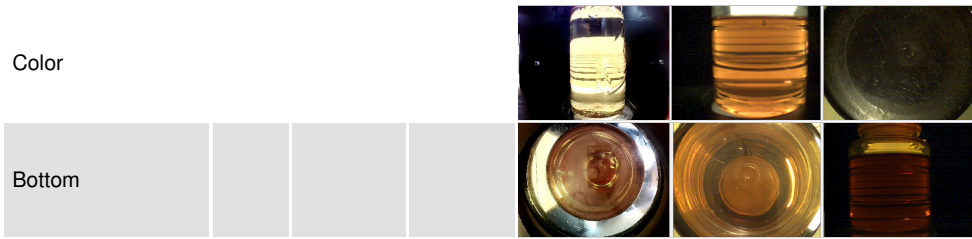

## GRAPHS

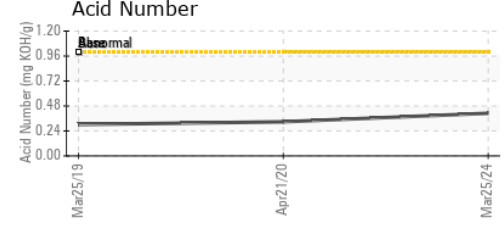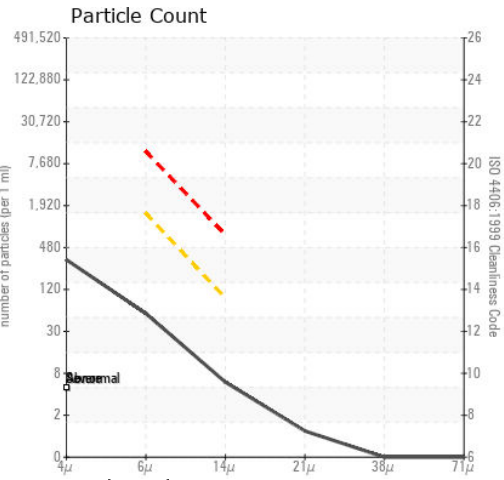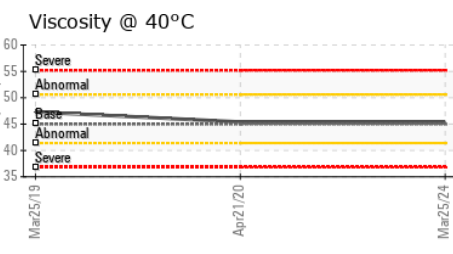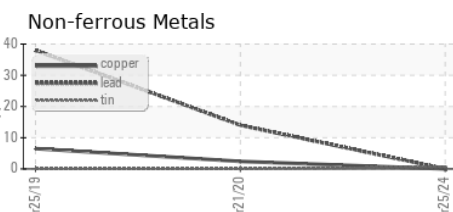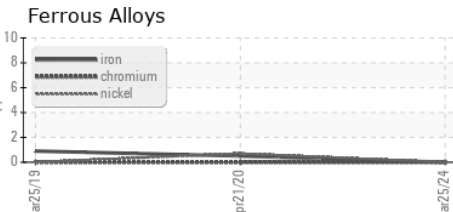

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA013916 **Received** : 02 Apr 2024  
**Lab Number** : 06136908 **Tested** : 03 Apr 2024  
**Unique Number** : 10956373 **Diagnosed** : 04 Apr 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**L3 COUMMUNICATIONS**  
 6700 SE 59TH ST  
 OKLAHOMA CITY, OK  
 US 73135  
 Contact: D. GAITHE  
 d.gaithe@caemilusa.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)