


OIL ANALYSIS REPORT

Sample Rating Trend



WATER

Machine Id

BUSCH 15767-C7346-2

Compone Pump

USPI VAC 100 (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jan 2022 N	Mar2022 Jul2022 Nov20	22 Feb 2023 Jul 2023 Oct 2023	Mar2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USPM36618	USP0002954	USPM28461
Sample Date		Client Info		26 Mar 2024	30 Oct 2023	18 Jul 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>90	0	0	<1
Chromium	ppm	ASTM D5185m	>5	<1	<1	0
Nickel	ppm	ASTM D5185m	>5	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	<1	0
Silver	ppm	ASTM D5185m	>3	0	0	0
Aluminum	ppm	ASTM D5185m	>7	0	0	1
Lead	ppm	ASTM D5185m	>12	0	0	0
Copper	ppm	ASTM D5185m	>30	0	<1	0
Tin	ppm	ASTM D5185m	>9	<1	<1	0
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	<1	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	2	0
Barium	ppm	ASTM D5185m	0	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	<1	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	0	<1	0	<1
Calcium	ppm	ASTM D5185m	0	4	0	<1
Phosphorus	ppm	ASTM D5185m	1800	1414	1250	1188
Zinc	ppm	ASTM D5185m	0	3	3	1
Sulfur	ppm	ASTM D5185m	0	140	182	201
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>60	9	9	10
Sodium	ppm	ASTM D5185m		0	1	0
Potassium	ppm	ASTM D5185m	>20	<1	2	<1
Water	%	ASTM D6304	>.1	<u> </u>	0.067	0.066
ppm Water	ppm	ASTM D6304	>1000	<u> </u>	670.5	664.1
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	14885	312	241
Particles >6µm		ASTM D7647	>1300	A 3702	89	71
Particles >14µm		ASTM D7647	>160	<u> </u>	9	8
Particles >21μm		ASTM D7647	>40	30	3	2
Particles >38µm		ASTM D7647	>10	1	1	1
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>19/17/14	<u>^</u> 21/19/15	15/14/10	15/13/10
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.05	0.93	0.51	0.38



OIL ANALYSIS REPORT

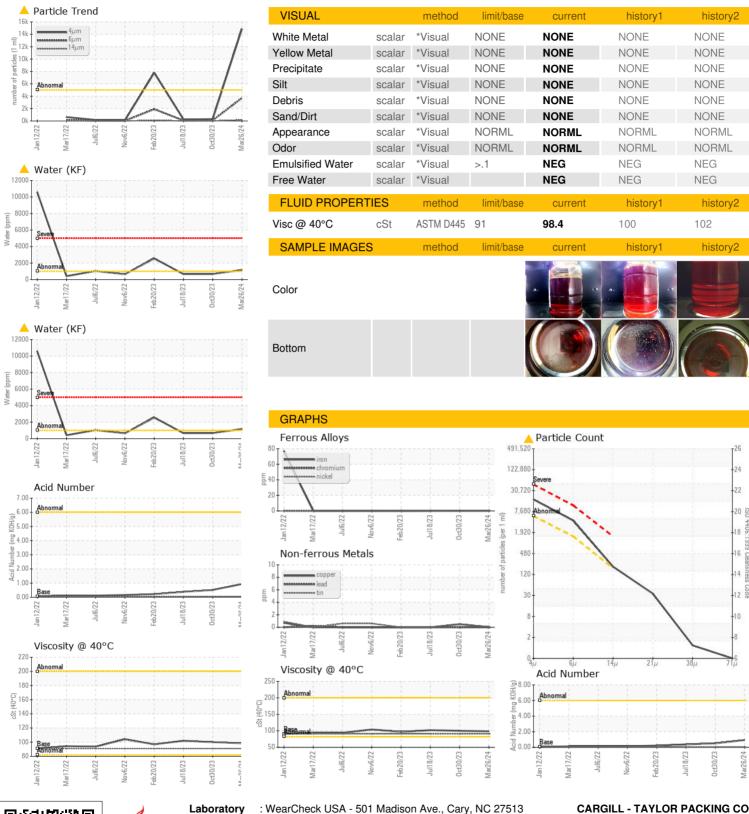





Certificate 12367

Laboratory Sample No.

: USPM36618 : 06137459

Lab Number Unique Number : 10956924

Tested : 04 Apr 2024 Diagnosed : 04 Apr 2024 - Doug Bogart Test Package : IND 2

Received

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: SERVICE MANAGER? - CARWYA

: 03 Apr 2024

WYALUSING, PA

Contact: SERVICE MANAGER

US 18853

T:

F: