




# OIL ANALYSIS REPORT

## Sample Rating Trend

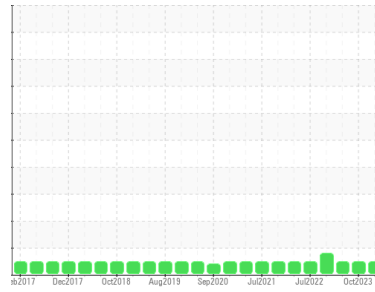

**NORMAL**



Machine Id  
**BUSCH 8 BUSCH (S/N 15278-C8427)**  
 Component  
**Pump**  
 Fluid  
**USPI VAC 100 (--- GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USPM36616</b>	USP0002959	USPM28464
Sample Date	Client Info	<b>26 Mar 2024</b>	30 Oct 2023	18 Jul 2023
Machine Age	hrs Client Info	<b>0</b>	0	0
Oil Age	hrs Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

### WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >90	<b>1</b>	2	2
Chromium	ppm ASTM D5185m >5	<b>&lt;1</b>	<1	0
Nickel	ppm ASTM D5185m >5	<b>0</b>	0	0
Titanium	ppm ASTM D5185m >3	<b>0</b>	<1	0
Silver	ppm ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm ASTM D5185m >7	<b>0</b>	0	<1
Lead	ppm ASTM D5185m >12	<b>0</b>	0	0
Copper	ppm ASTM D5185m >30	<b>0</b>	<1	0
Tin	ppm ASTM D5185m >9	<b>0</b>	<1	0
Vanadium	ppm ASTM D5185m	<b>0</b>	<1	0
Cadmium	ppm ASTM D5185m	<b>0</b>	<1	0

### ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm ASTM D5185m 0	<b>0</b>	0	0
Molybdenum	ppm ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm ASTM D5185m 0	<b>0</b>	0	0
Calcium	ppm ASTM D5185m 0	<b>3</b>	0	0
Phosphorus	ppm ASTM D5185m 1800	<b>1319</b>	1051	948
Zinc	ppm ASTM D5185m 0	<b>0</b>	<1	0
Sulfur	ppm ASTM D5185m 0	<b>0</b>	24	0

### CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >60	<b>3</b>	4	4
Sodium	ppm ASTM D5185m	<b>0</b>	<1	0
Potassium	ppm ASTM D5185m >20	<b>&lt;1</b>	1	<1
Water	% ASTM D6304 >.1	<b>0.033</b>	0.040	0.040
ppm Water	ppm ASTM D6304 >1000	<b>338</b>	403.0	408.0

### FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >5000	<b>926</b>	459	403
Particles >6µm	ASTM D7647 >1300	<b>161</b>	134	78
Particles >14µm	ASTM D7647 >160	<b>16</b>	13	4
Particles >21µm	ASTM D7647 >40	<b>5</b>	3	2
Particles >38µm	ASTM D7647 >10	<b>1</b>	0	0
Particles >71µm	ASTM D7647 >3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >19/17/14	<b>17/15/11</b>	16/14/11	16/13/9

### FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045 0.05	<b>0.12</b>	0.08	0.08




# OIL ANALYSIS REPORT

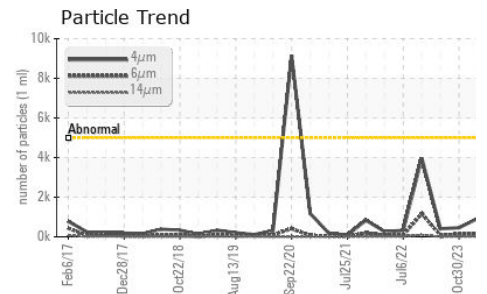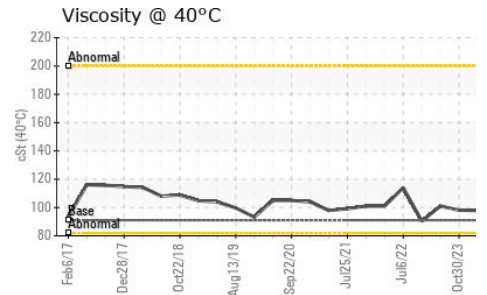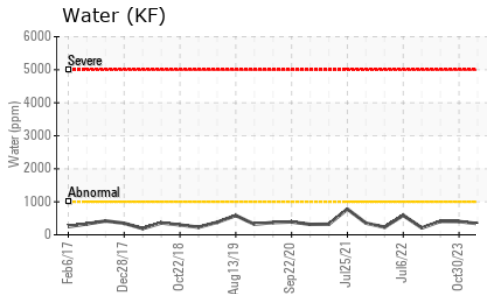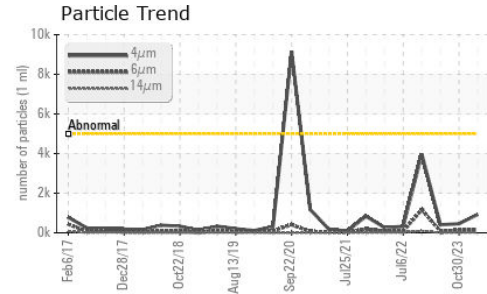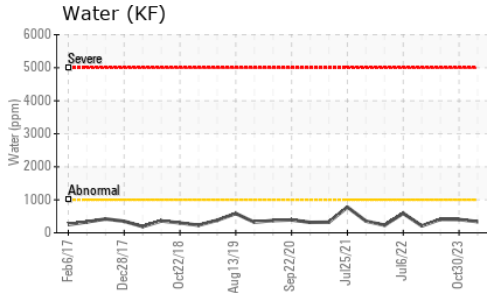






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 91	97.9	98.1	101

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

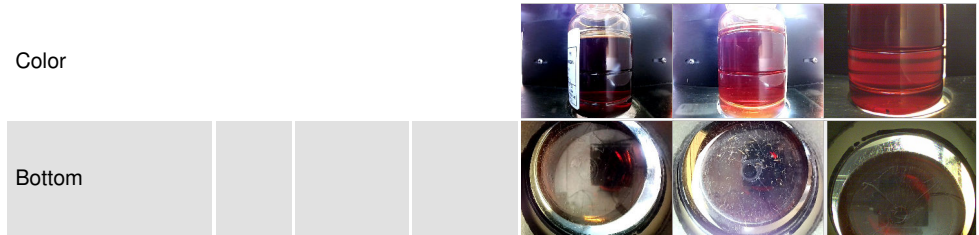

## GRAPHS

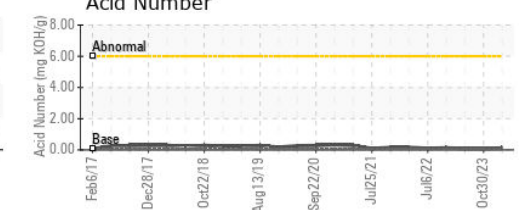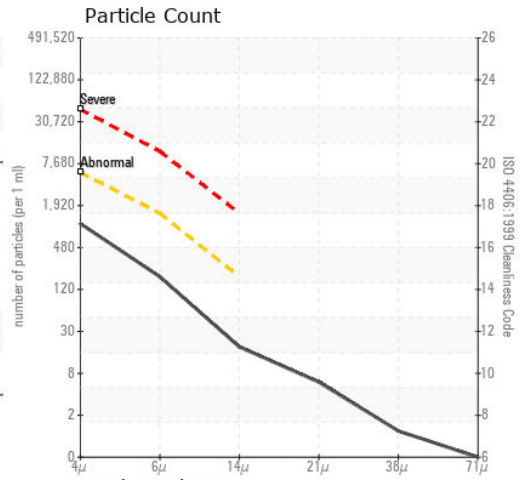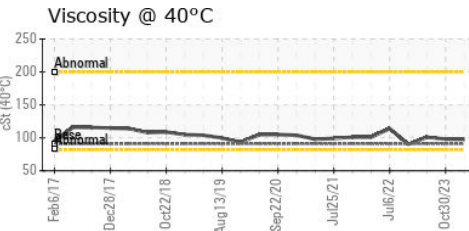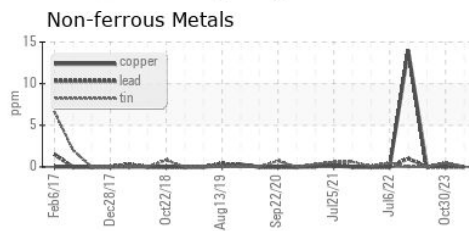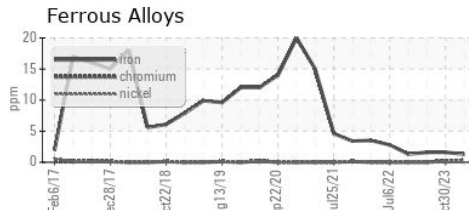

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : USPM36616  
 Lab Number : 06137461  
 Unique Number : 10956926  
 Test Package : IND 2

**CARGILL - TAYLOR PACKING CO**  
 WYALUSING, PA  
 US 18853  
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: