


# **OIL ANALYSIS REPORT**

Sample Rating Trend

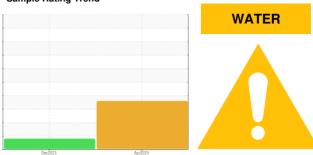

Machine Id

# ACP 0 (S/N MOX1010310)

Component
Air Compressor

**INGERSOLL-RAND SSR ULTRA COOLANT (--- GAL)** 

## DIAGNOSIS

#### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

#### Wear

All component wear rates are normal.

#### Contamination

There is a moderate concentration of water present in the oil. There is a moderate amount of visible silt present in the sample. The high sodium (Na) level indicates the possible presence of salt water.


### Fluid Condition

The AN level is acceptable for this fluid.

` '						
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0008105	USP0004434	
Sample Date		Client Info		02 Apr 2024	18 Dec 2023	
Machine Age	hrs	Client Info		0	0	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		N/A	N/A	
Sample Status				ABNORMAL	ATTENTION	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>4	<1	0	
Nickel	ppm	ASTM D5185m	>4	0	0	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m		0	0	
Aluminum	ppm	ASTM D5185m	>10	2	0	
Lead	ppm	ASTM D5185m	>20	0	0	
Copper	ppm	ASTM D5185m	>40	<1	0	
Tin	ppm	ASTM D5185m	>5	<1	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	500	579	942	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	0	2	0	
Calcium	ppm	ASTM D5185m	0	9	<1	
Phosphorus	ppm	ASTM D5185m	20	7	5	
Zinc	ppm	ASTM D5185m	0	<1	0	
Sulfur	ppm	ASTM D5185m	200	291	319	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	1	
Sodium	ppm	ASTM D5185m		<u>81</u>	2	
Potassium	ppm	ASTM D5185m	>20	5	<1	
Water	%	ASTM D6304	>0.6	<b>0.976</b>	0.138	
ppm Water	ppm	ASTM D6304	>6000	<b>△</b> 9760	1382	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000		10757	
Particles >6µm		ASTM D7647	>2500		2356	
Particles >14μm		ASTM D7647	>320		136	
Particles >21µm		ASTM D7647	>80		39	
Particles >38μm		ASTM D7647	>20		1	
Particles >71μm		ASTM D7647	>4		0	
Oil Cleanliness		ISO 4406 (c)	>20/18/15		21/18/14	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.054	0.092	



## **OIL ANALYSIS REPORT**

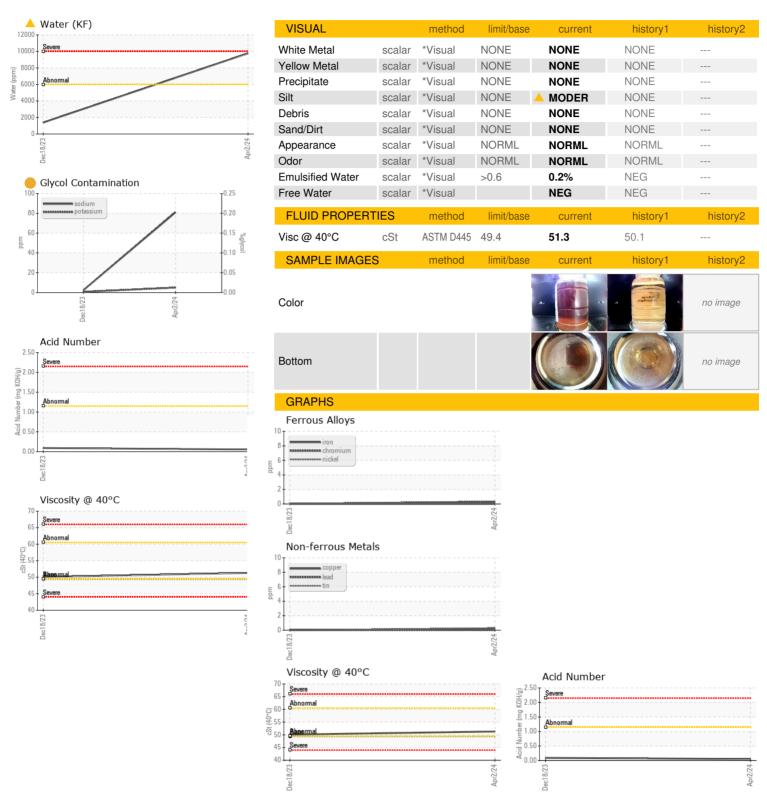





Certificate 12367

Laboratory Sample No.

Lab Number : 06137464 Unique Number : 10956929

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : USP0008105

Received **Tested** Diagnosed

: 03 Apr 2024 : 05 Apr 2024 : 05 Apr 2024 - Doug Bogart

**PILGRIMS** 928 MARTIN LUTHER KING JR BLVD NACOGDOCHES, TX US 75961

Contact: KERRI SULLIVAN

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (936)558-6928