

# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Machine Id  
**JBS AMM 2**  
Component  
**Refrigeration Compressor**  
Fluid  
**REFRIG COMP OIL ISO 68 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) REFRIG COMP OIL ISO 68. Please confirm.

### Wear

All component wear rates are normal.

### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>Y2K0001783</b>	---	---
Sample Date	Client Info		<b>25 Mar 2024</b>	---	---
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed		Client Info	<b>N/A</b>	---	---
Sample Status			<b>NORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>&lt;1</b>	---	---
Chromium	ppm	ASTM D5185m >2	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >3	<b>2</b>	---	---
Lead	ppm	ASTM D5185m >2	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >8	<b>0</b>	---	---
Tin	ppm	ASTM D5185m >4	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 5	<b>0</b>	---	---
Barium	ppm	ASTM D5185m 5	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m 5	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m 5	<b>0</b>	---	---
Calcium	ppm	ASTM D5185m 12	<b>3</b>	---	---
Phosphorus	ppm	ASTM D5185m 12	<b>0</b>	---	---
Zinc	ppm	ASTM D5185m 12	<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m 1000	<b>0</b>	---	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>0</b>	---	---
Sodium	ppm	ASTM D5185m	<b>0</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	---	---
Water	%	ASTM D6304 >0.01	<b>0.001</b>	---	---
ppm Water	ppm	ASTM D6304 >100	<b>15</b>	---	---






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>3650</b>	---	---
Particles >6µm	ASTM D7647	>2500	<b>567</b>	---	---
Particles >14µm	ASTM D7647	>320	<b>19</b>	---	---
Particles >21µm	ASTM D7647	>80	<b>4</b>	---	---
Particles >38µm	ASTM D7647	>20	<b>0</b>	---	---
Particles >71µm	ASTM D7647	>4	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>19/16/11</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.10	<b>0.014</b>	---	---

# OIL ANALYSIS REPORT

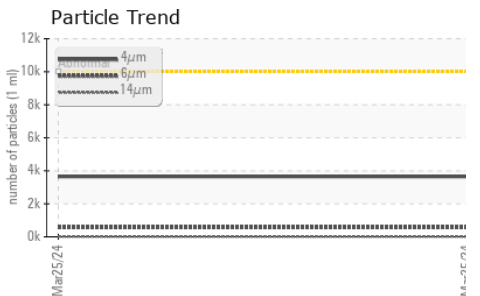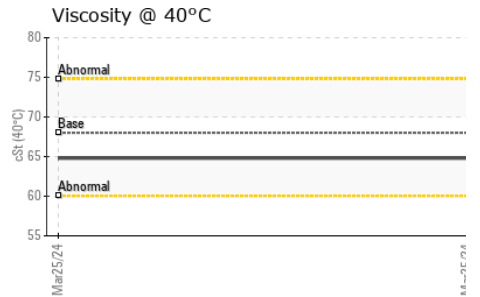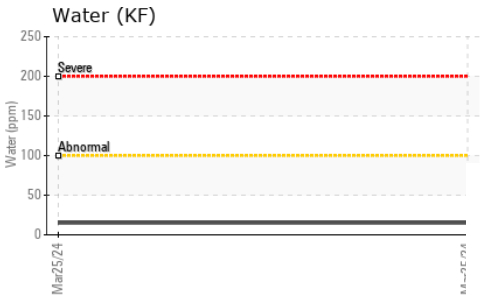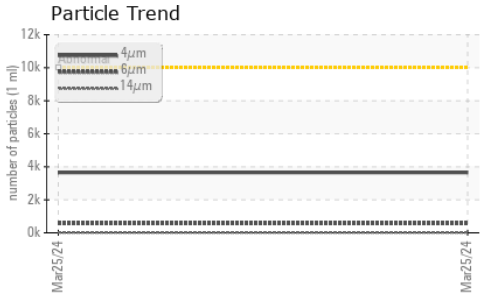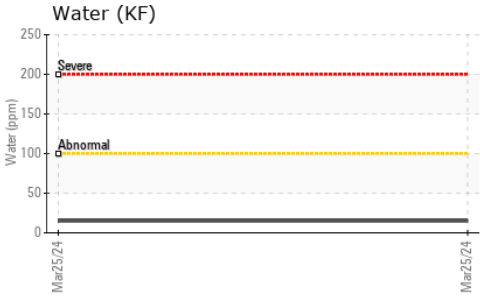





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	68	64.8	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

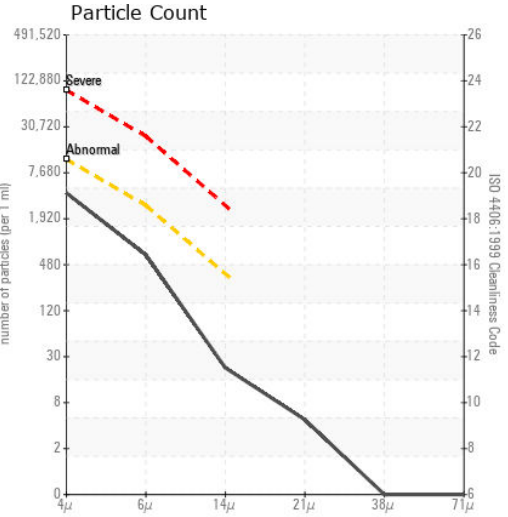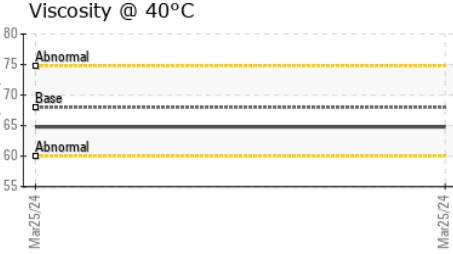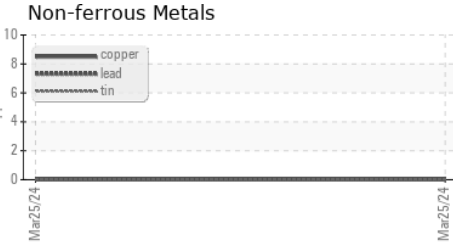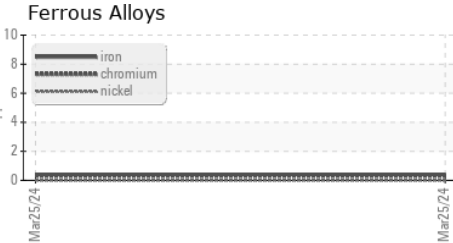

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : Y2K0001783      **Received** : 03 Apr 2024  
**Lab Number** : 06137496      **Tested** : 04 Apr 2024  
**Unique Number** : 10956961      **Diagnosed** : 04 Apr 2024 - Wes Davis  
**Test Package** : MOB 2 ( Additional Tests: KF, PrtCount )

**Y2K FLUID POWER**  
 3620 N LEWIS AVE  
 SIOUX FALLS, SD  
 US 57104  
 Contact: SERVICE MANAGER  
 sales@y2kfiltration.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)      F: (605)332-0988