

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Machine Id
JBS AMM 4
Component
Refrigeration Compressor
Fluid
REFRIG COMP OIL ISO 68 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) REFRIG COMP OIL ISO 68. Please confirm.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		Y2K0001782	---	---
Sample Date	Client Info		25 Mar 2024	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed		Client Info	N/A	---	---
Sample Status			NORMAL	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	0	---	---
Chromium	ppm	ASTM D5185m >2	<1	---	---
Nickel	ppm	ASTM D5185m	0	---	---
Titanium	ppm	ASTM D5185m	0	---	---
Silver	ppm	ASTM D5185m >2	0	---	---
Aluminum	ppm	ASTM D5185m >3	2	---	---
Lead	ppm	ASTM D5185m >2	0	---	---
Copper	ppm	ASTM D5185m >8	0	---	---
Tin	ppm	ASTM D5185m >4	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 5	0	---	---
Barium	ppm	ASTM D5185m 5	0	---	---
Molybdenum	ppm	ASTM D5185m 5	0	---	---
Manganese	ppm	ASTM D5185m	0	---	---
Magnesium	ppm	ASTM D5185m 5	0	---	---
Calcium	ppm	ASTM D5185m 12	3	---	---
Phosphorus	ppm	ASTM D5185m 12	0	---	---
Zinc	ppm	ASTM D5185m 12	0	---	---
Sulfur	ppm	ASTM D5185m 1000	0	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	0	---	---
Sodium	ppm	ASTM D5185m	0	---	---
Potassium	ppm	ASTM D5185m >20	<1	---	---
Water	%	ASTM D6304 >0.01	0.002	---	---
ppm Water	ppm	ASTM D6304 >100	20	---	---






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	1072	---	---
Particles >6µm	ASTM D7647	>2500	132	---	---
Particles >14µm	ASTM D7647	>320	9	---	---
Particles >21µm	ASTM D7647	>80	2	---	---
Particles >38µm	ASTM D7647	>20	0	---	---
Particles >71µm	ASTM D7647	>4	0	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	17/14/10	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.10	0.014	---	---

OIL ANALYSIS REPORT

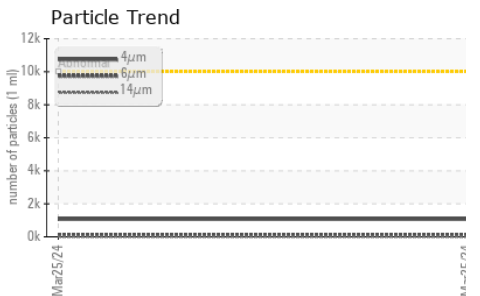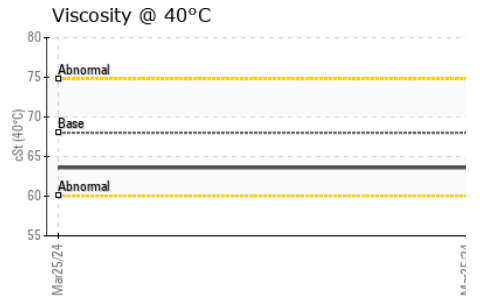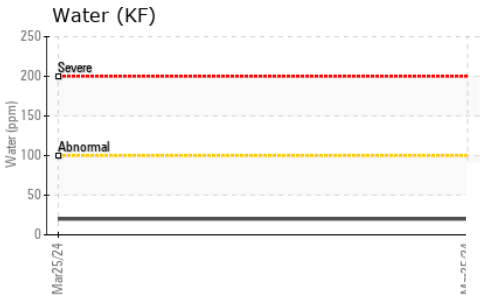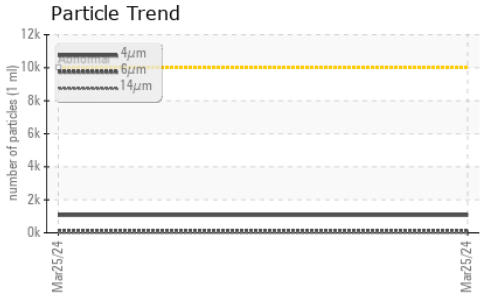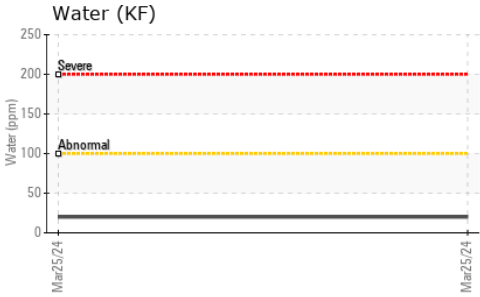






VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 68	63.6	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

GRAPHS

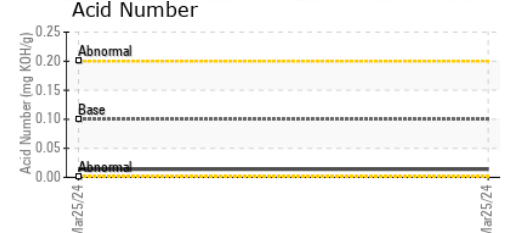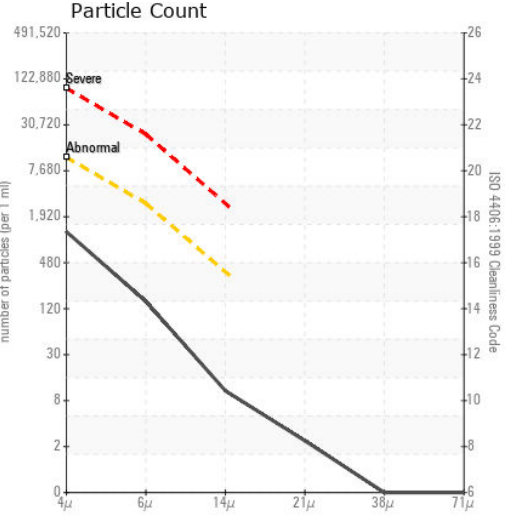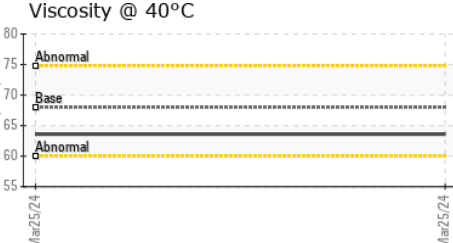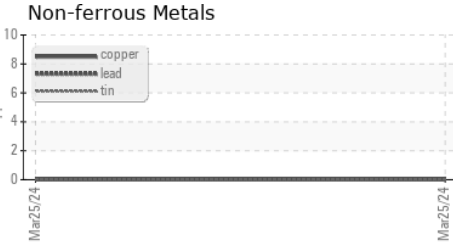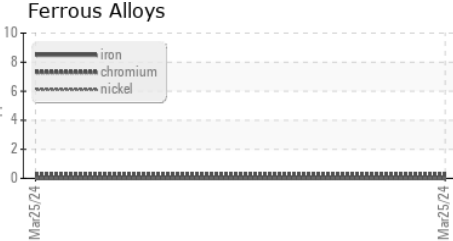

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : Y2K0001782 **Received** : 03 Apr 2024
Lab Number : **06137498** **Tested** : 04 Apr 2024
Unique Number : 10956963 **Diagnosed** : 04 Apr 2024 - Wes Davis
Test Package : MOB 2 (Additional Tests: KF, PrtCount)

Y2K FLUID POWER
 3620 N LEWIS AVE
 SIOUX FALLS, SD
 US 57104
 Contact: SERVICE MANAGER
 sales@y2kfiltration.com

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: (605)332-0988