

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Machine Id
JBS AMM 5
Component
Refrigeration Compressor
Fluid
REFRIG COMP OIL ISO 68 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) REFRIG COMP OIL ISO 68. Please confirm.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			Y2K0001786	---	---
Sample Date	Client Info			25 Mar 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Oil Changed	Client Info			N/A	---	---
Sample Status				NORMAL	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	<1	---	---
Chromium	ppm	ASTM D5185m	>2	<1	---	---
Nickel	ppm	ASTM D5185m		0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m	>2	0	---	---
Aluminum	ppm	ASTM D5185m	>3	2	---	---
Lead	ppm	ASTM D5185m	>2	0	---	---
Copper	ppm	ASTM D5185m	>8	0	---	---
Tin	ppm	ASTM D5185m	>4	0	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
Cadmium	ppm	ASTM D5185m		0	---	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	0	---	---
Barium	ppm	ASTM D5185m	5	0	---	---
Molybdenum	ppm	ASTM D5185m	5	0	---	---
Manganese	ppm	ASTM D5185m		0	---	---
Magnesium	ppm	ASTM D5185m	5	<1	---	---
Calcium	ppm	ASTM D5185m	12	3	---	---
Phosphorus	ppm	ASTM D5185m	12	0	---	---
Zinc	ppm	ASTM D5185m	12	0	---	---
Sulfur	ppm	ASTM D5185m	1000	0	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	0	---	---
Sodium	ppm	ASTM D5185m		0	---	---
Potassium	ppm	ASTM D5185m	>20	<1	---	---
Water	%	ASTM D6304	>0.01	0.001	---	---
ppm Water	ppm	ASTM D6304	>100	14	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	5230	---	---
Particles >6µm		ASTM D7647	>2500	812	---	---
Particles >14µm		ASTM D7647	>320	18	---	---
Particles >21µm		ASTM D7647	>80	3	---	---
Particles >38µm		ASTM D7647	>20	0	---	---
Particles >71µm		ASTM D7647	>4	0	---	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	20/17/11	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.10	0.028	---	---


OIL ANALYSIS REPORT

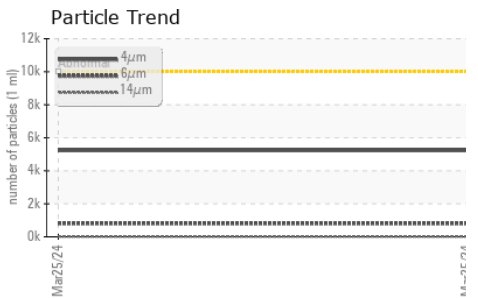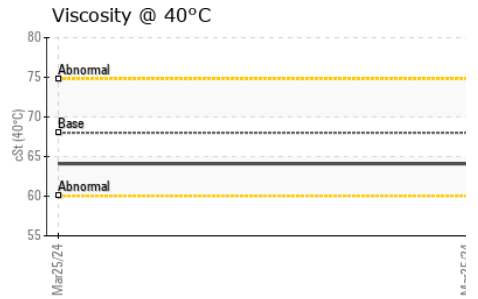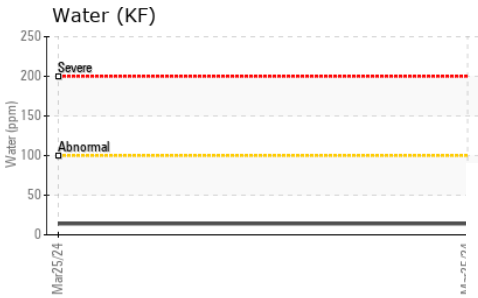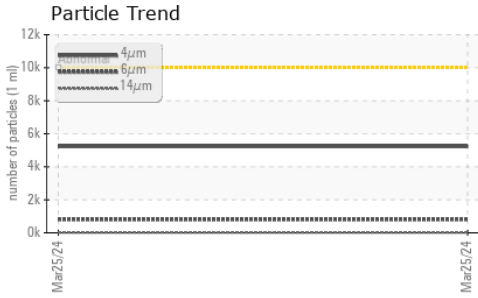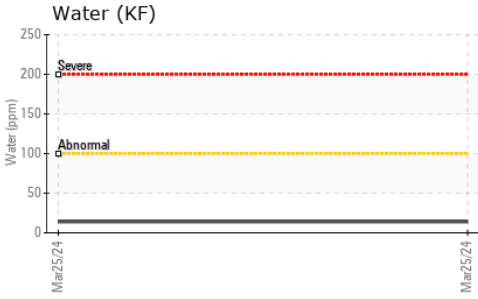





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	68	64.1	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

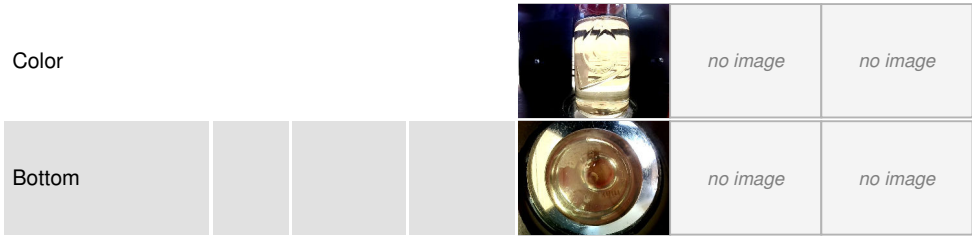

GRAPHS

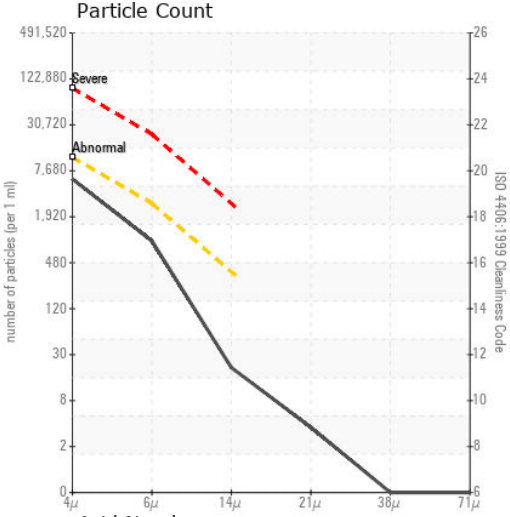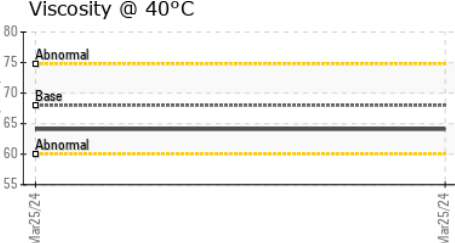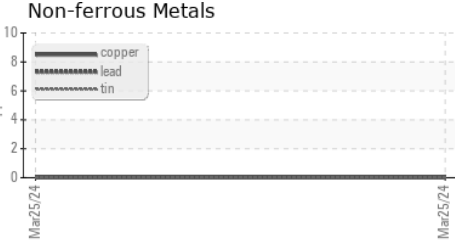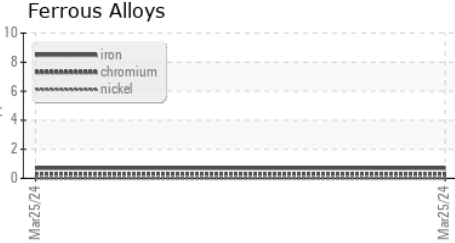

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : Y2K0001786 **Received** : 03 Apr 2024
Lab Number : 06137499 **Tested** : 04 Apr 2024
Unique Number : 10956964 **Diagnosed** : 04 Apr 2024 - Wes Davis
Test Package : MOB 2 (Additional Tests: KF, PrtCount)

Y2K FLUID POWER
 3620 N LEWIS AVE
 SIOUX FALLS, SD
 US 57104
 Contact: SERVICE MANAGER
 sales@y2kfiltration.com

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: (605)332-0988