

OIL ANALYSIS REPORT

Sample Rating Trend







Machine Id JBS AMM 1 Component Refrigeration Compressor Fluid REFRIG COMP OIL ISO 68 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) REFRIG COMP OIL ISO 68. Please confirm.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		Y2K0001781		
Sample Date		Client Info		25 Mar 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0		
Chromium	ppm	ASTM D5185m	>2	0		
Nickel	ppm	ASTM D5185m	~	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m		0		
Lead	ppm	ASTM D5185m	>2	0		
Copper	ppm	ASTM D5185m	>8	0		
Tin	ppm	ASTM D5185m	>4	0		
Vanadium	ppm	ASTM D5185m	~ 7	0		
Cadmium	ppm	ASTM D5185m		0		
	ррш			U		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	0		
Barium	ppm	ASTM D5185m	5	0		
Molybdenum	ppm	ASTM D5185m	5	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	5	0		
Calcium	ppm	ASTM D5185m	12	0		
Phosphorus	ppm	ASTM D5185m	12	0		
Zinc	ppm	ASTM D5185m	12	0		
Sulfur	ppm	ASTM D5185m	1000	0		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.01	0.002		
ppm Water	ppm	ASTM D6304	>100	16		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	6483		
Particles >6µm		ASTM D7647	>2500	1025		
Particles >14µm		ASTM D7647	>320	21		
Particles >21µm		ASTM D7647	>80	2		
Particles >38µm		ASTM D7647	>20	0		
Particles >71µm		ASTM D7647	>4	0		
Oil Cleanliness		ISO 4406 (c)	>20/18/15	20/17/12		
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.10	0.028		

Contact/Location: SERVICE MANAGER - Y2KSIO Page 1 of 2




OIL ANALYSIS REPORT

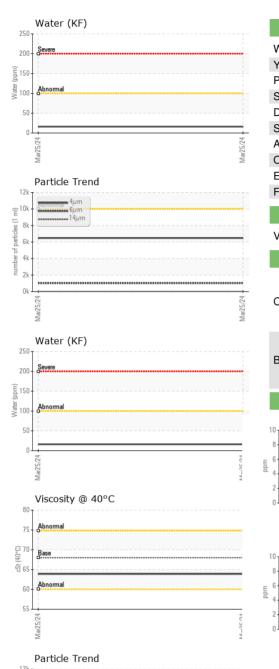

12 Ê¹⁰⁸ narticles (1 8k 6 * 4k 2 0

Certificate L2367

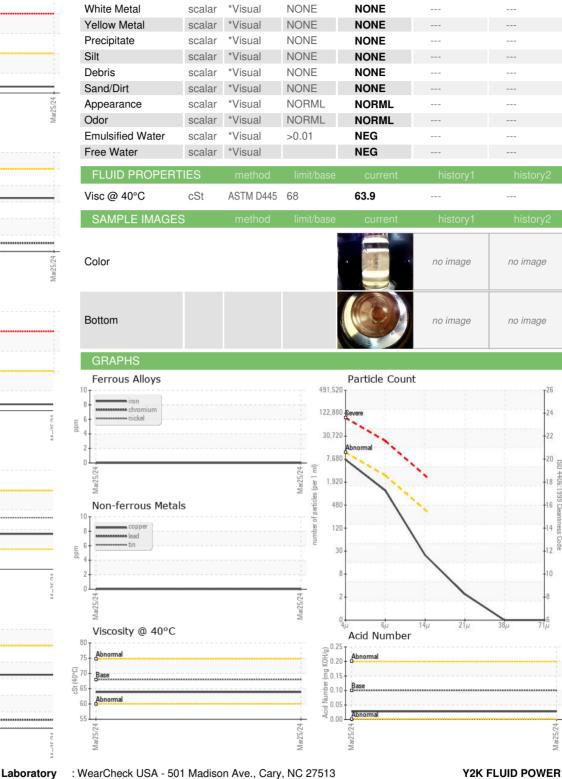



Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) Report Id: Y2KSIO [WUSCAR] 06137500 (Generated: 04/04/2024 11:39:18) Rev: 1

Unique Number : 10956965

: Y2K0001781

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Test Package : MOB 2 (Additional Tests: KF, PrtCount)

: 06137500

Received

Diagnosed

Tested

: 03 Apr 2024

: 04 Apr 2024

: 04 Apr 2024 - Wes Davis

Sample No.

Lab Number

Contact/Location: SERVICE MANAGER - Y2KSIO

US 57104

T:

3620 N LEWIS AVE

sales@y2kfiltration.com

Contact: SERVICE MANAGER

SIOUX FALLS, SD

F: (605)332-0988

4406

:1999 Cle

14