




OIL ANALYSIS REPORT

Sample Rating Trend

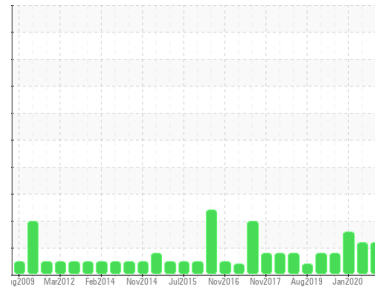

ISO



Machine Id
359.XX097 HYDRAULIC FINES BIN (S/N 359-097-29)
 Component
Hydraulic System
 Fluid
MOBIL DTE 10 EXCEL 68 (20 GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor. Please submit a sample of the new (unused) oil to verify and confirm current baseline.

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil. MPC (Membrane Patch Colorimetry) test indicates acceptable levels of varnish present.

Fluid Condition

The AN level is acceptable for this fluid. Linear Sweep Voltammetry (RULER – ASTM D6971) testing indicates normal levels of anti-oxidants present in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	RP0008490	RP0003356	RP203659
Sample Date	Client Info	28 Mar 2024	22 Apr 2020	29 Jan 2020
Machine Age	mths	Client Info	0	0
Oil Age	mths	Client Info	0	2
Oil Changed	Client Info	N/A	Not Changd	Not Changd
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	<1	<1
Chromium	ppm	ASTM D5185m >20	0	0
Nickel	ppm	ASTM D5185m >20	0	0
Titanium	ppm	ASTM D5185m	0	0
Silver	ppm	ASTM D5185m	0	<1
Aluminum	ppm	ASTM D5185m >20	0	0
Lead	ppm	ASTM D5185m >20	0	<1
Copper	ppm	ASTM D5185m >20	0	<1
Tin	ppm	ASTM D5185m >20	0	<1
Antimony	ppm	ASTM D5185m	---	0
Vanadium	ppm	ASTM D5185m	0	0
Cadmium	ppm	ASTM D5185m	0	<1

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<1
Barium	ppm	ASTM D5185m	0	0
Molybdenum	ppm	ASTM D5185m	0	0
Manganese	ppm	ASTM D5185m	0	0
Magnesium	ppm	ASTM D5185m	0	<1
Calcium	ppm	ASTM D5185m	111	108
Phosphorus	ppm	ASTM D5185m	457	420
Zinc	ppm	ASTM D5185m	12	25






CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<1	<1
Sodium	ppm	ASTM D5185m	1	0
Potassium	ppm	ASTM D5185m >20	0	<1
Water	%	ASTM D6304 >0.05	0.005	0.004
ppm Water	ppm	ASTM D6304 >500	59	41.7

FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >320	▲ 12776	▲ 14281	▲ 32174
Particles >6µm	ASTM D7647 >80	▲ 806	▲ 2048	▲ 8141
Particles >14µm	ASTM D7647 >20	13	▲ 59	▲ 385
Particles >21µm	ASTM D7647 >4	4	16	▲ 84
Particles >38µm	ASTM D7647 >3	0	0	3
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >15/13/11	▲ 21/17/11	▲ 21/18/13	▲ 22/20/16

OIL ANALYSIS REPORT

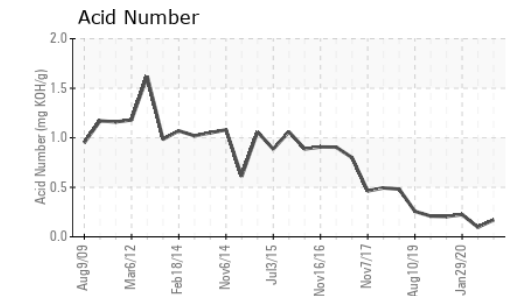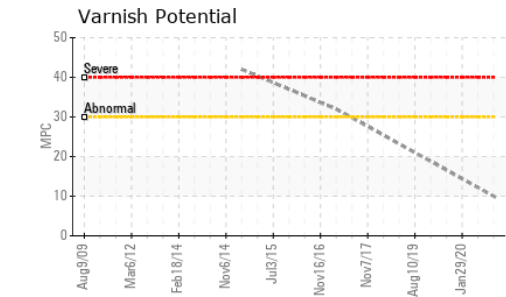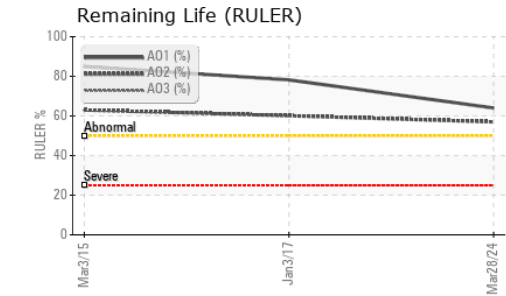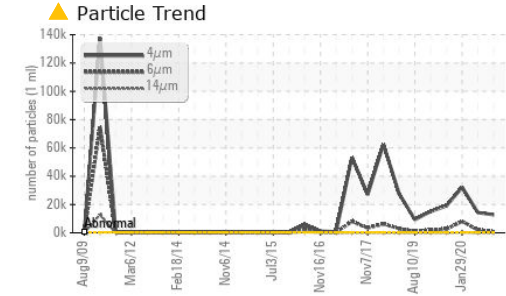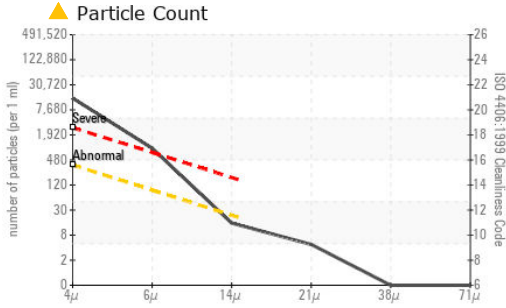

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.171	0.097	0.225
Anti-Oxidant 1	%	ASTM D6971	64	---	---
Anti-Oxidant 2	%	ASTM D6971	57	---	---
MPC Varnish Potential	Scale	ASTM D7843	10	---	---

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	68.4	68.0	69.3

SAMPLE IMAGES

	method	limit/base	current	history1	history2
Color					
Bottom					
MPC				no image	no image




Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0008490 **Received** : 03 Apr 2024
Lab Number : **06137502** **Tested** : 12 Apr 2024
Unique Number : 10956967 **Diagnosed** : 12 Apr 2024 - Doug Bogart
Test Package : AOM 1 (Additional Tests: KF)

INTERNATIONAL PAPER
 1785 Weyerhaeuser Road
 VANCEBORO, NC
 US 28586
 Contact: DOUG WEIR
 Doug.Weir@ipaper.com;jon.fazenbaker@wearcheck.com
 T: (252)633-7350
 F: (252)633-7761


To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.


Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

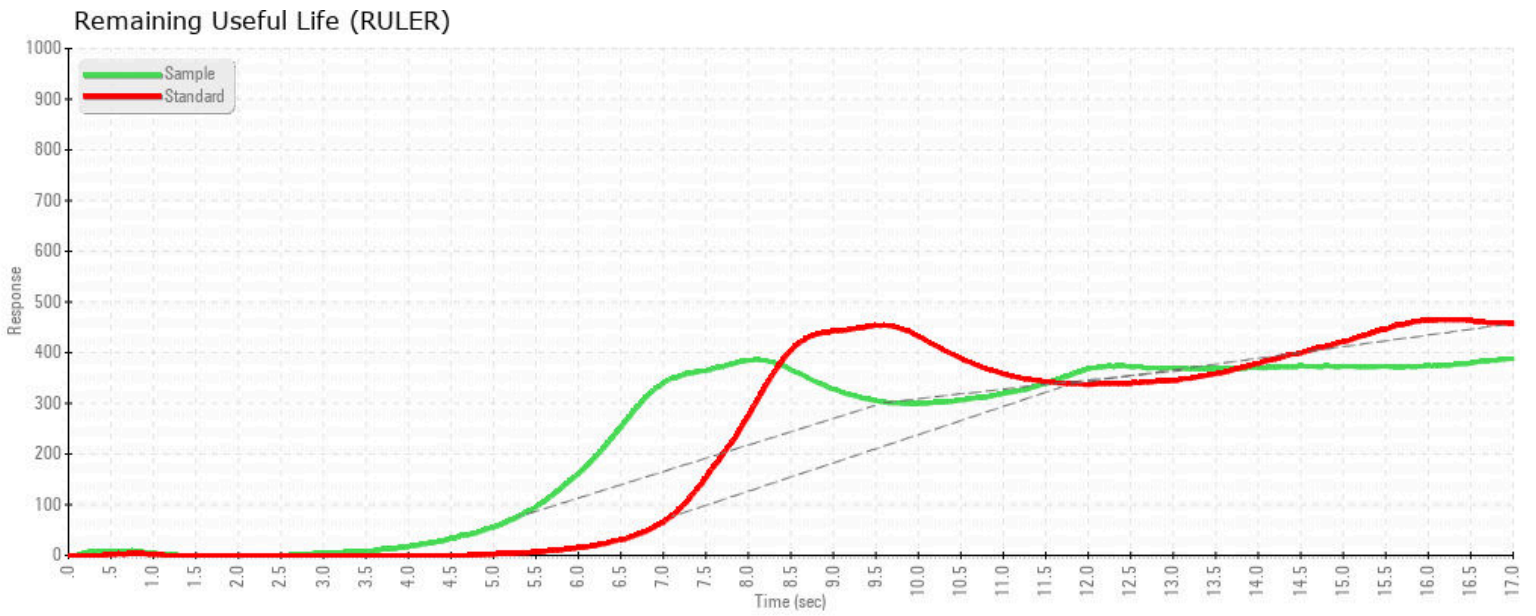

MPC (Varnish Test)

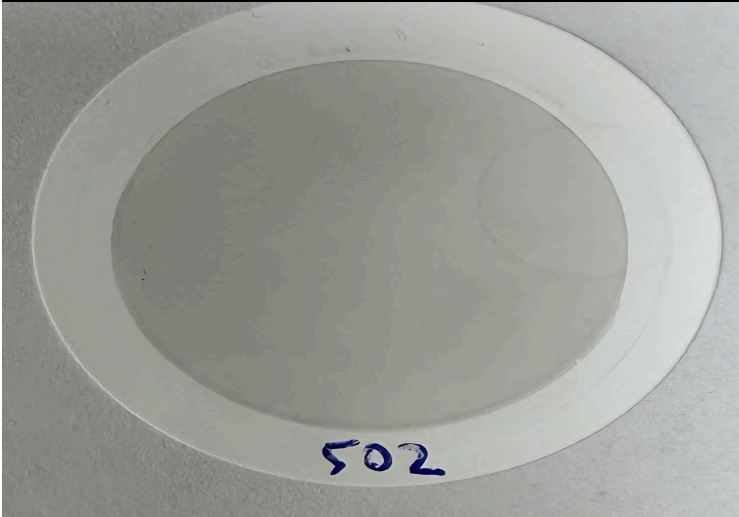

Sample Color & Clarity

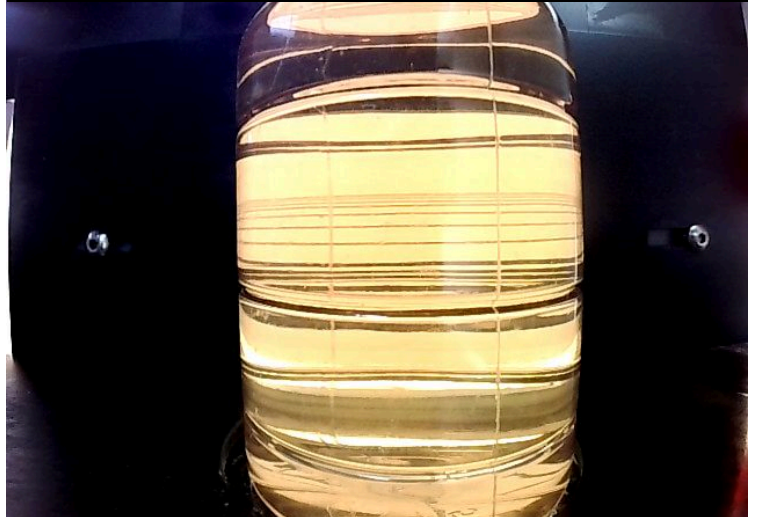

This page left intentionally blank