




# OIL ANALYSIS REPORT

## Sample Rating Trend

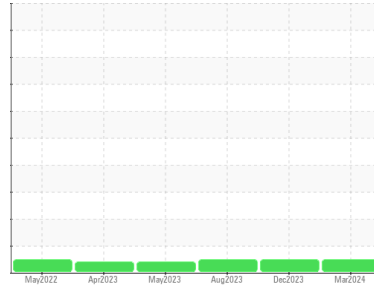

**NORMAL**



Area

**M-460**

Machine Id

**KAESER 1012 - HUGHES NETWORK SYSTEMS**

Component

**Compressor**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH06137544</b>	UCH06034135	UCH05939100
Sample Date	Client Info		<b>26 Mar 2024</b>	08 Dec 2023	25 Aug 2023
Machine Age	hrs	Client Info	<b>15865</b>	14522	13368
Oil Age	hrs	Client Info	<b>3728</b>	2385	1231
Oil Changed	Client Info		<b>Not Changed</b>	Not Changed	Not Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

### CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.05	<b>NEG</b>	NEG	NEG

### WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>50	<b>0</b>	2	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	1	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>4</b>	3	2
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

### ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>55</b>	0	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	100	<b>53</b>	25	42
Calcium	ppm	ASTM D5185m	0	<b>1</b>	0	0
Phosphorus	ppm	ASTM D5185m	0	<b>7</b>	0	3
Zinc	ppm	ASTM D5185m	0	<b>1</b>	0	10
Sulfur	ppm	ASTM D5185m	23500	<b>21524</b>	23430	21192

### CONTAMINANTS


	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	1	1
Sodium	ppm	ASTM D5185m		<b>6</b>	4	8
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	2	3

### FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.34</b>	0.25	0.30




# OIL ANALYSIS REPORT

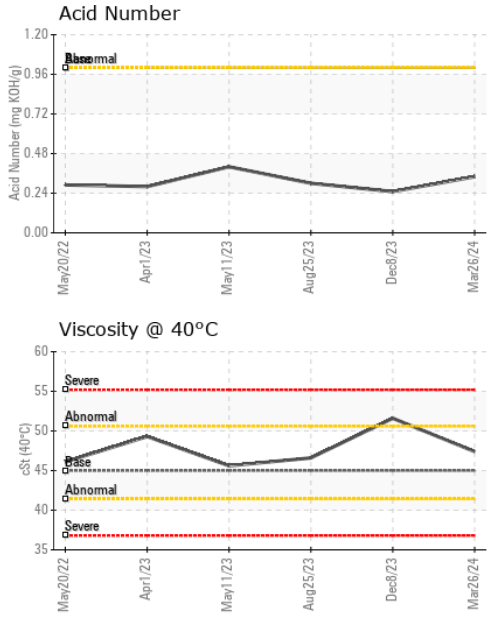



VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	47.4	51.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

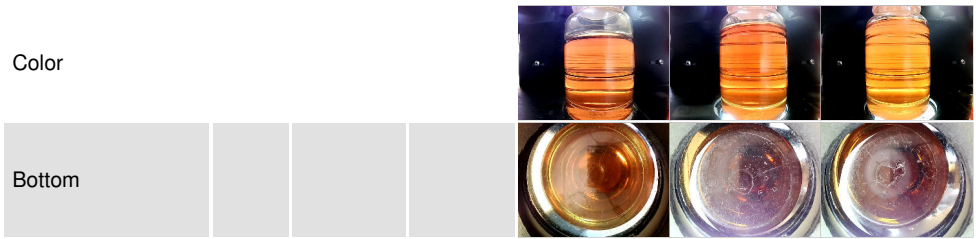

## GRAPHS

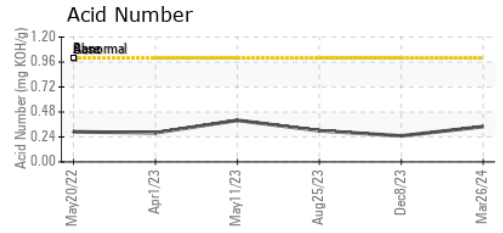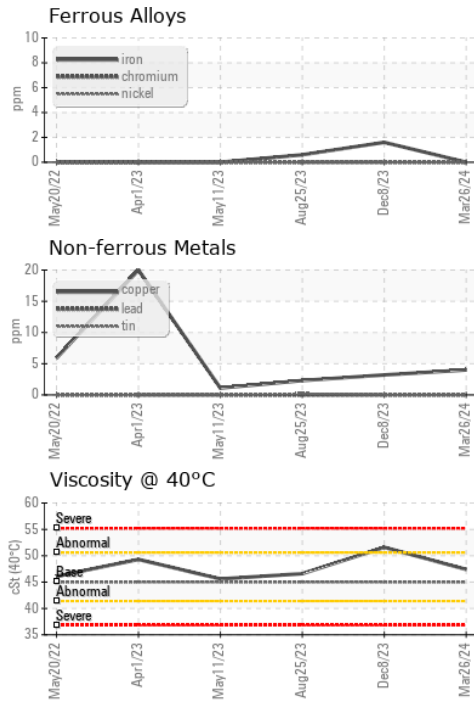

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06137544      **Received** : 03 Apr 2024  
**Lab Number** : 06137544      **Tested** : 04 Apr 2024  
**Unique Number** : 10957009      **Diagnosed** : 05 Apr 2024 - Sean Felton  
**Test Package** : IND 2

**TATE ENGINEERING**  
 3921 Vero Road  
 BALTIMORE, MD  
 US 21227  
 Contact: JOSH PLITT  
 josh.plitt@tate.com  
 T: (443)992-4413  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)