




# OIL ANALYSIS REPORT

Sample Rating Trend

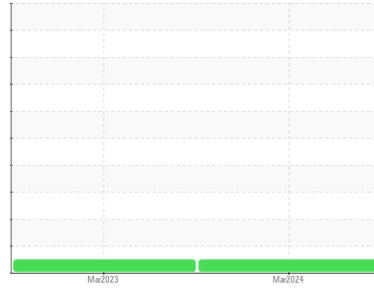

**NORMAL**



Machine Id  
**US MOTOR PUMP 5 TOP**  
 Component  
**Pump Motor**  
 Fluid  
**LUBRICATION ENG ISO 32 (4 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0802578</b>	WC0687521	---
Sample Date	Client Info			<b>28 Mar 2024</b>	15 Mar 2023	---
Machine Age	hrs	Client Info		<b>0</b>	9165	---
Oil Age	hrs	Client Info		<b>0</b>	0	---
Oil Changed	Client Info			<b>N/A</b>	N/A	---
Sample Status				<b>NORMAL</b>	NORMAL	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>2	<b>NEG</b>	NEG	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m		<b>0</b>	0	---
Silver	ppm	ASTM D5185m		<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>20	<b>0</b>	<1	---
Lead	ppm	ASTM D5185m	>20	<b>0</b>	<1	---
Copper	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Tin	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---


ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	---
Barium	ppm	ASTM D5185m		<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	1	---
Calcium	ppm	ASTM D5185m		<b>128</b>	125	---
Phosphorus	ppm	ASTM D5185m		<b>174</b>	168	---
Zinc	ppm	ASTM D5185m		<b>0</b>	0	---
Sulfur	ppm	ASTM D5185m		<b>1165</b>	937	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	---
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	<1	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.22</b>	0.09	---




# OIL ANALYSIS REPORT

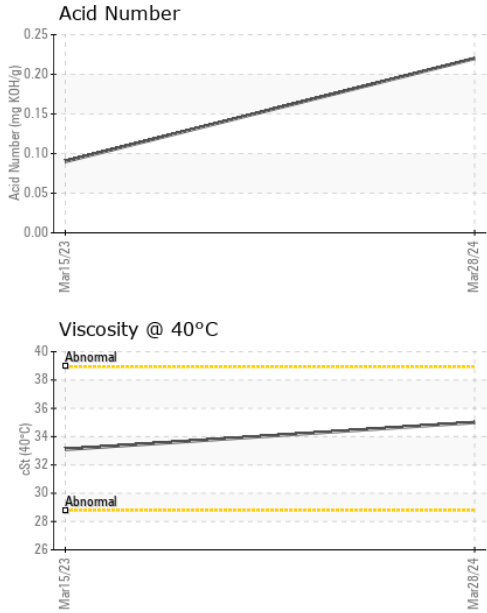





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>2	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	<b>35.0</b>	33.1	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

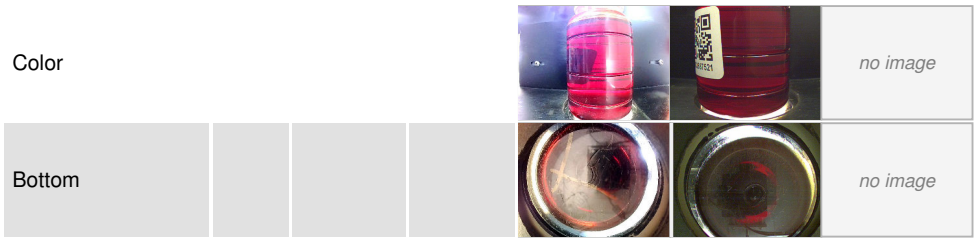

## GRAPHS

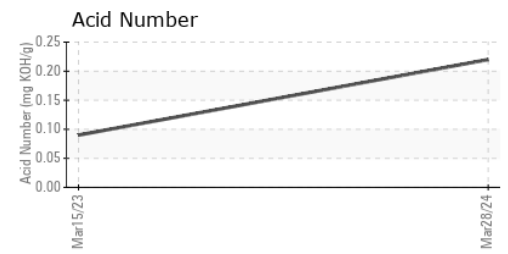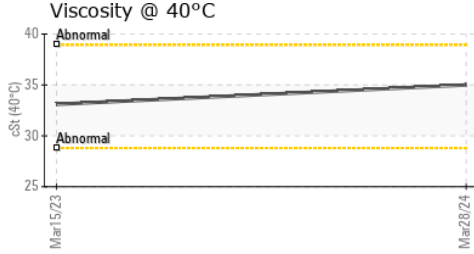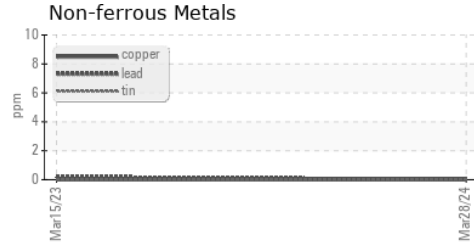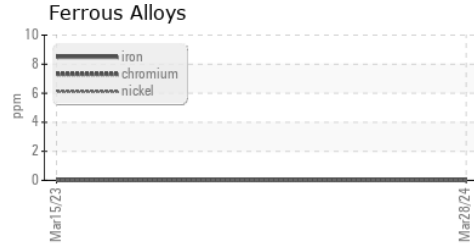

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0802578      **Received** : 03 Apr 2024  
**Lab Number** : **06137587**      **Tested** : 04 Apr 2024  
**Unique Number** : 10957052      **Diagnosed** : 05 Apr 2024 - Sean Felton  
**Test Package** : IND 2

**ELK MOUNTAINS SKI RESORT**  
 344 ELK MOUNTAIN RD  
 UNION DALE, PA  
 US 18470  
 Contact: CHRIS WELDON  
 clweldon@elkmtnpa.com  
 T: (570)679-4477  
 F: (570)679-4409

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)