





OIL ANALYSIS REPORT

Sample Rating Trend

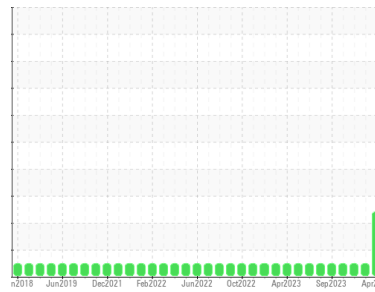

DIRT



Machine Id
Durham unit 2 (S/N 6181211)
 Component
Natural Gas Engine
 Fluid
D-A Lubricant Blue Flame HB-8 40W (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. We recommend an early resample to monitor this condition.

Wear

The aluminum level is abnormal. All other component wear rates are normal.

Contamination

Elemental level of silicon (Si) above normal.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WCM2249791	WCM2249788	WCM2249775
Sample Date	Client Info		02 Apr 2024	09 Jan 2024	23 Oct 2023
Machine Age	hrs	Client Info	18037	16362	14514
Oil Age	hrs	Client Info	0	1183	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>.2	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >60	11	10	10
Chromium	ppm	ASTM D5185m >5	1	<1	1
Nickel	ppm	ASTM D5185m >5	<1	<1	<1
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m >5	0	0	0
Aluminum	ppm	ASTM D5185m >10	▲ 13	7	8
Lead	ppm	ASTM D5185m >25	0	0	0
Copper	ppm	ASTM D5185m >100	2	2	1
Tin	ppm	ASTM D5185m >12	3	3	3
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<1	1	<1
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	5	6	6
Manganese	ppm	ASTM D5185m	0	0	<1
Magnesium	ppm	ASTM D5185m	45	48	53
Calcium	ppm	ASTM D5185m	2580	2460	2372
Phosphorus	ppm	ASTM D5185m	382	410	350
Zinc	ppm	ASTM D5185m	458	445	504
Sulfur	ppm	ASTM D5185m	4429	3978	3592

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	▲ 246	205	200
Sodium	ppm	ASTM D5185m >20	3	0	2
Potassium	ppm	ASTM D5185m >20	0	3	1

INFRA-RED






	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >2	0	0	0
Nitration	Abs/cm	*ASTM D7624 >20	8.2	7.7	7.9
Sulfation	Abs./1mm	*ASTM D7415 >30	25.2	23.6	24.6

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs./1mm	*ASTM D7414 >25	15.8	14.7	15.7
Acid Number (AN)	mg KOH/g	ASTM D8045	3.02	1.71	2.22
Base Number (BN)	mg KOH/g	ASTM D2896 8	4.18	4.27	4.25











OIL ANALYSIS REPORT

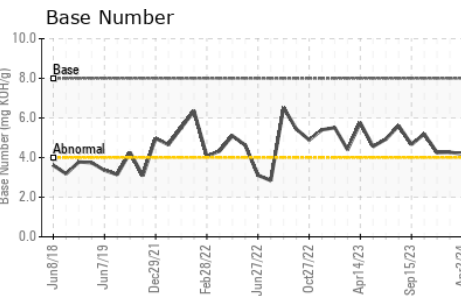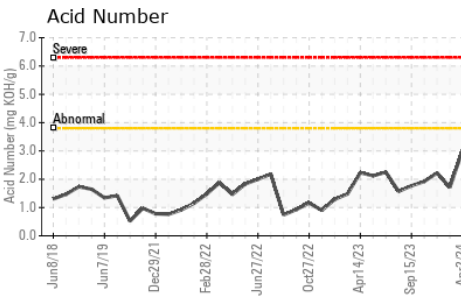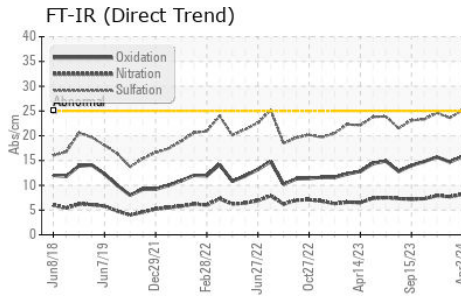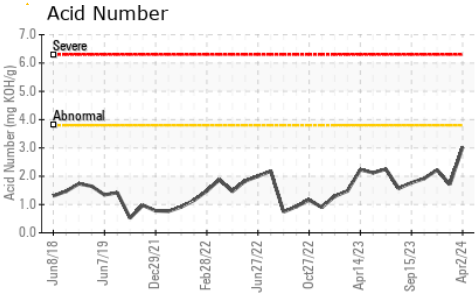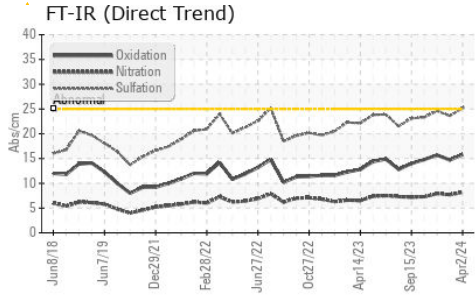

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.5	14.1	14.0

GRAPHS

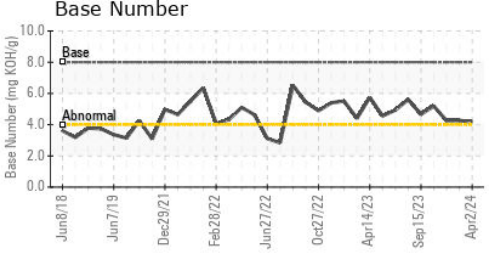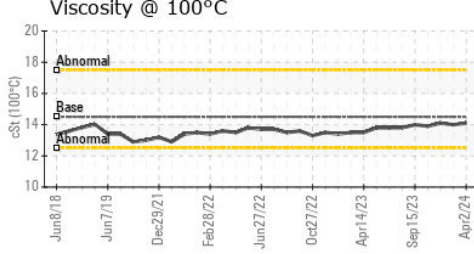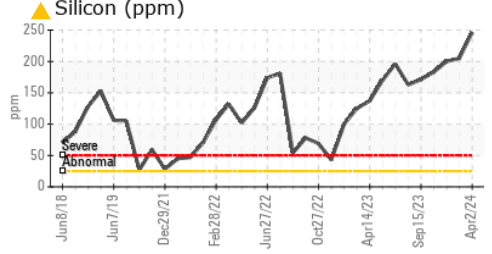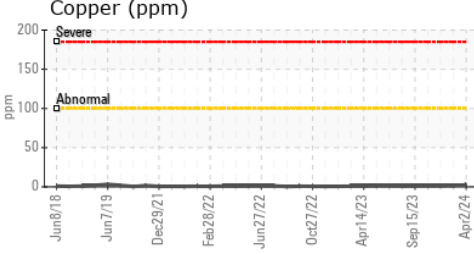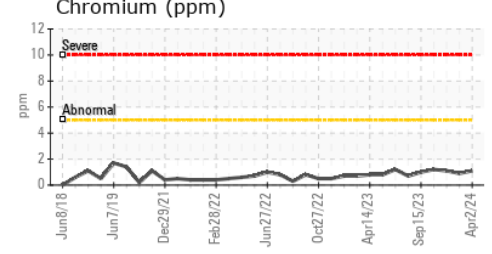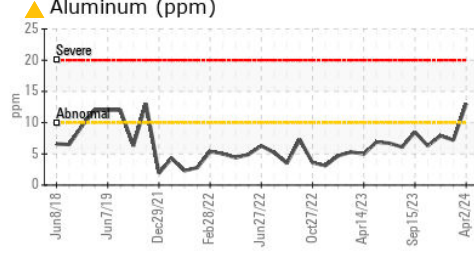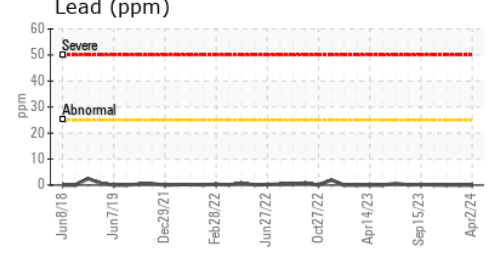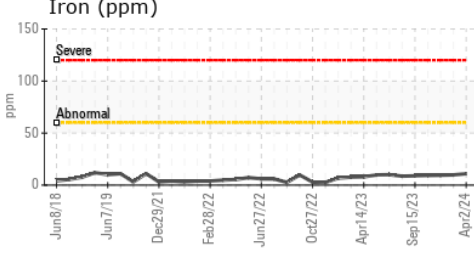

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WCM2249791
Lab Number : 06137614
Unique Number : 10957079
Test Package : MOB 2
Received : 03 Apr 2024
Tested : 04 Apr 2024
Diagnosed : 08 Apr 2024 - Jonathan Hester

METHANE POWER DURHAM - MAS ENERGY
 2115 EAST CLUB BLVD
 DURHAM, NC
 US 27704
 Contact: KAYLA LEHMANN
 KLEHMANN@MAS-ENERGY.COM
 T: (504)228-6289
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)