




OIL ANALYSIS REPORT

Sample Rating Trend

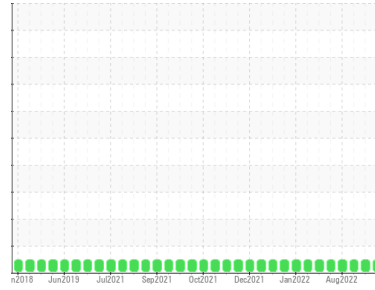

NORMAL



Machine Id
Durham unit 1 (S/N 6181411)
 Component
Biogas Engine
 Fluid
D-A Lubricant Blue Flame HB-8 40W (130 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| | method | limit/base | current | history1 | history2 |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | WCM2249829 | WCM2249790 | WCM2249809 |
| Sample Date | Client Info | | 02 Apr 2024 | 25 Jun 2023 | 09 May 2023 |
| Machine Age | hrs | Client Info | 506 | 11951 | 10883 |
| Oil Age | hrs | Client Info | 506 | 1068 | 24 |
| Oil Changed | Client Info | | N/A | N/A | Changed |
| Sample Status | | | NORMAL | NORMAL | NORMAL |

CONTAMINATION

| | method | limit/base | current | history1 | history2 |
|--------|-----------|------------|----------------|----------|----------|
| Fuel | WC Method | >4.0 | <1.0 | <1.0 | <1.0 |
| Water | WC Method | >.2 | NEG | NEG | NEG |
| Glycol | WC Method | | NEG | NEG | NEG |

WEAR METALS

| | method | limit/base | current | history1 | history2 |
|----------|--------|-----------------|----------|----------|----------|
| Iron | ppm | ASTM D5185m >20 | 3 | 9 | 6 |
| Chromium | ppm | ASTM D5185m >5 | 0 | <1 | <1 |
| Nickel | ppm | ASTM D5185m >2 | 0 | <1 | <1 |
| Titanium | ppm | ASTM D5185m | 0 | 0 | <1 |
| Silver | ppm | ASTM D5185m >5 | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m >15 | 2 | 4 | 5 |
| Lead | ppm | ASTM D5185m >20 | 0 | 0 | <1 |
| Copper | ppm | ASTM D5185m >15 | 5 | <1 | <1 |
| Tin | ppm | ASTM D5185m >5 | 0 | 2 | 2 |
| Vanadium | ppm | ASTM D5185m | 0 | 0 | <1 |
| Cadmium | ppm | ASTM D5185m | 0 | 0 | 0 |

ADDITIVES

| | method | limit/base | current | history1 | history2 |
|------------|--------|-------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m | 55 | 0 | 2 |
| Barium | ppm | ASTM D5185m | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | <1 | 7 | 6 |
| Manganese | ppm | ASTM D5185m | 0 | 0 | <1 |
| Magnesium | ppm | ASTM D5185m | 4 | 45 | 57 |
| Calcium | ppm | ASTM D5185m | 1539 | 2517 | 2327 |
| Phosphorus | ppm | ASTM D5185m | 284 | 362 | 370 |
| Zinc | ppm | ASTM D5185m | 323 | 475 | 461 |
| Sulfur | ppm | ASTM D5185m | 2086 | 4065 | 4212 |

CONTAMINANTS

| | method | limit/base | current | history1 | history2 |
|-----------|--------|------------------|-----------|----------|----------|
| Silicon | ppm | ASTM D5185m >200 | 31 | 158 | 100 |
| Sodium | ppm | ASTM D5185m >20 | 2 | 0 | 2 |
| Potassium | ppm | ASTM D5185m >20 | 0 | 3 | 4 |

INFRA-RED

| | method | limit/base | current | history1 | history2 |
|-----------|----------|-----------------|-------------|----------|----------|
| Soot % | % | *ASTM D7844 >2 | 0 | 0.1 | 0 |
| Nitration | Abs/cm | *ASTM D7624 >20 | 6.7 | 7.3 | 6.1 |
| Sulfation | Abs/.1mm | *ASTM D7415 >30 | 16.2 | 23.8 | 21.5 |


FLUID DEGRADATION

| | method | limit/base | current | history1 | history2 |
|------------------|----------|-----------------|-------------|----------|----------|
| Oxidation | Abs/.1mm | *ASTM D7414 >25 | 11.4 | 14.2 | 11.8 |
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 1.34 | 0.21 | 1.07 |
| Base Number (BN) | mg KOH/g | ASTM D2896 8 | 4.00 | 5.09 | 5.43 |




OIL ANALYSIS REPORT


FT-IR (Direct Trend)

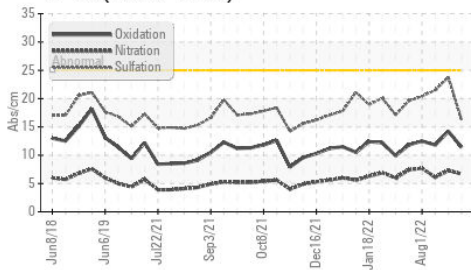


Acid Number

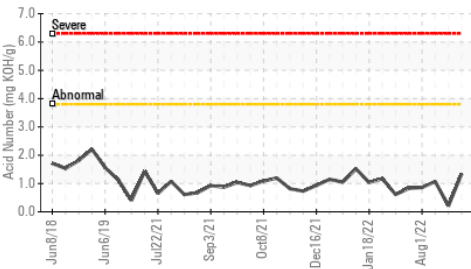

Base Number

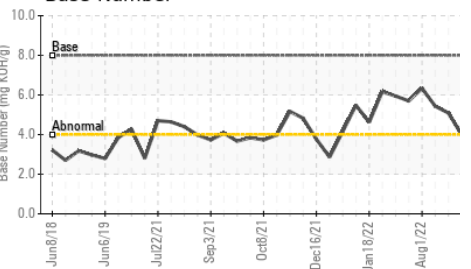









Viscosity @ 100°C

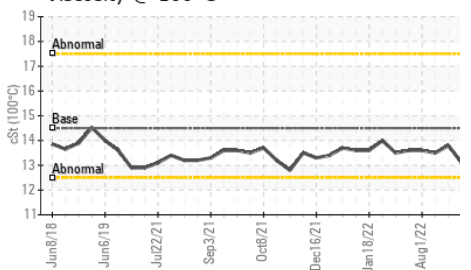

| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | LIGHT | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >.2 | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 | |
|------------------|--------|------------|---------|-------------|----------|------|
| Visc @ 100°C | cSt | ASTM D445 | 14.5 | 13.1 | 13.8 | 13.5 |

GRAPHS

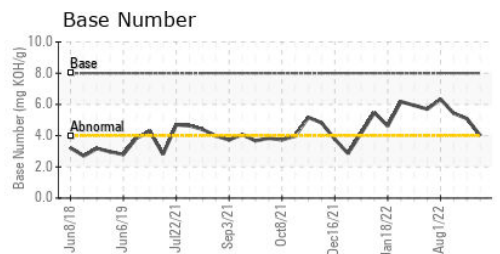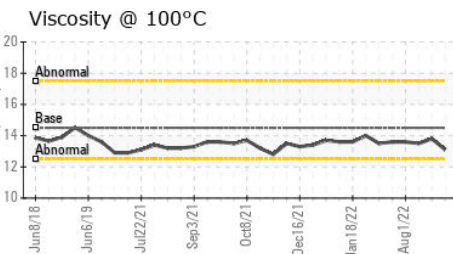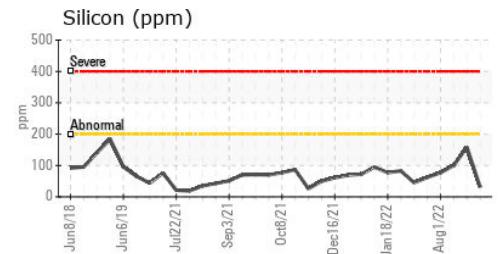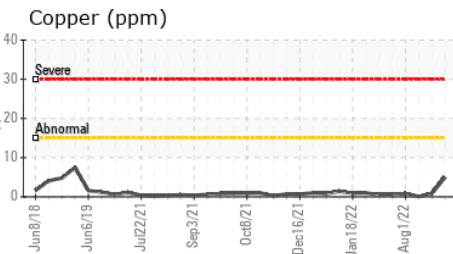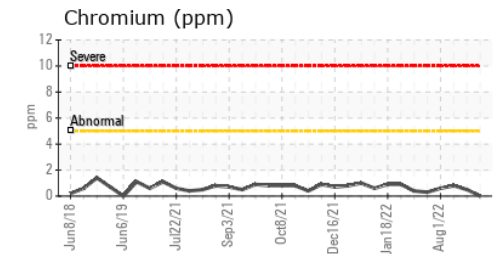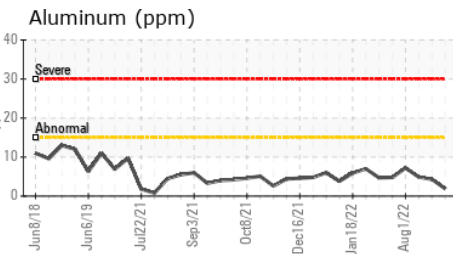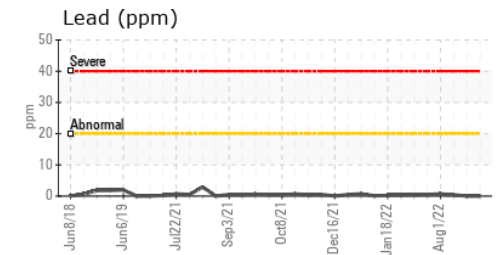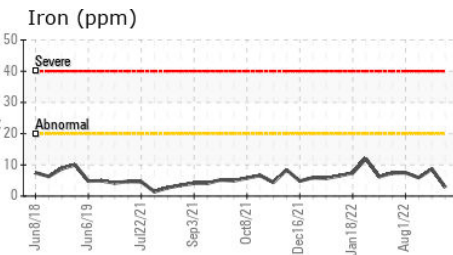

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WCM2249829
Lab Number : **06137615**
Unique Number : 10957080
Test Package : MOB 2

Received : 03 Apr 2024
Tested : 04 Apr 2024
Diagnosed : 05 Apr 2024 - Sean Felton

METHANE POWER DURHAM - MAS ENERGY
 2115 EAST CLUB BLVD
 DURHAM, NC
 US 27704
 Contact: DUSTIN

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (910)730-3493

F:

Submitted By: ?