




FUEL REPORT

Sample Rating Trend

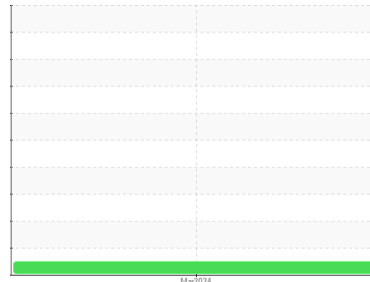

NORMAL



Machine Id
CHARLES SCHWAB 1945 NORTHWESTERN DR
 Component
Diesel Fuel
 Fluid
DIESEL FUEL No. 2 (--- GAL)

DIAGNOSIS

Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The water content is negligible. There is no indication of any contamination in the fuel. The amount and size of particulates present in the system are acceptable.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0888261	---	---
Sample Date	Client Info		23 Mar 2024	---	---
Machine Age	hrs	Client Info	0	---	---
Sample Status			NORMAL	---	---

PHYSICAL PROPERTIES

	method	limit/base	current	history1	history2
Fuel Color	text	*Visual Screen	Red	---	---
ASTM Color	scalar	*ASTM D1500	L4.0	---	---
Visc @ 40°C	cSt	ASTM D445 4.1	2.59	---	---
Pensky-Martens Flash Point	°C	*PMCC Calculated	61	---	---

SULFUR CONTENT

	method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	4	---	---
Sulfur (UVF)	ppm	ASTM D5453	52	---	---

DISTILLATION

	method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86	172	---	---
5% Distillation Point	°C	ASTM D86	195	---	---
10% Distill Point	°C	ASTM D86	205	---	---
15% Distillation Point	°C	ASTM D86	213	---	---
20% Distill Point	°C	ASTM D86	221	---	---
30% Distill Point	°C	ASTM D86	236	---	---
40% Distill Point	°C	ASTM D86	249	---	---
50% Distill Point	°C	ASTM D86	263	---	---
60% Distill Point	°C	ASTM D86	278	---	---
70% Distill Point	°C	ASTM D86	292	---	---
80% Distill Point	°C	ASTM D86	309	---	---
85% Distillation Point	°C	ASTM D86	319	---	---
90% Distill Point	°C	ASTM D86	329	---	---
95% Distillation Point	°C	ASTM D86	343	---	---
Final Boiling Point	°C	ASTM D86	355	---	---

IGNITION QUALITY






	method	limit/base	current	history1	history2
API Gravity	ASTM D7777		36	---	---
Cetane Index	ASTM D4737	<40.0	48	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m <1.0	0	---	---
Sodium	ppm	ASTM D5185m <0.1	<1	---	---
Potassium	ppm	ASTM D5185m <0.1	0	---	---
Water	%	ASTM D6304 <0.05	0.004	---	---
ppm Water	ppm	ASTM D6304 <500	45	---	---
% Gasoline	%	*In-House <0.50	0.0	---	---
% Biodiesel	%	*In-House <20.0	0.0	---	---



FUEL REPORT

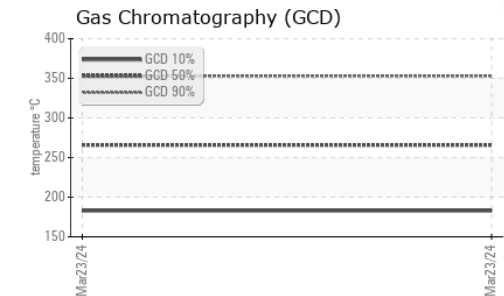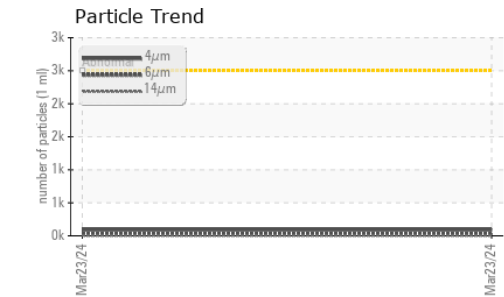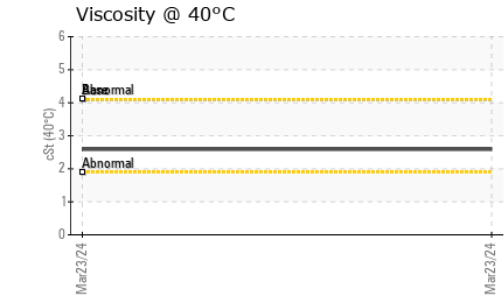
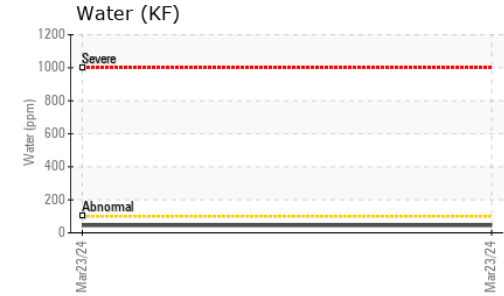
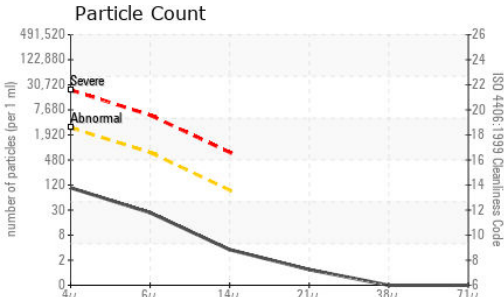


FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	91	---	---
Particles >6µm	ASTM D7647	>640	23	---	---
Particles >14µm	ASTM D7647	>80	3	---	---
Particles >21µm	ASTM D7647	>20	1	---	---
Particles >38µm	ASTM D7647	>4	0	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>18/16/13	14/12/9	---	---

HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m <0.1	0	---	---
Nickel	ppm	ASTM D5185m <0.1	0	---	---
Lead	ppm	ASTM D5185m <0.1	0	---	---
Vanadium	ppm	ASTM D5185m <0.1	0	---	---
Iron	ppm	ASTM D5185m <0.1	0	---	---
Calcium	ppm	ASTM D5185m <0.1	0	---	---
Magnesium	ppm	ASTM D5185m <0.1	0	---	---
Phosphorus	ppm	ASTM D5185m <0.1	0	---	---
Zinc	ppm	ASTM D5185m <0.1	0	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

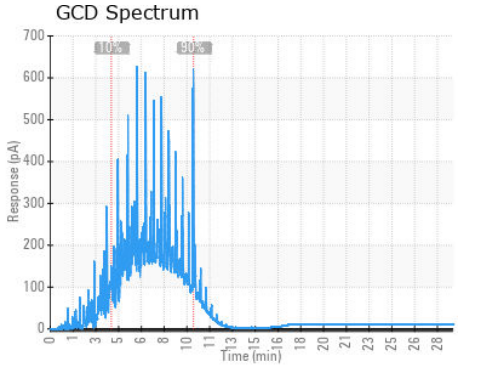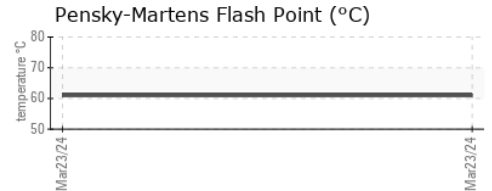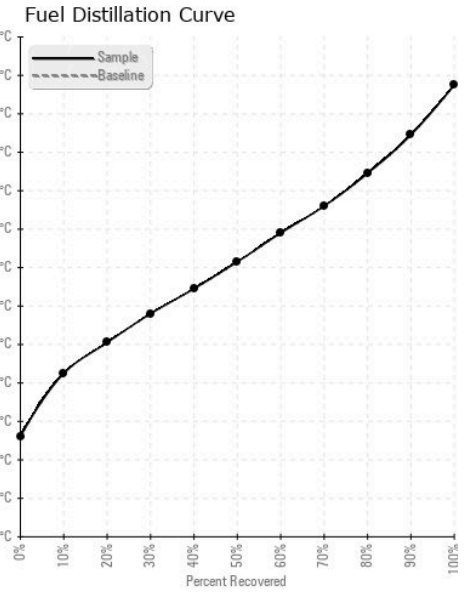

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0888261 **Received** : 03 Apr 2024
Lab Number : 06137855 **Tested** : 12 Apr 2024
Unique Number : 10962663 **Diagnosed** : 12 Apr 2024 - Doug Bogart
Test Package : DF-2 (Additional Tests: Fuel, Screen)

GAINES OIL COMPANY
 2346 S MAIN ST
 GOLDSTON, NC
 US 27252
 Contact: CHIP POOLE
 chip@gainesoil.com
 T: (919)898-2231
 F: (919)898-2981

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)