




OIL ANALYSIS REPORT

Sample Rating Trend

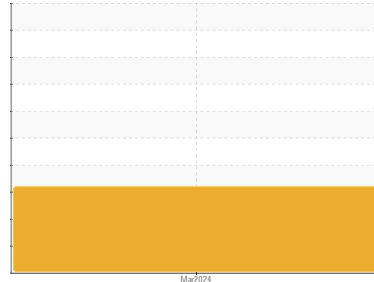

DEGRADATION



Machine Id
KAESER DSD 150 1803723 (S/N 1039)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) FG-460 (--- QTS)

DIAGNOSIS

Recommendation

We advise that you check for a possible overheat condition. Oil and filter change at the time of sampling has been noted. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is above the recommended limit. The oil viscosity is higher than normal. TAN level indicates possible presence of varnish. The oil is no longer serviceable.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA015228	---	---
Sample Date	Client Info	22 Mar 2024	---	---
Machine Age	hrs Client Info	112447	---	---
Oil Age	hrs Client Info	0	---	---
Oil Changed	Client Info	Changed	---	---
Sample Status		ABNORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm	ASTM D5185m >50	4	---	---
Chromium ppm	ASTM D5185m >10	<1	---	---
Nickel ppm	ASTM D5185m >3	<1	---	---
Titanium ppm	ASTM D5185m >3	<1	---	---
Silver ppm	ASTM D5185m >2	0	---	---
Aluminum ppm	ASTM D5185m >10	5	---	---
Lead ppm	ASTM D5185m >10	<1	---	---
Copper ppm	ASTM D5185m >50	6	---	---
Tin ppm	ASTM D5185m >10	<1	---	---
Vanadium ppm	ASTM D5185m	<1	---	---
Cadmium ppm	ASTM D5185m	<1	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm	ASTM D5185m	0	---	---
Barium ppm	ASTM D5185m	0	---	---
Molybdenum ppm	ASTM D5185m	<1	---	---
Manganese ppm	ASTM D5185m	<1	---	---
Magnesium ppm	ASTM D5185m	1	---	---
Calcium ppm	ASTM D5185m	3	---	---
Phosphorus ppm	ASTM D5185m 500	230	---	---
Zinc ppm	ASTM D5185m	39	---	---
Sulfur ppm	ASTM D5185m	1042	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm	ASTM D5185m >25	<1	---	---
Sodium ppm	ASTM D5185m	3	---	---
Potassium ppm	ASTM D5185m >20	2	---	---
Water %	ASTM D6304 >0.05	0.014	---	---
ppm Water ppm	ASTM D6304 >500	144	---	---






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	16300	---	---
Particles >6µm	ASTM D7647 >1300	▲ 4707	---	---
Particles >14µm	ASTM D7647 >80	▲ 348	---	---
Particles >21µm	ASTM D7647 >20	▲ 73	---	---
Particles >38µm	ASTM D7647 >4	1	---	---
Particles >71µm	ASTM D7647 >3	0	---	---
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 21/19/16	---	---

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D8045 1.5	▲ 4.204	---	---

OIL ANALYSIS REPORT

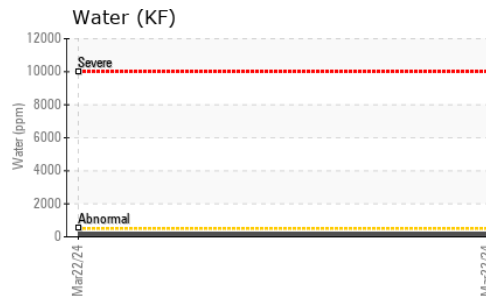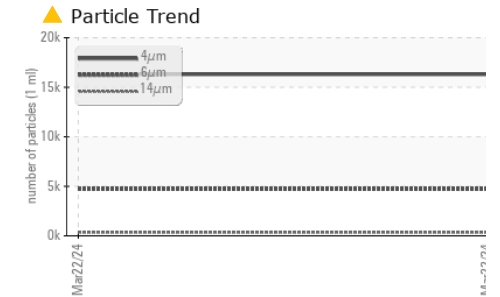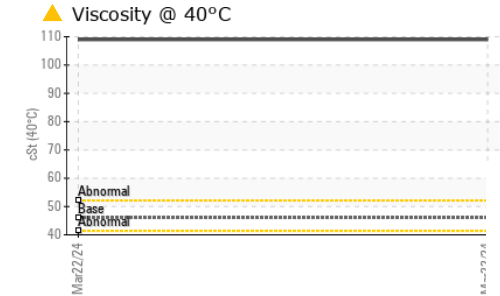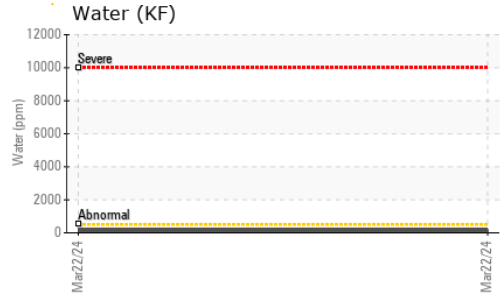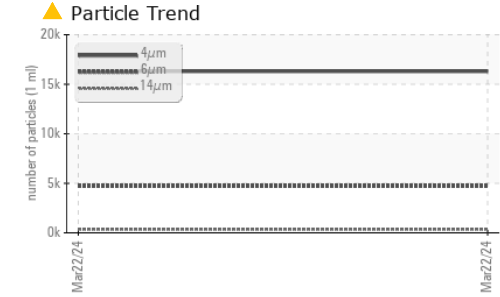

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---






FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	▲ 109	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

	no image	no image
Bottom		no image

GRAPHS

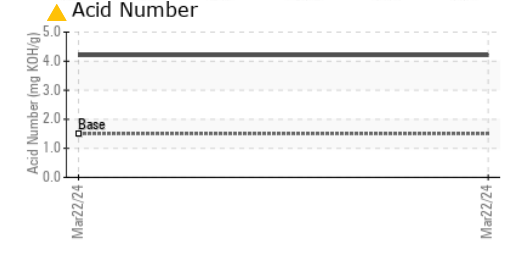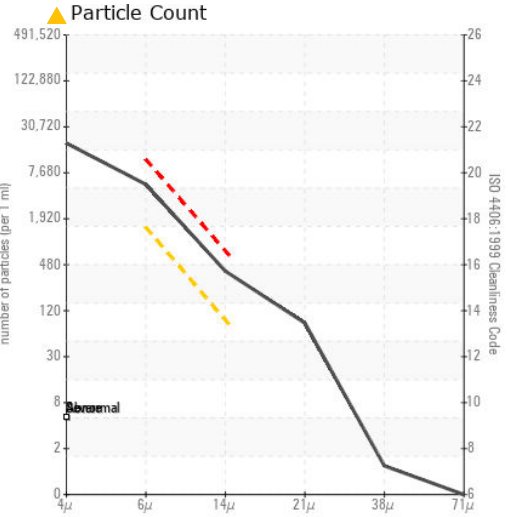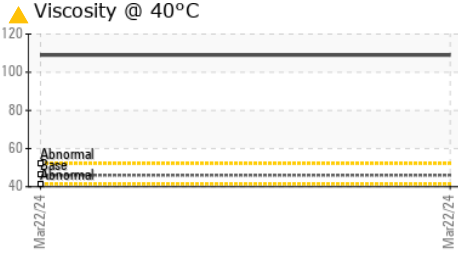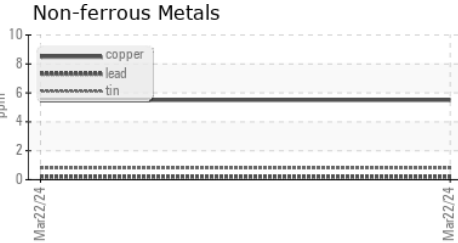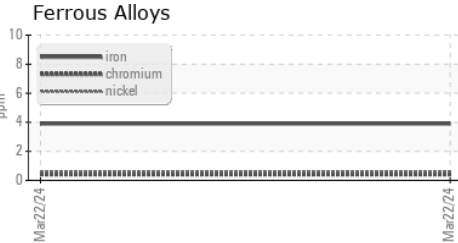

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA015228 **Received** : 03 Apr 2024
Lab Number : 06138064 **Tested** : 04 Apr 2024
Unique Number : 10962872 **Diagnosed** : 05 Apr 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

DART CONTAINER
 2120 LITHONIA IND BLVD
 LITHONIA, GA
 US 30058
 Contact: RAWLE BLAIRE
 rawle.blaire@dart.biz

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)