




# OIL ANALYSIS REPORT

## Sample Rating Trend

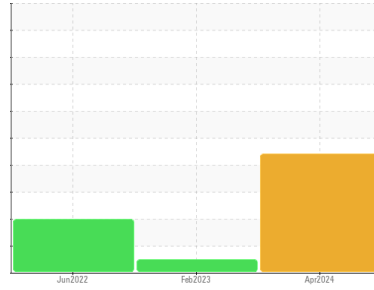

**WATER**



Machine Id  
**KAESER 5006582 (S/N 1611)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

### DIAGNOSIS

#### ▲ Recommendation

Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition.

#### Wear

All component wear rates are normal.

#### ▲ Contamination

There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA016316</b>	KCP55456	KCP44506
Sample Date	Client Info		<b>01 Apr 2024</b>	14 Feb 2023	13 Jun 2022
Machine Age	hrs	Client Info	<b>73179</b>	65057	59532
Oil Age	hrs	Client Info	<b>0</b>	3000	5000
Oil Changed	Client Info		<b>Changed</b>	Changed	Changed
Sample Status			<b>ABNORMAL</b>	NORMAL	ABNORMAL

### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	0	0
Chromium	ppm	ASTM D5185m >10	<1	0	0
Nickel	ppm	ASTM D5185m >3	<1	0	0
Titanium	ppm	ASTM D5185m >3	<1	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	2	<1	<1
Lead	ppm	ASTM D5185m >10	<1	0	0
Copper	ppm	ASTM D5185m >50	4	4	4
Tin	ppm	ASTM D5185m >10	<1	0	0
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 90	0	2	0
Molybdenum	ppm	ASTM D5185m 0	<1	0	0
Manganese	ppm	ASTM D5185m	<1	0	0
Magnesium	ppm	ASTM D5185m 100	2	2	10
Calcium	ppm	ASTM D5185m 0	3	0	0
Phosphorus	ppm	ASTM D5185m 0	5	9	3
Zinc	ppm	ASTM D5185m 0	2	11	13
Sulfur	ppm	ASTM D5185m 23500	<b>21020</b>	18609	17585

### CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	2	<1	<1
Sodium	ppm	ASTM D5185m	1	0	2
Potassium	ppm	ASTM D5185m >20	1	<1	0
Water	%	ASTM D6304 >0.05	▲ <b>0.151</b>	0.010	0.008
ppm Water	ppm	ASTM D6304 >500	▲ <b>1510</b>	103.6	81.8






### FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>16891</b>	5497	9187
Particles >6µm	ASTM D7647	>1300	▲ <b>5737</b>	1292	▲ 3267
Particles >14µm	ASTM D7647	>80	▲ <b>765</b>	57	▲ 478
Particles >21µm	ASTM D7647	>20	▲ <b>231</b>	12	▲ 130
Particles >38µm	ASTM D7647	>4	▲ <b>11</b>	1	▲ 13
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>21/20/17</b>	20/17/13	▲ 20/19/16

### FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>0.417</b>	0.40	0.37


# OIL ANALYSIS REPORT

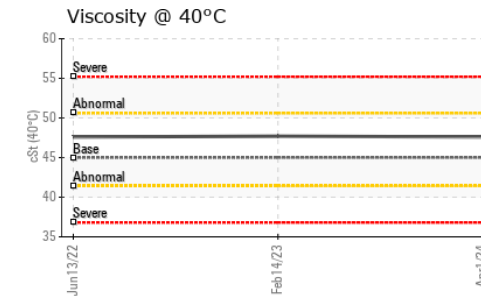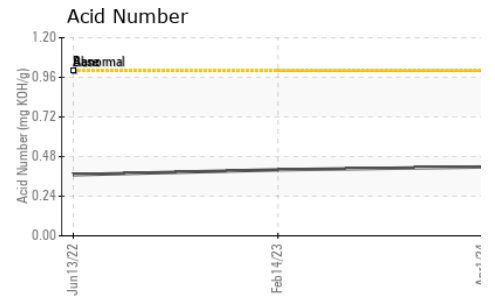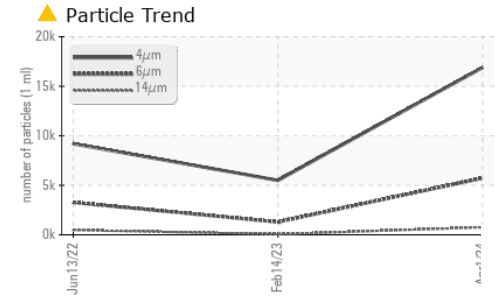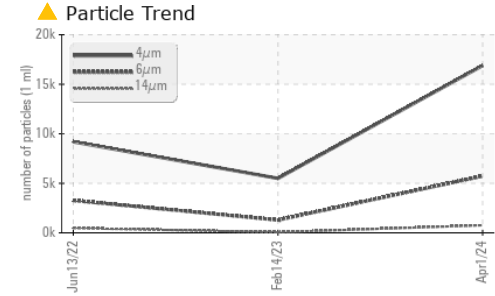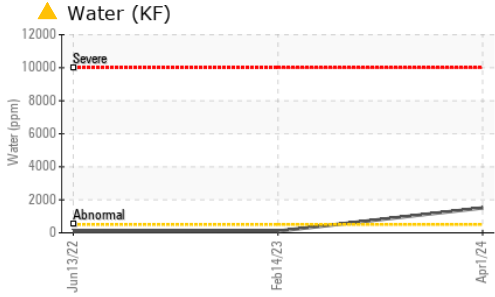






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	HAZY	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	0.2%	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	47.6	47.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

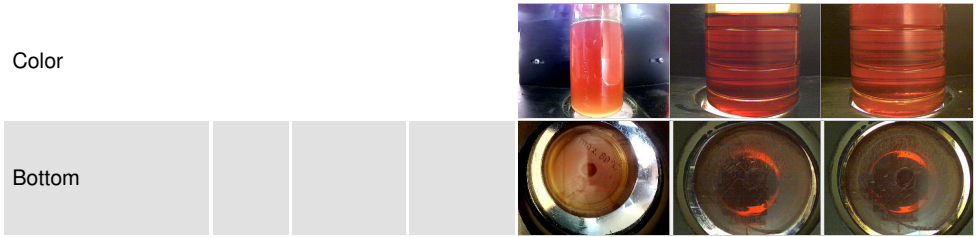

## GRAPHS

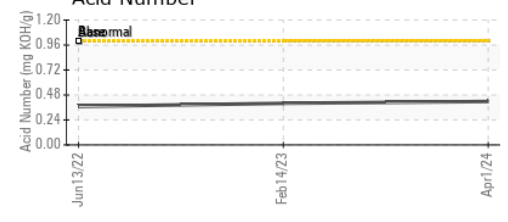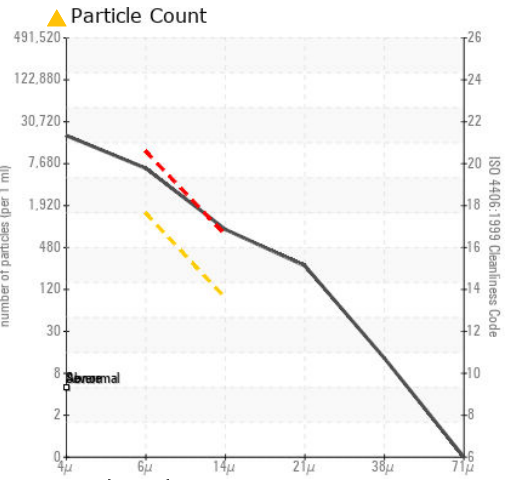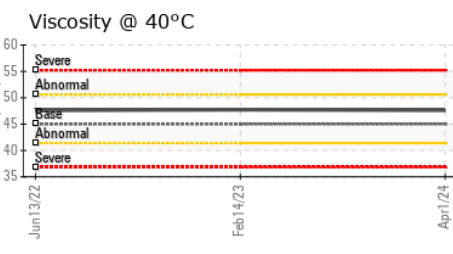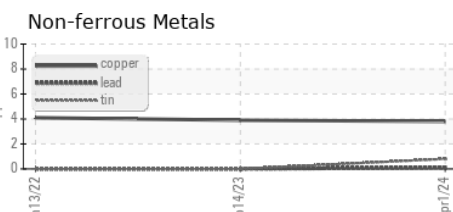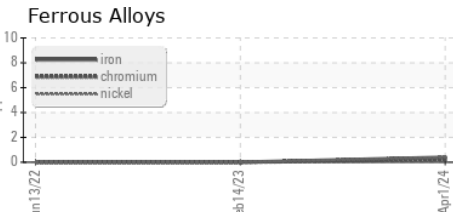

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA016316 **Received** : 03 Apr 2024  
**Lab Number** : 06138065 **Tested** : 05 Apr 2024  
**Unique Number** : 10962873 **Diagnosed** : 05 Apr 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**A & J PRODUCT SOLUTION**  
 1245 BIRCHWOOD DR  
 SUNNYVALE, CA  
 US 94089  
 Contact: MATHEW  
 mathew@jproductsolutions.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)