


OIL ANALYSIS REPORT

Sample Rating Trend

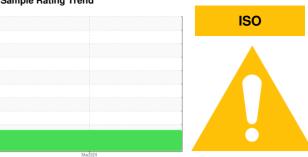

Machine Id

KAESER 8760198

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Mar2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
	IATION		IIIIIIIIIIIIII		HISTORY	HISTOLYZ
Sample Number		Client Info		KCPA016314		
Sample Date		Client Info		28 Mar 2024		
Machine Age	hrs	Client Info		1014		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	2		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	3		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	3		
Molybdenum	ppm	ASTM D5185m	0	<1		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	50		
Calcium	ppm	ASTM D5185m	0	4		
Phosphorus	ppm	ASTM D5185m	0	1		
Zinc	ppm	ASTM D5185m	0	14		
Sulfur	ppm	ASTM D5185m	23500	20474		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	8		
Sodium	ppm	ASTM D5185m		11		
Potassium	ppm	ASTM D5185m	>20	5		
Water	%	ASTM D6304	>0.05	0.020		
ppm Water	ppm	ASTM D6304	>500	201		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		6740		
Particles >6µm		ASTM D7647	>1300	2582		
Particles >14µm		ASTM D7647	>80	143		
Particles >21µm		ASTM D7647	>20	<u></u> 31		
Particles >38µm		ASTM D7647	>4	2		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	20/19/14		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.37		



OIL ANALYSIS REPORT

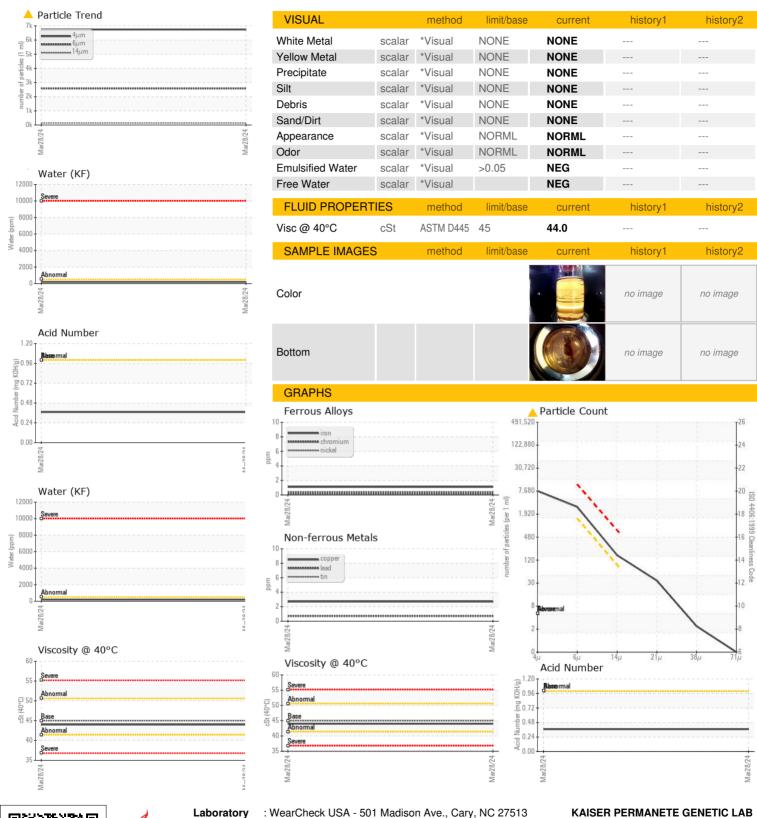





Certificate 12367

Laboratory Sample No.

: KCPA016314 Lab Number : 06138070 Unique Number : 10962878

Received **Tested**

: 04 Apr 2024 Diagnosed

: 03 Apr 2024 : 05 Apr 2024 - Don Baldridge

5901 OPTICAL CT SAN JOSE, CA US 95138 Contact: M. QUIROZ

mquiroz@cmihvac.com

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: KAISANCA [WUSCAR] 06138070 (Generated: 04/05/2024 19:42:40) Rev: 1

Contact/Location: M. QUIROZ - KAISANCA

T:

F: