




OIL ANALYSIS REPORT

Sample Rating Trend

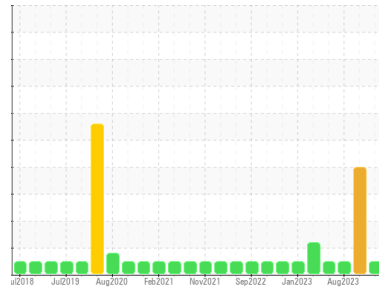

NORMAL



Machine Id
INGERSOLL RAND PARFRY WEST 1 (S/N EE4218U17060)
 Component
Air Compressor
 Fluid
USPI AIR 46 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	USPM36627	USPM31771	USPM29541
Sample Date	Client Info	02 Apr 2024	14 Dec 2023	31 Aug 2023
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	ABNORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<1	0	0
Chromium	ppm	ASTM D5185m >4	<1	0	0
Nickel	ppm	ASTM D5185m >4	<1	0	0
Titanium	ppm	ASTM D5185m	<1	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >10	2	<1	<1
Lead	ppm	ASTM D5185m >20	<1	0	0
Copper	ppm	ASTM D5185m >40	<1	0	0
Tin	ppm	ASTM D5185m >5	<1	<1	0
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 0	0	0	0
Molybdenum	ppm	ASTM D5185m 0	<1	0	0
Manganese	ppm	ASTM D5185m	<1	<1	0
Magnesium	ppm	ASTM D5185m 0	<1	<1	0
Calcium	ppm	ASTM D5185m 0	8	2	8
Phosphorus	ppm	ASTM D5185m 1	72	103	112
Zinc	ppm	ASTM D5185m 0	<1	0	0
Sulfur	ppm	ASTM D5185m 0	219	135	160

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<1	<1	0
Sodium	ppm	ASTM D5185m	1	<1	1
Potassium	ppm	ASTM D5185m >20	1	2	0
Water	%	ASTM D6304 >0.2	0.056	▲ 0.433	0.075
ppm Water	ppm	ASTM D6304 >2000	569	▲ 4330	758.8

FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	911	---	511
Particles >6µm	ASTM D7647 >2500	325	---	161
Particles >14µm	ASTM D7647 >320	33	---	21
Particles >21µm	ASTM D7647 >80	6	---	6
Particles >38µm	ASTM D7647 >20	0	---	0
Particles >71µm	ASTM D7647 >4	0	---	0
Oil Cleanliness	ISO 4406 (c) >20/18/15	17/16/12	---	16/15/12

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.05	0.23	0.27	0.21




OIL ANALYSIS REPORT

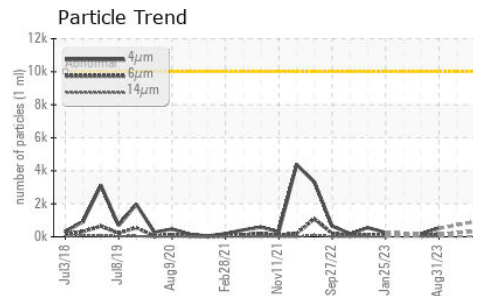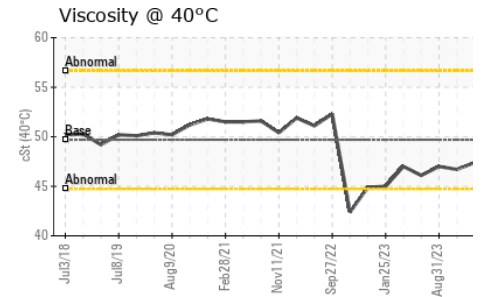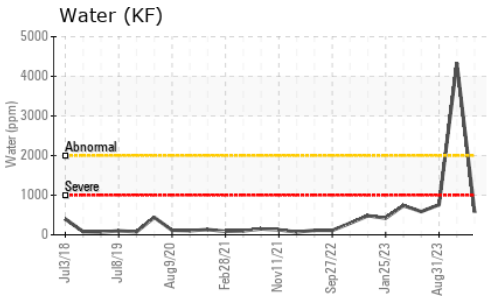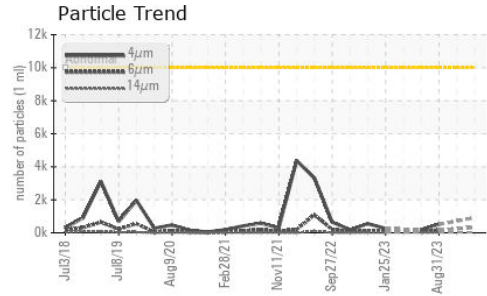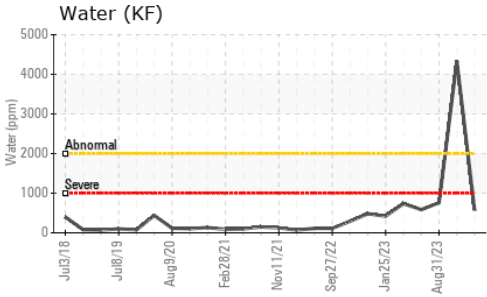






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	▲ MODER	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	0.2%
Free Water	scalar	*Visual		▲ 10.0	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	49.7	47.4	46.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

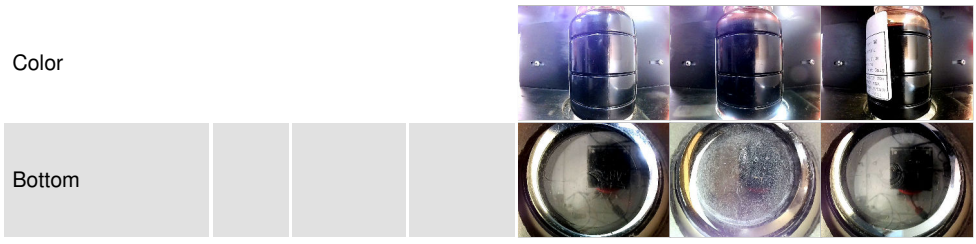

GRAPHS

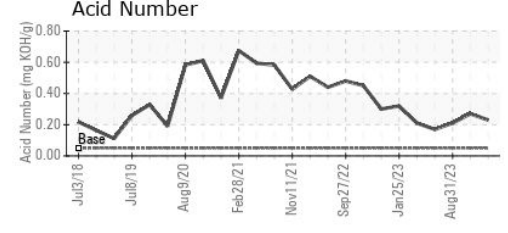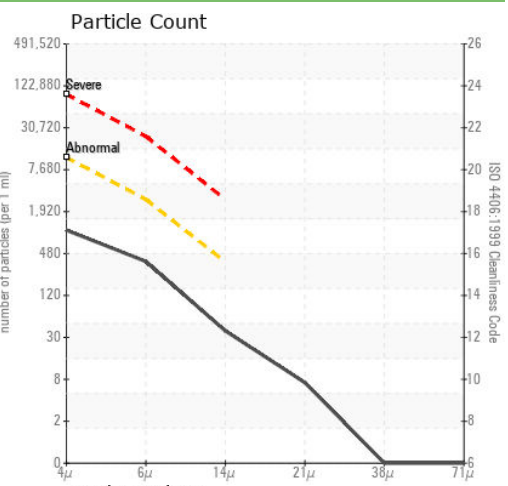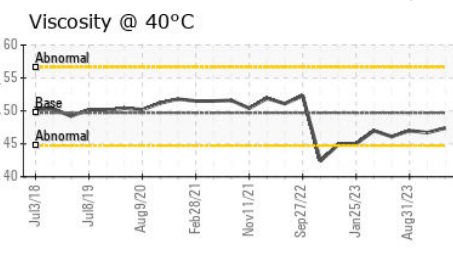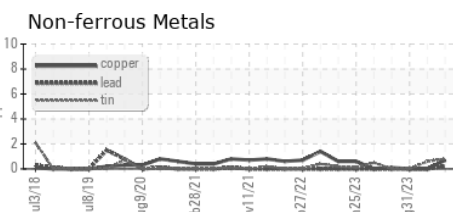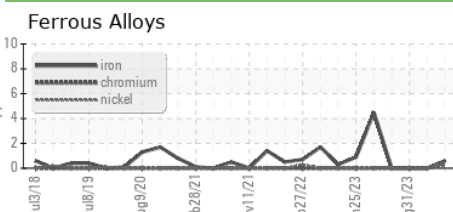

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USPM36627
Lab Number : 06138072
Unique Number : 10962880
Test Package : IND 2
Received : 03 Apr 2024
Tested : 04 Apr 2024
Diagnosed : 05 Apr 2024 - Doug Bogart

TYSON FOODS-GREEN FOREST-PRE
 601 TYSON DRIVE
 GREEN FOREST, AR
 US 72638
 Contact: DANNY SAUL
 dale.west@tyson.com
 T: (870)438-5211
 F: (870)438-7194

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)