




# OIL ANALYSIS REPORT

Sample Rating Trend

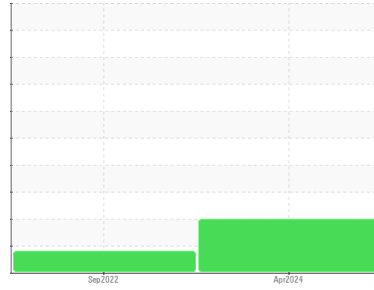

ISO



Machine Id  
**8221093 (S/N 2151)**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC111610</b>	KC94957	---
Sample Date	Client Info			<b>01 Apr 2024</b>	07 Sep 2022	---
Machine Age	hrs	Client Info		<b>12161</b>	2247	---
Oil Age	hrs	Client Info		<b>996</b>	2247	---
Oil Changed	Client Info			<b>Not Chngd</b>	Changed	---
Sample Status				<b>ABNORMAL</b>	ATTENTION	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	<1	---
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	---
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>10	<b>2</b>	<1	---
Lead	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	---
Copper	ppm	ASTM D5185m	>50	<b>10</b>	7	---
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	---
Barium	ppm	ASTM D5185m	90	<b>51</b>	13	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	---
Magnesium	ppm	ASTM D5185m	90	<b>64</b>	53	---
Calcium	ppm	ASTM D5185m	2	<b>6</b>	2	---
Phosphorus	ppm	ASTM D5185m		<b>1</b>	3	---
Zinc	ppm	ASTM D5185m		<b>6</b>	7	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>2</b>	<1	---
Sodium	ppm	ASTM D5185m		<b>11</b>	12	---
Potassium	ppm	ASTM D5185m	>20	<b>6</b>	11	---
Water	%	ASTM D6304	>0.05	<b>0.011</b>	0.013	---
ppm Water	ppm	ASTM D6304	>500	<b>115</b>	135.8	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>94476</b>	9014	---
Particles >6µm		ASTM D7647	>1300	<b>▲ 37968</b>	● 2457	---
Particles >14µm		ASTM D7647	>80	<b>▲ 2224</b>	46	---
Particles >21µm		ASTM D7647	>20	<b>▲ 399</b>	6	---
Particles >38µm		ASTM D7647	>4	<b>▲ 7</b>	0	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>▲ 24/22/18</b>	● 20/18/13	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.32</b>	0.32	---


# OIL ANALYSIS REPORT

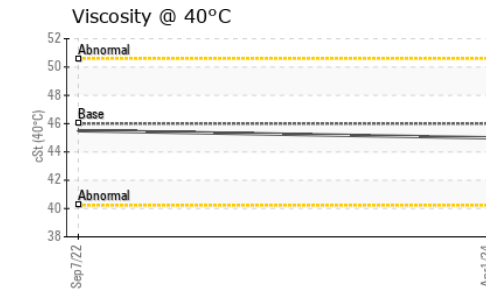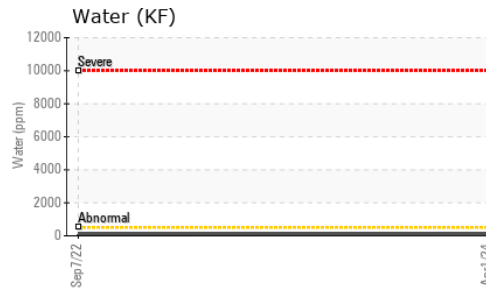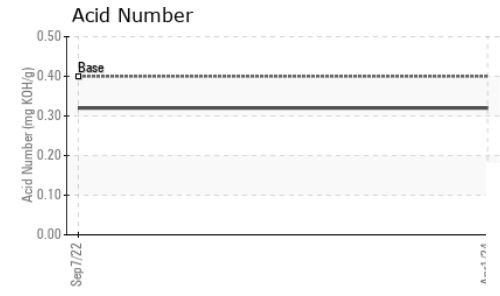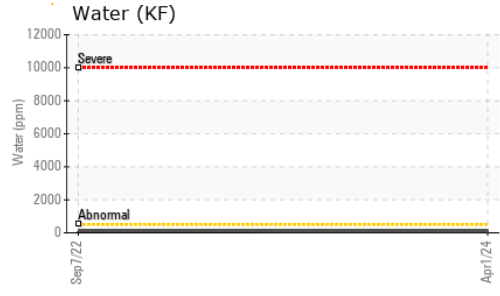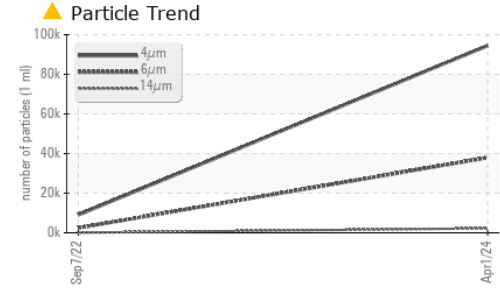






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	45.0	45.5	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

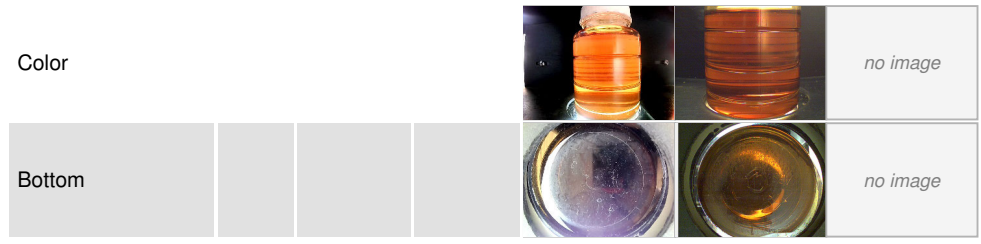

## GRAPHS

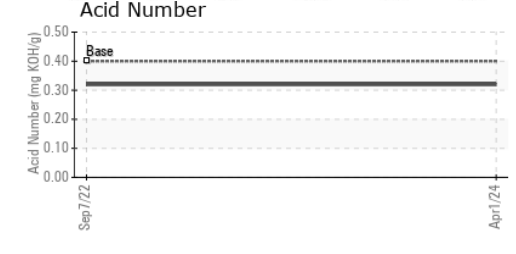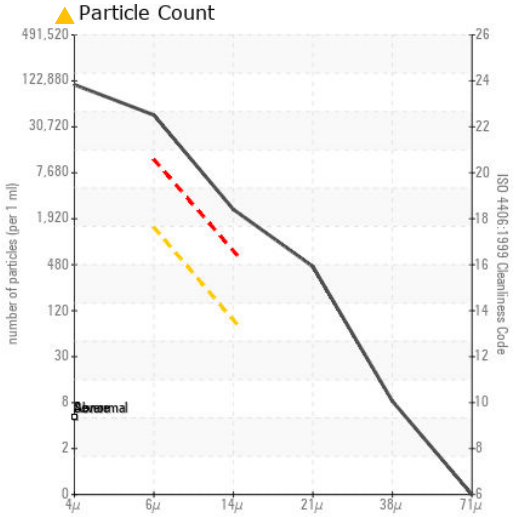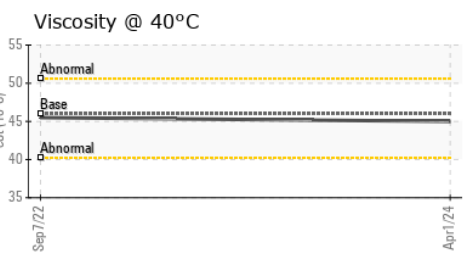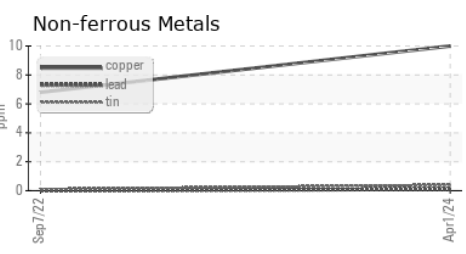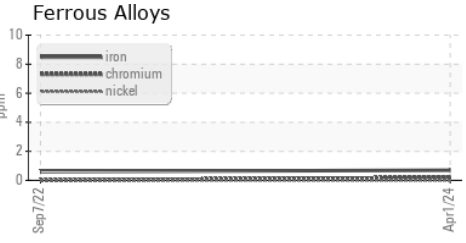

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC111610  
**Lab Number** : 06138539  
**Unique Number** : 10963347  
**Test Package** : IND 2

**Received** : 04 Apr 2024  
**Tested** : 05 Apr 2024  
**Diagnosed** : 06 Apr 2024 - Don Baldrige

**TRAILER COMPONENTS**  
 9049 TYLER BLVD  
 MENTOR, OH  
 US 44060  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)