

## **OIL ANALYSIS REPORT**

Sample Rating Trend



NORMAL



Machine Id

# C3 - FURTHER PROCESS ER (S/N 0245)

**Refrigeration Compressor** 

USPI ALT-68 SC (--- GAL)

#### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

|                  |          | Aug <sup>2</sup> 022 | Jan2023 Apr2023 | Jul2023 Sep2023 Dec2023 | Apr2024     |                 |
|------------------|----------|----------------------|-----------------|-------------------------|-------------|-----------------|
| SAMPLE INFORM    | MATION   | method               | limit/base      | current                 | history1    | history2        |
| Sample Number    |          | Client Info          |                 | USP0007948              | USP0004973  | USP0001697      |
| Sample Date      |          | Client Info          |                 | 03 Apr 2024             | 30 Dec 2023 | 22 Sep 2023     |
| Machine Age      | hrs      | Client Info          |                 | 105435                  | 108618      | 101733          |
| Oil Age          | hrs      | Client Info          |                 | 0                       | 0           | 0               |
| Oil Changed      |          | Client Info          |                 | N/A                     | N/A         | N/A             |
| Sample Status    |          |                      |                 | NORMAL                  | ATTENTION   | ABNORMAL        |
| WEAR METALS      |          | method               | limit/base      | current                 | history1    | history2        |
| Iron             | ppm      | ASTM D5185m          | >8              | <1                      | <1          | <1              |
| Chromium         | ppm      | ASTM D5185m          | >2              | <1                      | <1          | 0               |
| Nickel           | ppm      | ASTM D5185m          |                 | 0                       | 0           | <1              |
| Titanium         | ppm      | ASTM D5185m          |                 | <1                      | 0           | 0               |
| Silver           | ppm      | ASTM D5185m          | >2              | 0                       | 0           | 0               |
| Aluminum         | ppm      | ASTM D5185m          | >3              | 0                       | 0           | 0               |
| Lead             | ppm      | ASTM D5185m          | >2              | 0                       | 0           | 0               |
| Copper           | ppm      | ASTM D5185m          | >8              | <1                      | 0           | <1              |
| Tin              | ppm      | ASTM D5185m          | >4              | <1                      | 0           | 0               |
| Vanadium         | ppm      | ASTM D5185m          |                 | 0                       | 0           | 0               |
| Cadmium          | ppm      | ASTM D5185m          |                 | 0                       | 0           | 0               |
| ADDITIVES        |          | method               | limit/base      | current                 | history1    | history2        |
| Boron            | ppm      | ASTM D5185m          |                 | 0                       | 0           | 0               |
| Barium           | ppm      | ASTM D5185m          |                 | 0                       | 0           | 0               |
| Molybdenum       | ppm      | ASTM D5185m          |                 | 0                       | 0           | 0               |
| Manganese        | ppm      | ASTM D5185m          |                 | 0                       | 0           | 0               |
| Magnesium        | ppm      | ASTM D5185m          |                 | 0                       | 0           | 0               |
| Calcium          | ppm      | ASTM D5185m          |                 | 0                       | 0           | 0               |
| Phosphorus       | ppm      | ASTM D5185m          |                 | 0                       | 0           | 1               |
| Zinc             | ppm      | ASTM D5185m          |                 | 0                       | 0           | 0               |
| Sulfur           | ppm      | ASTM D5185m          | 50              | 0                       | 0           | 0               |
| CONTAMINANTS     |          | method               | limit/base      | current                 | history1    | history2        |
| Silicon          | ppm      | ASTM D5185m          | >15             | <1                      | 1           | 2               |
| Sodium           | ppm      | ASTM D5185m          |                 | 0                       | <1          | 0               |
| Potassium        | ppm      | ASTM D5185m          | >20             | <1                      | <1          | <1              |
| Water            | %        | ASTM D6304           | >0.01           | 0.001                   | 0.003       | 0.001           |
| ppm Water        | ppm      | ASTM D6304           | >100            | 11                      | 28          | 11.9            |
| FLUID CLEANLIN   | ESS      | method               | limit/base      | current                 | history1    | history2        |
| Particles >4µm   |          | ASTM D7647           | >10000          | 7291                    | 13034       | <b>△</b> 31593  |
| Particles >6µm   |          | ASTM D7647           | >2500           | 1481                    | 1257        | <u>▲</u> 8055   |
| Particles >14µm  |          | ASTM D7647           | >320            | 21                      | 20          | 148             |
| Particles >21µm  |          | ASTM D7647           | >80             | 2                       | 6           | 19              |
| Particles >38µm  |          | ASTM D7647           | >20             | 0                       | 1           | 1               |
| Particles >71µm  |          | ASTM D7647           | >4              | 0                       | 0           | 0               |
| Oil Cleanliness  |          | ISO 4406 (c)         | >20/18/15       | 20/18/12                | 21/17/11    | <u>22/20/14</u> |
| FLUID DEGRADA    | TION     | method               | limit/base      | current                 | history1    | history2        |
| Acid Number (AN) | mg KOH/g | ASTM D974            | 0.005           | 0.027                   | 0.015       | 0.014           |



## **OIL ANALYSIS REPORT**

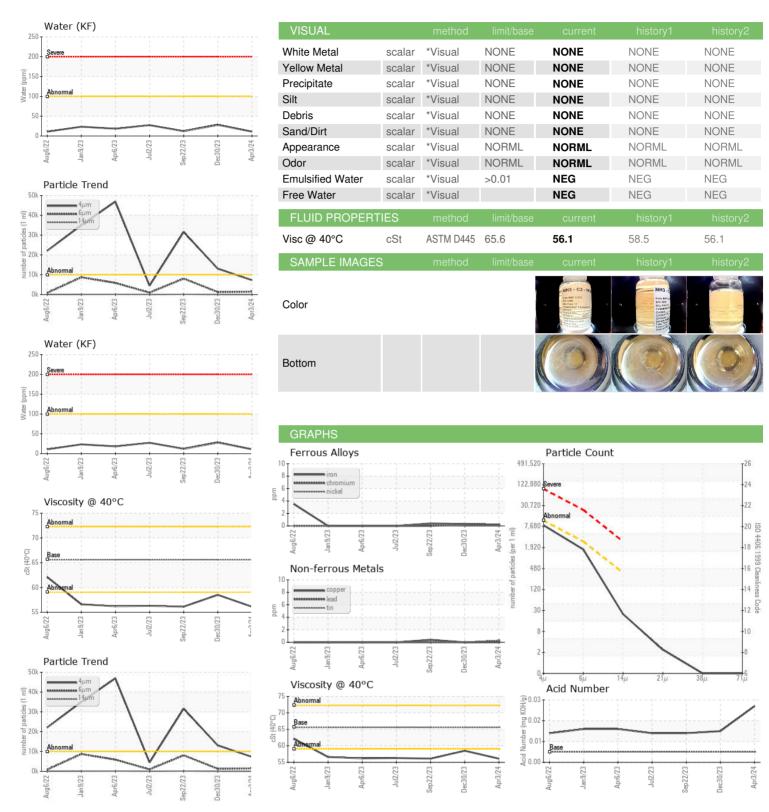





Certificate 12367

Laboratory Sample No. Lab Number : 06138557

: USP0007948 Unique Number : 10963365 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 04 Apr 2024

**Tested** : 05 Apr 2024 Diagnosed : 05 Apr 2024 - Doug Bogart **TYSON KEYSTONE - BAKER HILL** 

57 MELVIN CLARK RD EUFAULA, AL

US 36027 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: