OIL ANALYSIS REPORT

Sample Rating Trend

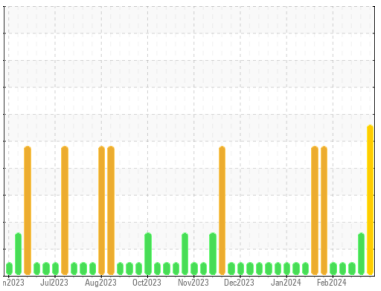

DIRT

Machine Id
HBKM01BE
Component
Biogas Engine
Fluid
SHELL MYSELLA S5 S (--- GAL)

DIAGNOSIS

Recommendation
We recommend that you drain the oil and perform a filter service on this component if not already done. We recommend an early resample to monitor this condition. (Customer Sample Comment: Top Up Amount: 30 GAL)

Wear
The tin level is abnormal.

Contamination
Elemental level of silicon (Si) above normal.

Fluid Condition
The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0775502**	WC0775498	WC0775495
Sample Date		Client Info		**02 Apr 2024**	26 Mar 2024	15 Mar 2024
Machine Age	hrs	Client Info		**109229**	109078	108815
Oil Age	hrs	Client Info		**803**	628	389
Oil Changed		Client Info		**Oil Added**	Oil Added	Oil Added
Sample Status				**SEVERE**	ABNORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel		WC Method	>4.0	**<1.0**	<1.0	<1.0
Water		WC Method		**NEG**	NEG	NEG
Glycol		WC Method		**NEG**	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>14	**5**	4	4
Chromium	ppm	ASTM D5185m	>3	**<1**	<1	<1
Nickel	ppm	ASTM D5185m		**0**	<1	0
Titanium	ppm	ASTM D5185m		**<1**	0	<1
Silver	ppm	ASTM D5185m		**0**	0	0
Aluminum	ppm	ASTM D5185m	>5	**4**	3	3
Lead	ppm	ASTM D5185m	>8	**0**	0	<1
Copper	ppm	ASTM D5185m	>5	**2**	2	2
Tin	ppm	ASTM D5185m	>3	▲ **4**	3	4
Vanadium	ppm	ASTM D5185m		**<1**	0	<1
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**6**	5	6
Barium	ppm	ASTM D5185m		**0**	0	1
Molybdenum	ppm	ASTM D5185m		**4**	4	4
Manganese	ppm	ASTM D5185m		**0**	0	0
Magnesium	ppm	ASTM D5185m		**18**	15	16
Calcium	ppm	ASTM D5185m		**1591**	1481	1570
Phosphorus	ppm	ASTM D5185m	300	**303**	302	328
Zinc	ppm	ASTM D5185m		**430**	397	438
Sulfur	ppm	ASTM D5185m		**3446**	3315	3503

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>180	▲ **230**	▲ 199	158
Sodium	ppm	ASTM D5185m	>20	**5**	6	3
Potassium	ppm	ASTM D5185m	>20	**0**	0	2

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		**0**	0	0
Nitration	Abs/cm	*ASTM D7624		**4.9**	4.8	4.4
Sulfation	Abs/.1mm	*ASTM D7415		**21.7**	21.0	19.7

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414		**14.7**	14.1	12.6
Acid Number (AN)	mg KOH/g	ASTM D8045		**1.25**	1.17	1.483
Base Number (BN)	mg KOH/g	ASTM D2896	5.3	**2.82**	3.59	3.55

OIL ANALYSIS REPORT

Non-ferrous Metals

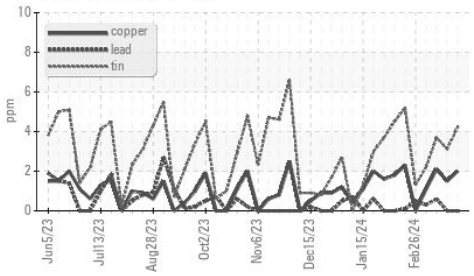

FT-IR (Direct Trend)

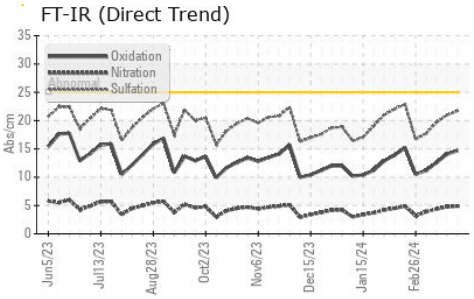

Acid Number

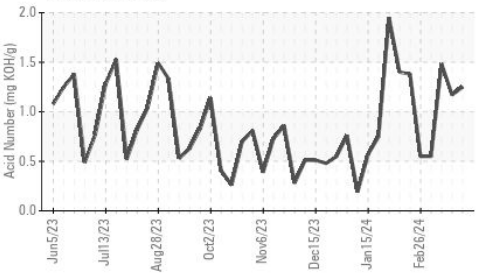

Acid Number

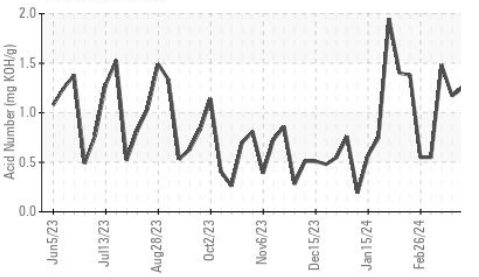

Base Number

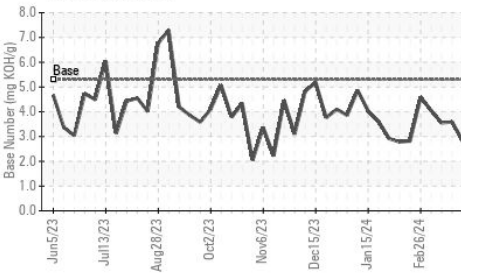

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual		**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.5	**13.6**	13.5	13.4

GRAPHS

Iron (ppm)

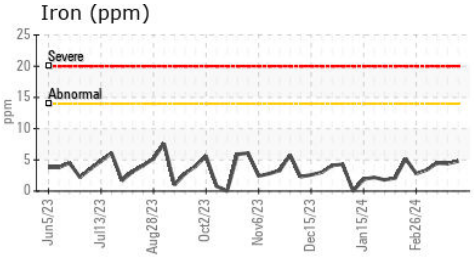

Lead (ppm)

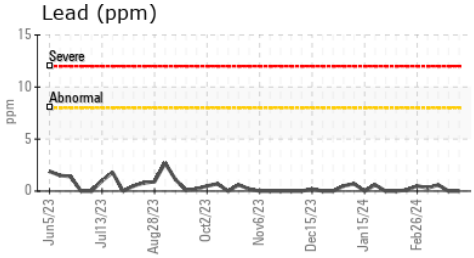

Aluminum (ppm)

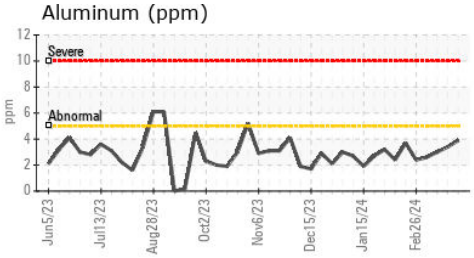

Chromium (ppm)

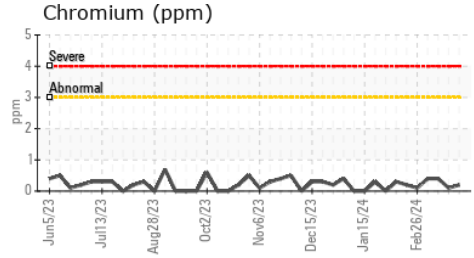

Copper (ppm)

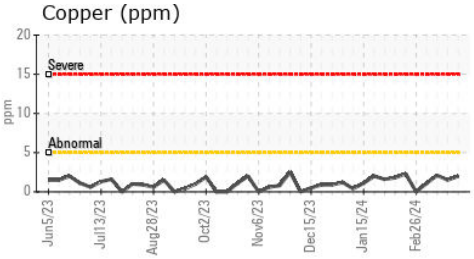

Silicon (ppm)

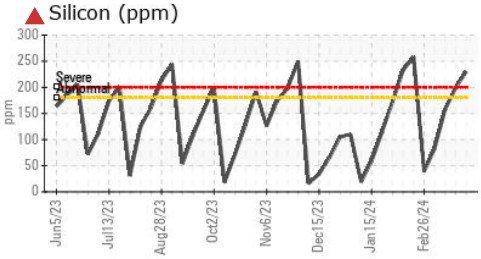

Viscosity @ 100°C

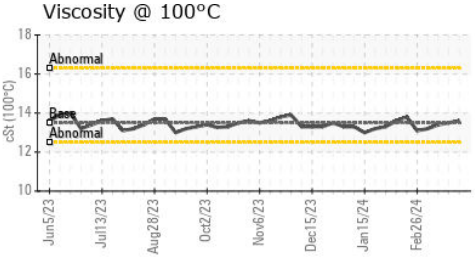

Base Number

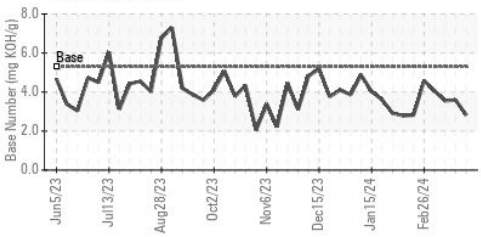

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0775502
Lab Number : 06138717
Unique Number : 10963525
Test Package : MOB 2

Received : 04 Apr 2024
Tested : 05 Apr 2024
Diagnosed : 06 Apr 2024 - Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

EDL NA Recips-Honeybrook
Honey Brook Powerstation, 481 S. Churchtown Road
Narvon, PA
US 17555-9574
Contact: Christian Adames
Christian.Adames@edlenergy.com
T:
F:

Report Id: EDLNAR [WUSCAR] 06138717 (Generated: 04/06/2024 12:51:06) Rev: 1

Submitted By: Samantha Gauger