


FUEL REPORT

Newberry County Memorial [5129] [Newberry County Memorial] MAIN

Diesel Fuel

No.2 DIESEL FUEL (ULTRALOW SULPHUR) (15000 GAL)





DIAGNOSIS

Recommendation

No corrective action is recommended at this time. All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

All metal levels are normal indicating no corrosion in the system.

Contaminants

The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. There is no indication of any contamination in the fuel. The amount and size of particulates present in the system are acceptable.


Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

R) (15000 GAL)				Mar2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC06139075		
Sample Date		Client Info		25 Mar 2024		
Machine Age	hrs	Client Info		0		
Sample Status				NORMAL		
PHYSICAL PROP	ERTIES	method	limit/base	current	history1	history2
Fuel Color	text	*Visual Screen	Yllow	Red		
ASTM Color	scalar	*ASTM D1500		L4.0		
Visc @ 40°C	cSt	ASTM D445	3.0	2.59		
Pensky-Martens Flash Point	°C	*PMCC Calculated	52	61.2		
SULFUR CONTE	VT	method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	<1		
Sulfur (UVF)	ppm	ASTM D5453		9		
DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86	165	172		
5% Distillation Point	°C	ASTM D86		196		
10% Distill Point	°C	ASTM D86	201	206		
15% Distillation Point	°C	ASTM D86		214		
20% Distill Point	°C	ASTM D86	216	222		
30% Distill Point	°C	ASTM D86	230	237		
40% Distill Point	°C	ASTM D86	243	250		
50% Distill Point	°C	ASTM D86	255	264		
60% Distill Point	°C	ASTM D86	267	277		
70% Distill Point	°C	ASTM D86	280	291		
80% Distill Point	°C	ASTM D86	295	306		
85% Distillation Point	°C	ASTM D86	210	317		
90% Distill Point 95% Distillation Point	°C	ASTM D86	310	328 345		
Final Boiling Point	°C	ASTM D86	341	359		
IGNITION QUALIT	ГҮ	method	limit/base	current	history1	history2
API Gravity		ASTM D7777	37.7	36		
Cetane Index		ASTM D4737	<40.0	48		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0		
Sodium	ppm	ASTM D5185m	<0.1	<1		
Potassium	ppm	ASTM D5185m	< 0.1	0		
Water	%	ASTM D6304	< 0.05	0.003		
ppm Water	ppm	ASTM D6304	<500	34		
% Gasoline	%	*In-House	< 0.50	0.0		
% Biodiesel	%	*In-House	<20.0	0.0		



FUEL REPORT

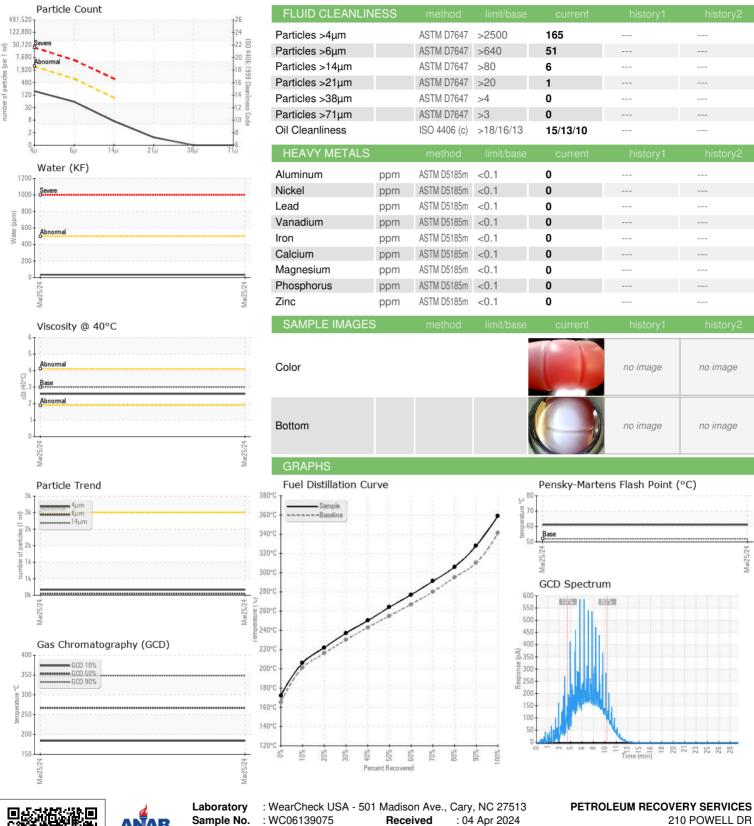





Certificate 12367

Sample No.

: WC06139075 Lab Number : 06139075 Unique Number: 10963883

Diagnosed Test Package : DF-2 (Additional Tests: Fuel, Screen)

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

210 POWELL DR SUMMERVILLE, SC US 29483

Contact: AJAY EL Ajay@prsfuel.com T: (843)225-1777

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Tested

: 15 Apr 2024

: 15 Apr 2024 - Doug Bogart