


## **OIL ANALYSIS REPORT**

Sample Rating Trend

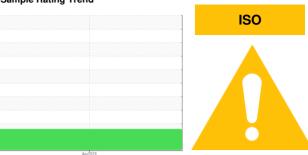

Machine Id

# **KAESER 6333507**

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### **DIAGNOSIS**

#### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Apr2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA016313		
Sample Date		Client Info		01 Apr 2024		
Machine Age	hrs	Client Info		3288		
Oil Age	hrs	Client Info		3200		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
		ASTM D5185m	>50	<1		
Copper	ppm	ASTM D5185m	>10	<1 <1		
Vanadium	ppm	ASTM D5185m	>10	0		
	ppm			0		
Cadmium	ppm	ASTM D5185m				
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	0		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		382		
Zinc	ppm	ASTM D5185m		49		
Sulfur	ppm	ASTM D5185m		812		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		4		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.05	0.003		
ppm Water	ppm	ASTM D6304	>500	35		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		5380		
Particles >6µm		ASTM D7647		<u> </u>		
Particles >14μm		ASTM D7647	>80	<u> </u>		
Particles >21μm		ASTM D7647	>20	<b>48</b>		
Particles >38μm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 20/18/15		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.14		



## **OIL ANALYSIS REPORT**

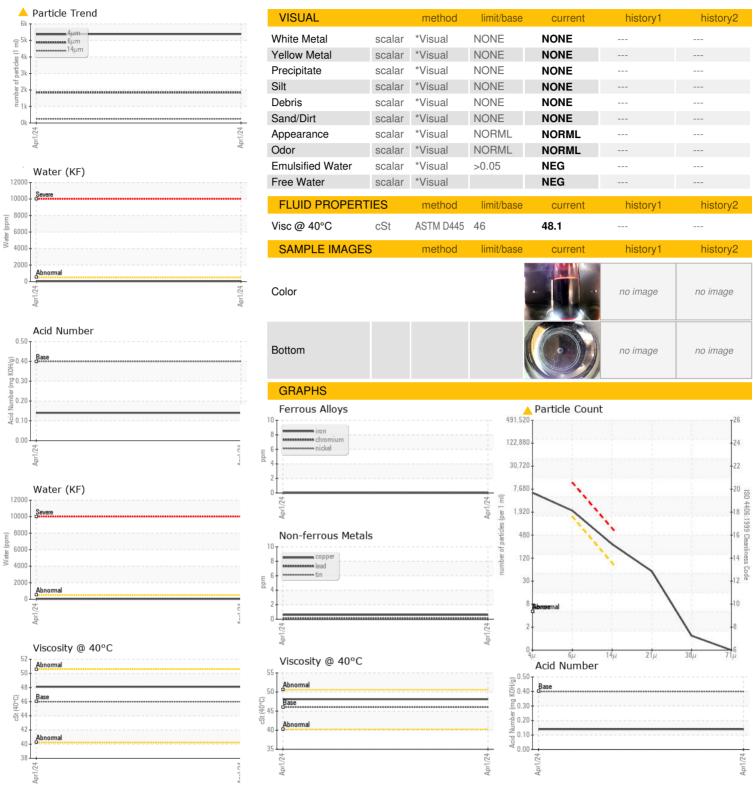



Certificate 12367

Laboratory Sample No.

Lab Number

: KCPA016313 : 06139265 Unique Number : 10964073

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 04 Apr 2024 **Tested** : 05 Apr 2024

Diagnosed : 06 Apr 2024 - Don Baldridge

Test Package : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

US 54115 Contact: Service Manager

**GREEN BAY PACKAGING** 

2275 AMERICAN BLVD

T:

F:

DE PERE, WI