




OIL ANALYSIS REPORT

Sample Rating Trend

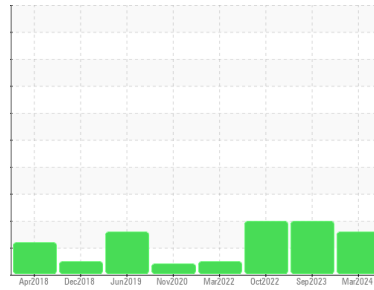

ISO



Machine Id
KAESER CSD 100ST 6131519 (S/N 1108)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA016329	KCPA005883	KCP46932
Sample Date	Client Info		27 Mar 2024	22 Sep 2023	14 Oct 2022
Machine Age	hrs	Client Info	42665	39325	33405
Oil Age	hrs	Client Info	4000	0	3000
Oil Changed	Client Info		Changed	N/A	Changed
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	<1	0
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	<1
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	2	2
Lead	ppm	ASTM D5185m >10	<1	0	2
Copper	ppm	ASTM D5185m >50	2	11	10
Tin	ppm	ASTM D5185m >10	<1	0	<1
Vanadium	ppm	ASTM D5185m	0	0	<1
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 90	0	0	0
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	<1	0	1
Magnesium	ppm	ASTM D5185m 100	0	3	20
Calcium	ppm	ASTM D5185m 0	0	0	0
Phosphorus	ppm	ASTM D5185m 0	0	2	20
Zinc	ppm	ASTM D5185m 0	0	3	16
Sulfur	ppm	ASTM D5185m 23500	22218	23215	24279

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	1	1
Sodium	ppm	ASTM D5185m	<1	0	4
Potassium	ppm	ASTM D5185m >20	0	<1	4
Water	%	ASTM D6304 >0.05	0.005	0.004	0.012
ppm Water	ppm	ASTM D6304 >500	58	49.3	121.2






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		8873	42878	161376
Particles >6µm	ASTM D7647	>1300	▲ 2880	▲ 14269	▲ 44438
Particles >14µm	ASTM D7647	>80	▲ 207	▲ 1138	▲ 2915
Particles >21µm	ASTM D7647	>20	▲ 48	▲ 303	▲ 751
Particles >38µm	ASTM D7647	>4	1	▲ 8	▲ 14
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/19/15	▲ 23/21/17	▲ 25/23/19

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.59	0.47	0.49

OIL ANALYSIS REPORT

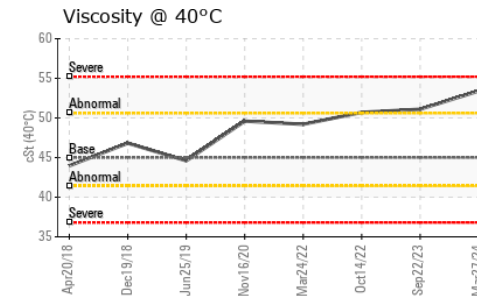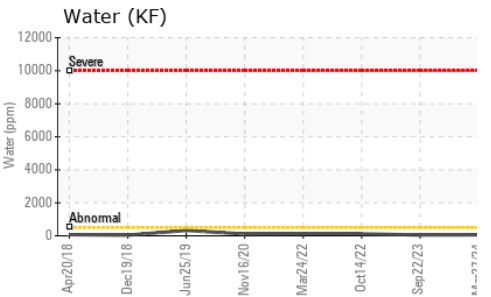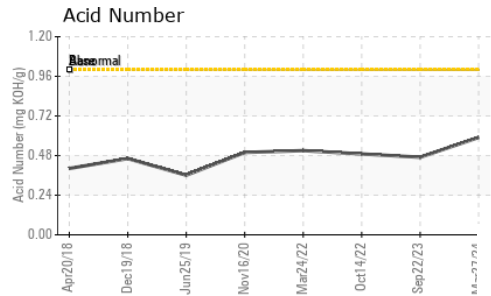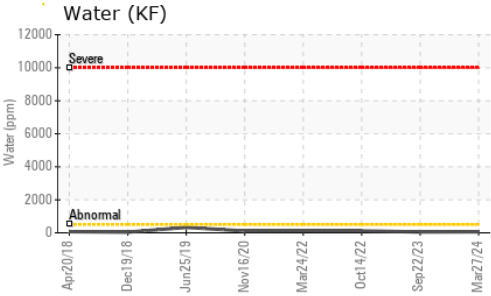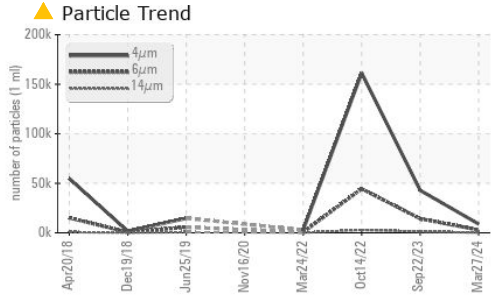




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	53.4	51.1

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color				
Bottom				

GRAPHS

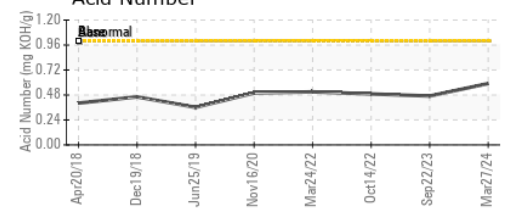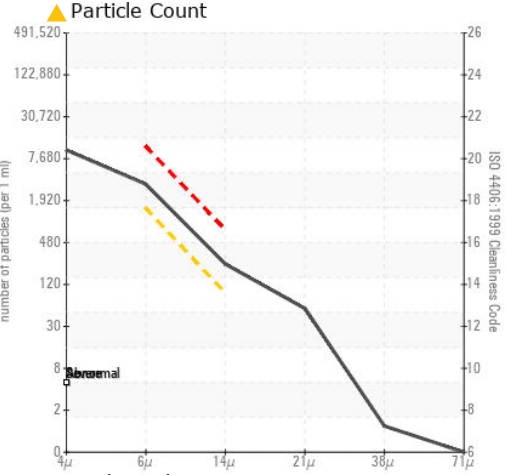

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA016329
Lab Number : 06139269
Unique Number : 10964077
Test Package : IND 2 (Additional Tests: KF, PrtCount)
Received : 04 Apr 2024
Tested : 05 Apr 2024
Diagnosed : 06 Apr 2024 - Don Baldrige

FABRI-TECH INC
 225 N JANACEK RD
 BROOKFIELD, WI
 US 53045
 Contact: DAVE W
 DAVEW@FABRI-TECH.NET
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)