




# OIL ANALYSIS REPORT

## Sample Rating Trend

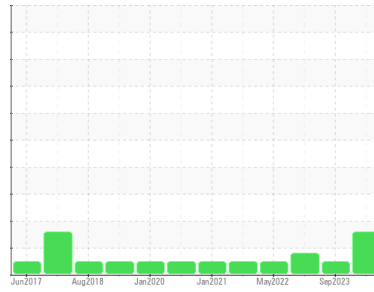

ISO



Machine Id  
**KAESER SK 19 1422130 (S/N 0189929)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a moderate amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA016352</b>	KCPA006616	KCPA002308
Sample Date	Client Info			<b>25 Mar 2024</b>	25 Sep 2023	22 May 2023
Machine Age	hrs	Client Info		<b>90171</b>	86364	83964
Oil Age	hrs	Client Info		<b>1890</b>	0	0
Oil Changed	Client Info			<b>Changed</b>	N/A	N/A
Sample Status				<b>ATTENTION</b>	NORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	<1	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>4</b>	3	9
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>11</b>	15	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m	100	<b>45</b>	54	▲ <1
Calcium	ppm	ASTM D5185m	0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	0	<b>0</b>	5	2
Zinc	ppm	ASTM D5185m	0	<b>31</b>	26	0
Sulfur	ppm	ASTM D5185m	23500	<b>22405</b>	19004	20999

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>19</b>	15	0
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	3	<1
Water	%	ASTM D6304	>0.05	<b>0.011</b>	0.026	0.003
ppm Water	ppm	ASTM D6304	>500	<b>112</b>	265.3	25.7

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>6501</b>	2208	---
Particles >6µm		ASTM D7647	>1300	● <b>1590</b>	497	---
Particles >14µm		ASTM D7647	>80	● <b>111</b>	57	---
Particles >21µm		ASTM D7647	>20	● <b>28</b>	21	---
Particles >38µm		ASTM D7647	>4	<b>1</b>	1	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	● <b>20/18/14</b>	18/16/13	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.40</b>	0.37	0.45


# OIL ANALYSIS REPORT

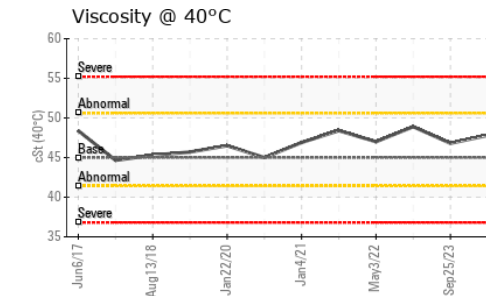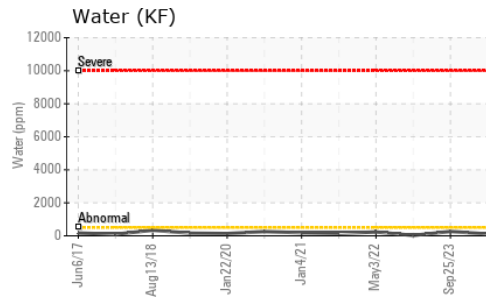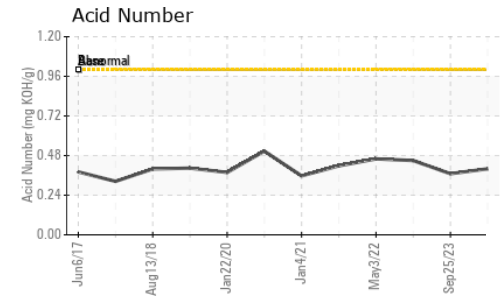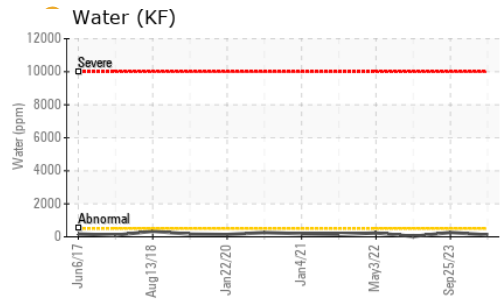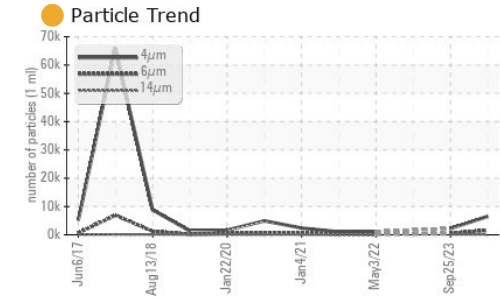




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	47.8	46.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

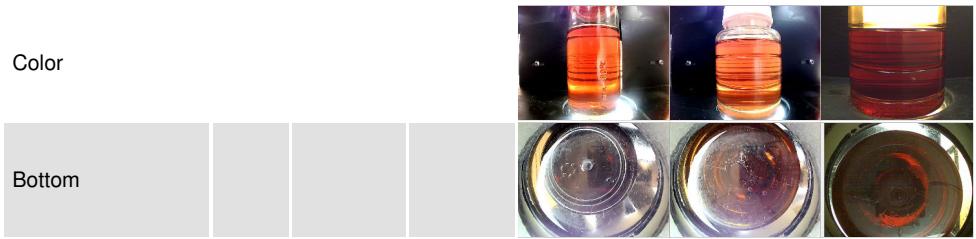

## GRAPHS

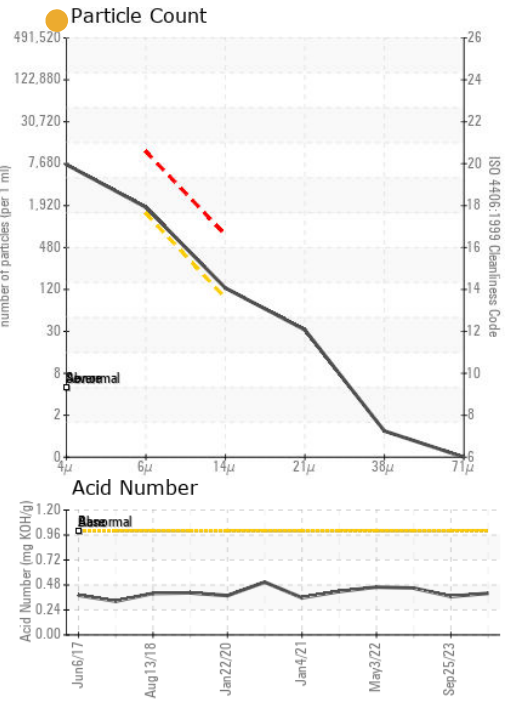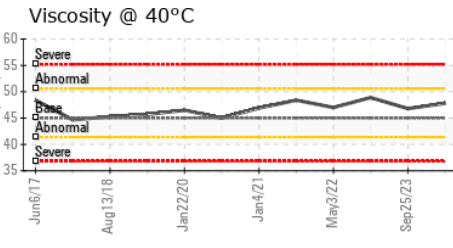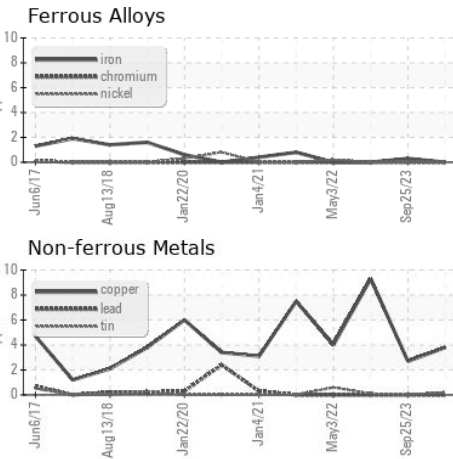

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA016352  
**Lab Number** : 06139275  
**Unique Number** : 10964083  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )  
**Received** : 04 Apr 2024  
**Tested** : 05 Apr 2024  
**Diagnosed** : 06 Apr 2024 - Don Baldrige

**NORTH EASTON MACHINE**  
 218 ELM ST  
 NORTH EASTON, MA  
 US 02356  
 Contact: P. DIAMOND  
 pdiamond@northeastonmachine.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)