


OIL ANALYSIS REPORT

Sample Rating Trend

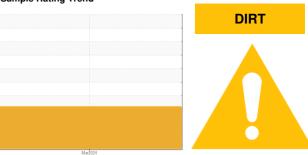

Machine Id

7068395 (S/N 1118)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil. Elemental level of silicon (Si) above normal.

Fluid Condition

The AN level is acceptable for this fluid.

0.4451.5.055						
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA015026		
Sample Date		Client Info		27 Mar 2024		
Machine Age	hrs	Client Info		354		
Oil Age	hrs	Client Info		354		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	3		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m	>10	0		
Cadmium		ASTM D5185m		0		
	ppm					
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	74		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	72		
Calcium	ppm	ASTM D5185m	2	2		
Phosphorus	ppm	ASTM D5185m		2		
Zinc	ppm	ASTM D5185m		19		
Sulfur	ppm	ASTM D5185m		20551		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	604		
Sodium	ppm	ASTM D5185m		21		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304	>0.05	0.020		
ppm Water	ppm	ASTM D6304	>500	210		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		196898		
Particles >6µm		ASTM D7647	>1300	^ 73843		
Particles >14µm		ASTM D7647	>80	△ 635		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38µm		ASTM D7647	>4	2		
Particles >71µm		ASTM D7647		0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>△</u> 25/23/16		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)				0.41		


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.41



OIL ANALYSIS REPORT

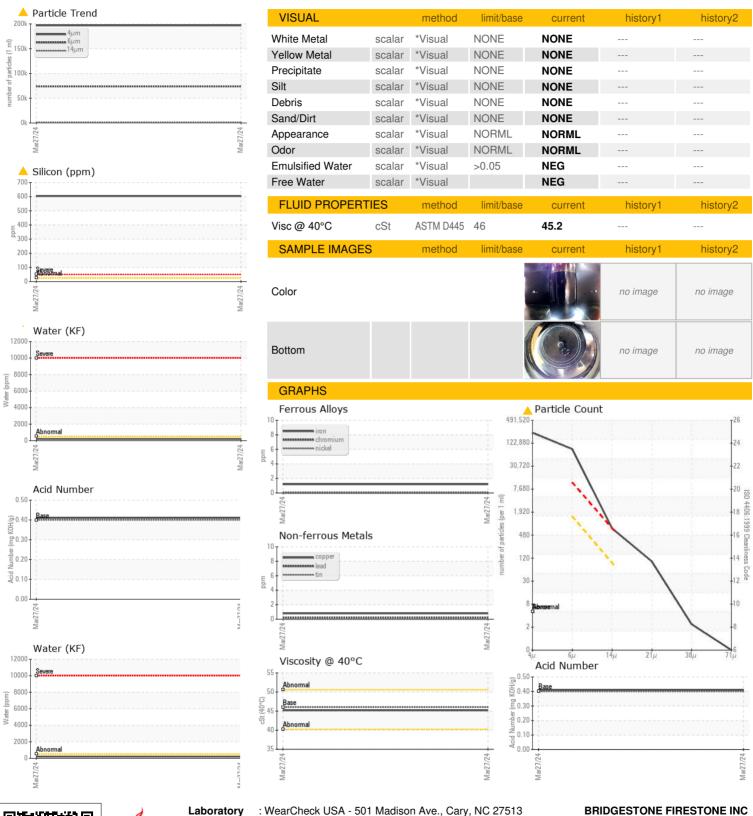





Certificate 12367

Laboratory Sample No.

Lab Number

: KCPA015026 : 06139276 Unique Number : 10964084

Received : 04 Apr 2024 **Tested**

: 05 Apr 2024 Diagnosed : 08 Apr 2024 - Doug Bogart

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

BRIDGESTONE FIRESTONE INC

1 BRIDGESTON PKWY GRANITEVILLE, SC US 29829

Contact: JEFFREY KNIGHTON knightonjeffrey@bfusa.com

T:

F: