




# OIL ANALYSIS REPORT

## Sample Rating Trend

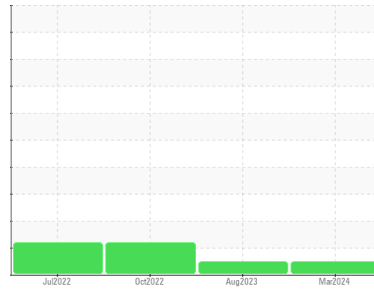

**NORMAL**



Machine Id  
**KAESER 7980818**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA015757</b>	KCPA005702	KCP47291D
Sample Date	Client Info			<b>26 Mar 2024</b>	08 Aug 2023	24 Oct 2022
Machine Age	hrs	Client Info		<b>8760</b>	6785	4442
Oil Age	hrs	Client Info		<b>0</b>	1758	800
Oil Changed	Client Info			<b>Not Changed</b>	Changed	N/A
Sample Status				<b>NORMAL</b>	NORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	1	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>1</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>2</b>	0	<1
Lead	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	0
Copper	ppm	ASTM D5185m	>50	<b>0</b>	2	<1
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>53</b>	52	73
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	100	<b>86</b>	80	91
Calcium	ppm	ASTM D5185m	0	<b>0</b>	0	<1
Phosphorus	ppm	ASTM D5185m	0	<b>0</b>	0	<1
Zinc	ppm	ASTM D5185m	0	<b>0</b>	<1	1
Sulfur	ppm	ASTM D5185m	23500	<b>23252</b>	26085	22668

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	2	<1
Sodium	ppm	ASTM D5185m		<b>19</b>	22	13
Potassium	ppm	ASTM D5185m	>20	<b>4</b>	2	0
Water	%	ASTM D6304	>0.05	<b>0.013</b>	0.036	0.018
ppm Water	ppm	ASTM D6304	>500	<b>136</b>	364.8	182.8

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>1021</b>	1770	8291
Particles >6µm		ASTM D7647	>1300	<b>349</b>	788	2358
Particles >14µm		ASTM D7647	>80	<b>29</b>	47	102
Particles >21µm		ASTM D7647	>20	<b>10</b>	6	17
Particles >38µm		ASTM D7647	>4	<b>0</b>	0	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>17/16/12</b>	18/17/13	20/18/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.33</b>	0.41	0.46


# OIL ANALYSIS REPORT

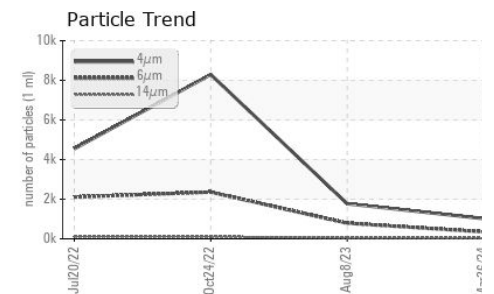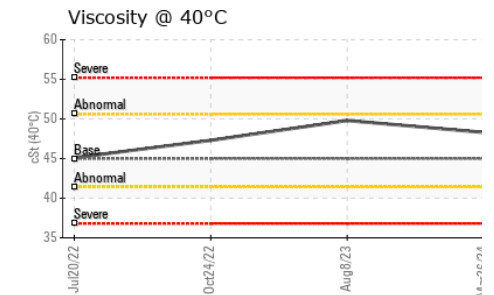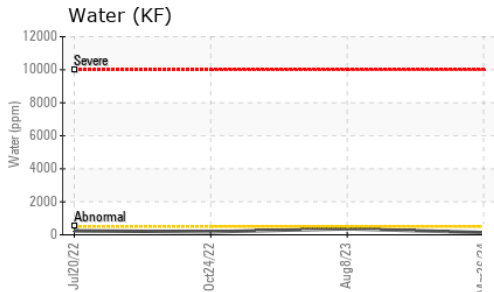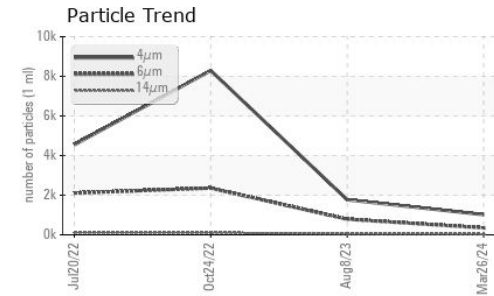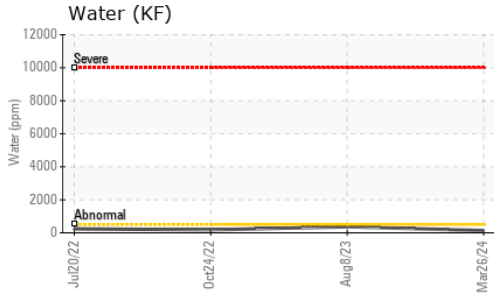






PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	48.3	49.8	47.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

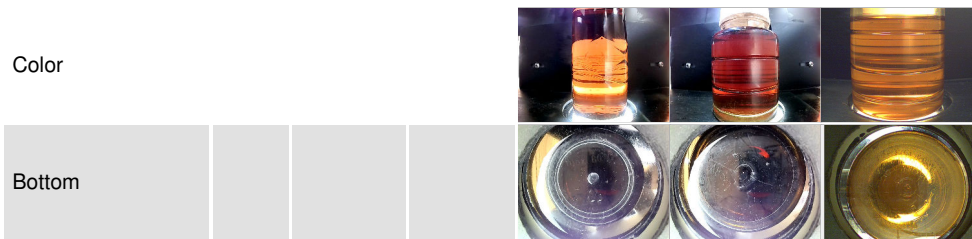

## GRAPHS

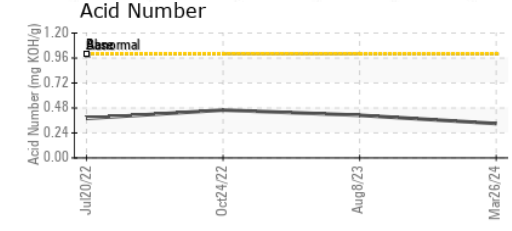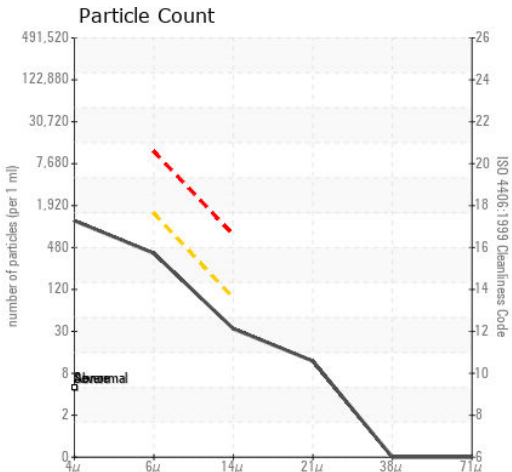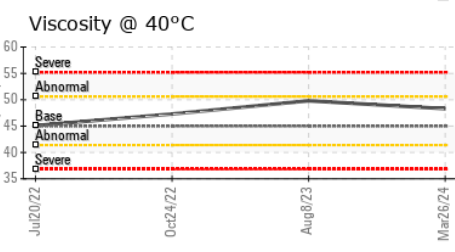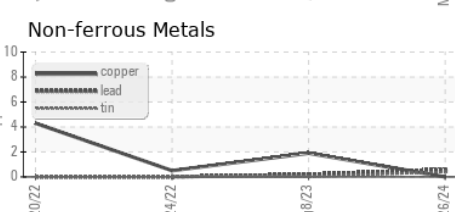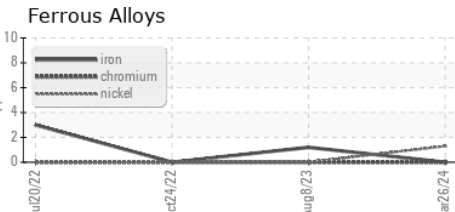

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA015757 **Received** : 04 Apr 2024  
**Lab Number** : 06139279 **Tested** : 05 Apr 2024  
**Unique Number** : 10964087 **Diagnosed** : 06 Apr 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**AMAZON FAR 1**  
 3701 40TH AVE N  
 FARGO, ND  
 US 58102  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)