

# **FUEL REPORT**

Sample Rating Trend



Machine Id

# STEWARD HEALTH CARE SYS - ALF GEN

Tank Diesel Fuel

No.2 DIESEL FUEL (ULTRALOW SULPHUR

#### Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

### Corrosion

All metal levels are normal indicating no corrosion in the system.

## Contaminants

There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The water content is negligible. There is no indication of any contamination in the fuel.


### **Fuel Condition**

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

R) (225 GAL)			Mar2023	Mar2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WCDF4573	WCDF4375	
Sample Date		Client Info		28 Mar 2024	29 Mar 2023	
Machine Age	mls	Client Info		0	0	
Sample Status				NORMAL	NORMAL	
PHYSICAL PROP	ERTIES	method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298	0.839		0.843	
Fuel Color	text	*Visual Screen	Yllow	Red	Red	
ASTM Color	scalar	*ASTM D1500		L4.0	L5.0	
Visc @ 40°C	cSt	ASTM D445	3.0	2.62	2.29	
Pensky-Martens Flash Point	°C	*PMCC Calculated	52	63.9	61	
Cloud Point	°C	ASTM D5771		-13	-12	
SULFUR CONTE	VT	method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	28	2	
Sulfur (UVF)	ppm	ASTM D5453		15	23	
DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86	165	175	168	
5% Distillation Point	°C	ASTM D86		198	193	
10% Distill Point	°C	ASTM D86	201	209	205	
15% Distillation Point	°C	ASTM D86	201	217	214	
20% Distill Point	°C	ASTM D86	216	225	222	
30% Distill Point	°C	ASTM D86	230	240	237	
40% Distill Point	°C	ASTM D86	243	253	251	
50% Distill Point	°C	ASTM D86	255	266	265	
60% Distill Point	°C	ASTM D86	267	279	278	
70% Distill Point	°C	ASTM D86	280	293	292	
80% Distill Point	°C	ASTM D86	295	308	308	
85% Distillation Point	°C	ASTM D86	290	318	318	
90% Distill Point	°C	ASTM D86	310	328	329	
95% Distillation Point		ASTM D86	310	345	346	
	°C	ASTM D86	341			
Final Boiling Point Distillation Residue	%	ASTM D86	3.0	358	353 1.4	
Distillation Loss	%	ASTM D86	3.0		0.9	
IGNITION QUALIT	ΓΥ	method	limit/base	current	history1	history2
API Gravity		ASTM D7777	37.7	36	36.4	
Cetane Index		ASTM D4737	<40.0	48	48.6	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0	0	
Sodium	ppm	ASTM D5185m	<0.1	<1	0	
Potassium	ppm	ASTM D5185m	<0.1	0	<1	
Water	%	ASTM D6304	< 0.05	0.002	0.003	
ppm Water	ppm	ASTM D6304	<500	24	32.8	
% Gasoline	%	*In-House	<0.50	0.0	0.0	
% Biodiesel	%	*In-House	<20.0	0.0	0.0	



# **FUEL REPORT**

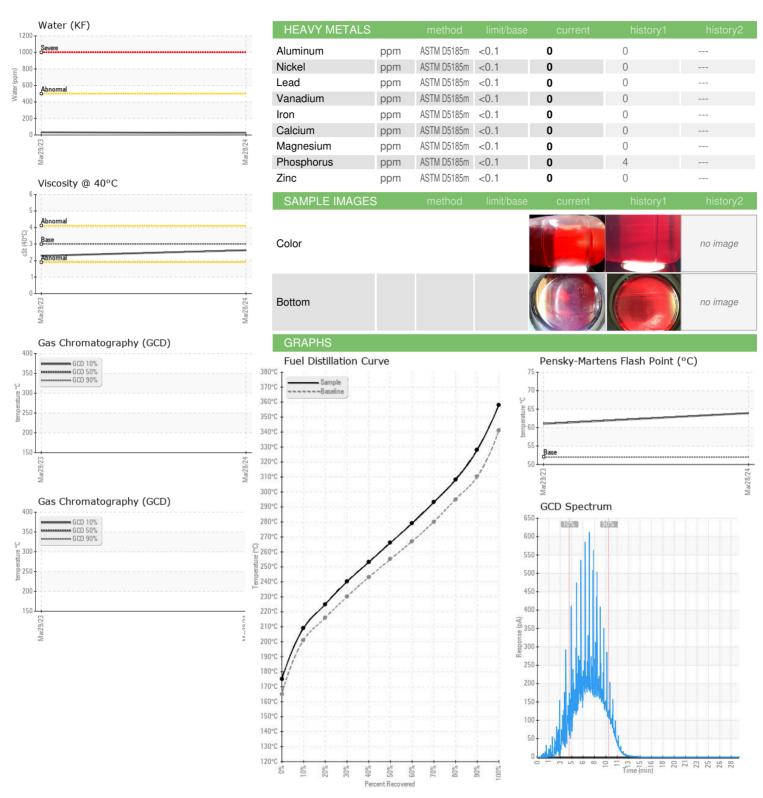



Certificate 12367

Laboratory Sample No.

Lab Number : 06139426

: WCDF4573 Unique Number : 10964234

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Received : 04 Apr 2024 Tested Diagnosed

: 15 Apr 2024

: 15 Apr 2024 - Doug Bogart

Test Package : DF-2 ( Additional Tests: CldPt, Fuel, Screen ) To discuss this sample report, contact Customer Service at 1-800-237-1369.

Contact: WENDALL STRODERD wendall@tankwizards.com T: (321)427-5149

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: (321)574-4131 Contact/Location: 321-285-8878 X1 - WENDALL STRODERD - TANPAL

**TANK WIZARDS** 

PALM BAY, FL

US 32907

1511 MASTERS RD NW