

### FUEL REPORT

Sample Rating Trend

# NORMAL

#### Machine Id

## STEWARD HEALTH CARE - SEBASTIAN RIVER MEDICAL 5K REMOTE

Tank Diesel Fuel

#### Fluid No.2 DIESEL FUEL (ULTRALOW SULPHUR) (5000 GAL)

#### DIAGNOSIS

#### Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

#### Corrosion

All metal levels are normal indicating no corrosion in the system.

#### Contaminants

There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The water content is negligible. There is no indication of any contamination in the fuel.

#### **Fuel Condition**

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.







SAMPLE INFORM	1ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WCDF4576		
Sample Date		Client Info		28 Mar 2024		
Machine Age	mls	Client Info		0		
Sample Status				NORMAL		
PHYSICAL PROP	ERTIES	method	limit/base	current	history1	history2
Fuel Color	text	*Visual Screen	Yllow	Red		
ASTM Color	scalar	*ASTM D1500		L4.0		
Visc @ 40°C	cSt	ASTM D445	3.0	2.56		
Pensky-Martens Flash Point	°C	*PMCC Calculated	52	62		
Cloud Point	°C	ASTM D5771		-12		
SULFUR CONTER	NT	method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	0		
Sulfur (UVF)	ppm	ASTM D5453		11		
DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86	165	173		
5% Distillation Point	°C	ASTM D86		195		
10% Distill Point	°C	ASTM D86	201	204		
15% Distillation Point	°C	ASTM D86		213		
20% Distill Point	°C	ASTM D86	216	221		
30% Distill Point	°C	ASTM D86	230	236		
40% Distill Point	°C	ASTM D86	243	250		
50% Distill Point	°C	ASTM D86	255	264		
60% Distill Point	°C	ASTM D86	267	278		
70% Distill Point	°C	ASTM D86	280	292		
80% Distill Point	°C	ASTM D86	295	308		
85% Distillation Point	°C	ASTM D86		319		
90% Distill Point	°C	ASTM D86	310	330		
95% Distillation Point	°C	ASTM D86		346		
Final Boiling Point	°C	ASTM D86	341	361		
IGNITION QUALIT	ΓY	method	limit/base	current	history1	history2
API Gravity		ASTM D7777	37.7	37		
Cetane Index		ASTM D4737	<40.0	50		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0		
Sodium	ppm	ASTM D5185m	<0.1	<1		
Potassium	ppm	ASTM D5185m	<0.1	0		
Water	%	ASTM D6304	< 0.05	0.003		
ppm Water	ppm	ASTM D6304	<500	31		
% Gasoline	%	*In-House	<0.50	0.0		
% Biodiesel	%	*In-House	<20.0	0.0		



## **FUEL REPORT**



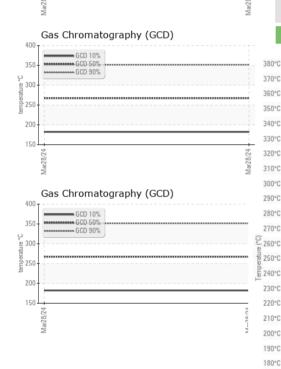

HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	0		
Nickel	ppm	ASTM D5185m	<0.1	0		
Lead	ppm	ASTM D5185m	<0.1	0		
Vanadium	ppm	ASTM D5185m	<0.1	0		
Iron	ppm	ASTM D5185m	<0.1	0		
Calcium	ppm	ASTM D5185m	<0.1	0		
Magnesium	ppm	ASTM D5185m	<0.1	0		
Phosphorus	ppm	ASTM D5185m	<0.1	0		
Zinc	ppm	ASTM D5185m	<0.1	0		
SAMPLE IMAGES		method	limit/base	current	history1	history2

Color

380°0

370°C

360°C

350°C

340% 330°C

300°0

290°0

260°C

250°C

240°C

220°C

180°

170°

160°C 150°C

140°C 130°C 120°C

10%


20%



Fuel Distillation Curve

-Baselin

no image no image no image no image

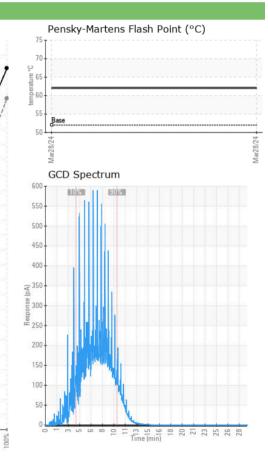

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513 TANK WIZARDS : WCDF4576 Sample No. Received : 04 Apr 2024 1511 MASTERS RD NW Lab Number : 06139430 Tested : 15 Apr 2024 PALM BAY, FL : 15 Apr 2024 - Doug Bogart Unique Number : 10964238 Diagnosed US 32907 Test Package : DF-2 (Additional Tests: CldPt, Fuel, Screen) Contact: WENDALL STRODERD Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369. wendall@tankwizards.com \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: (321)427-5149 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: (321)574-4131

40% 50% 70%

0%

Report Id: TANPAL [WUSCAR] 06139430 (Generated: 04/15/2024 14:08:41) Rev: 1

Contact/Location: 321-285-8878 X1 - WENDALL STRODERD - TANPAL

Page 2 of 2