



FUEL REPORT

Sample Rating Trend



ISO



Area

Procacci Development-Miami [4946]

Machine Id

[Procacci Development-Miami] H-1 MTF

Component

Diesel Fuel

Fluid

No.2 DIESEL FUEL (ULTRALOW SULPHUR) (3500 GAL)

DIAGNOSIS

Recommendation

We advise that you filter this fluid before use. All laboratory tests indicate that this sample meets specifications for No.2 low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

There is a high amount of particulates present in the fuel. The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC06139440	---	---
Sample Date	Client Info	27 Mar 2024	---	---
Machine Age	hrs	Client Info	0	---
Sample Status		ABNORMAL	---	---

PHYSICAL PROPERTIES

method	limit/base	current	history1	history2	
Fuel Color	text	*Visual Screen	Yellow	Red	---
ASTM Color	scalar	*ASTM D1500		L4.0	---
Visc @ 40°C	cSt	ASTM D445	3.0	2.46	---
Pensky-Martens Flash Point	°C	*PMCC Calculated	52	61.5	---

SULFUR CONTENT

method	limit/base	current	history1	history2	
Sulfur	ppm	ASTM D5185m	10	15	---
Sulfur (UVF)	ppm	ASTM D5453		27	---

DISTILLATION

method	limit/base	current	history1	history2	
Initial Boiling Point	°C	ASTM D86	165	173	---
5% Distillation Point	°C	ASTM D86		194	---
10% Distill Point	°C	ASTM D86	201	203	---
15% Distillation Point	°C	ASTM D86		210	---
20% Distill Point	°C	ASTM D86	216	218	---
30% Distill Point	°C	ASTM D86	230	232	---
40% Distill Point	°C	ASTM D86	243	246	---
50% Distill Point	°C	ASTM D86	255	259	---
60% Distill Point	°C	ASTM D86	267	274	---
70% Distill Point	°C	ASTM D86	280	288	---
80% Distill Point	°C	ASTM D86	295	305	---
85% Distillation Point	°C	ASTM D86		316	---
90% Distill Point	°C	ASTM D86	310	328	---
95% Distillation Point	°C	ASTM D86		347	---
Final Boiling Point	°C	ASTM D86	341	361	---

IGNITION QUALITY






method	limit/base	current	history1	history2	
API Gravity		ASTM D7777	37.7	37	---
Cetane Index		ASTM D4737	<40.0	50	---

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	<1.0	0	---
Sodium	ppm	ASTM D5185m	<0.1	<1	---
Potassium	ppm	ASTM D5185m	<0.1	0	---
Water	%	ASTM D6304	<0.05	0.003	---
ppm Water	ppm	ASTM D6304	<500	31	---
% Gasoline	%	*In-House	<0.50	0.0	---
% Biodiesel	%	*In-House	<20.0	0.0	---



FUEL REPORT

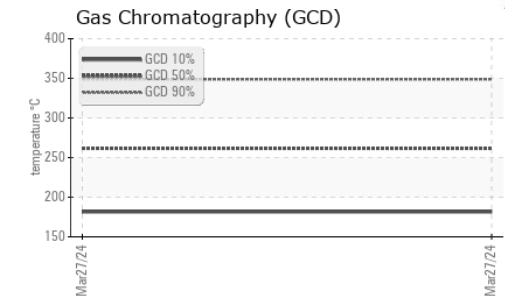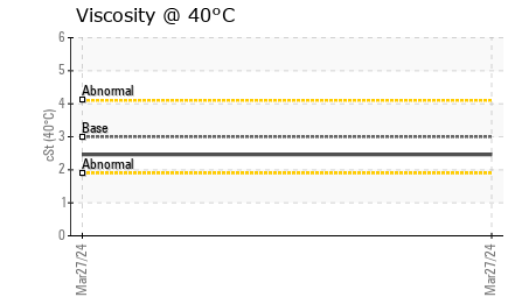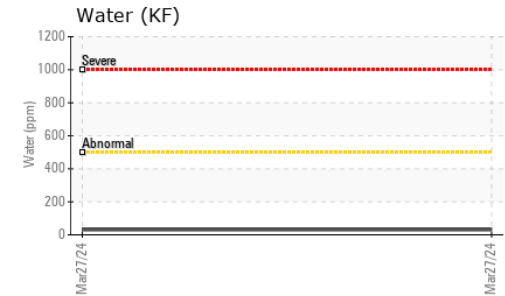
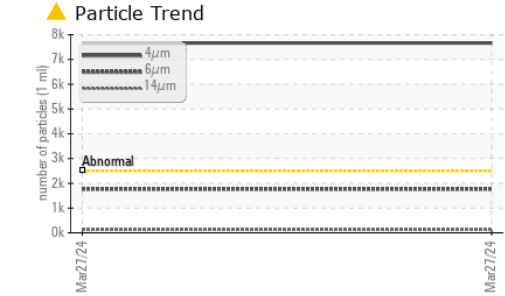
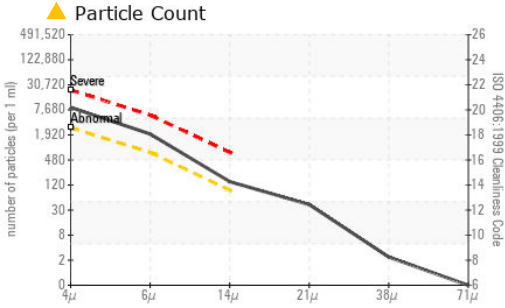


FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	▲ 7662	---	---
Particles >6µm	ASTM D7647	>640	▲ 1767	---	---
Particles >14µm	ASTM D7647	>80	● 128	---	---
Particles >21µm	ASTM D7647	>20	● 36	---	---
Particles >38µm	ASTM D7647	>4	2	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>18/16/13	▲ 20/18/14	---	---

HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m <0.1	0	---	---
Nickel	ppm	ASTM D5185m <0.1	0	---	---
Lead	ppm	ASTM D5185m <0.1	0	---	---
Vanadium	ppm	ASTM D5185m <0.1	0	---	---
Iron	ppm	ASTM D5185m <0.1	0	---	---
Calcium	ppm	ASTM D5185m <0.1	0	---	---
Magnesium	ppm	ASTM D5185m <0.1	0	---	---
Phosphorus	ppm	ASTM D5185m <0.1	0	---	---
Zinc	ppm	ASTM D5185m <0.1	0	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

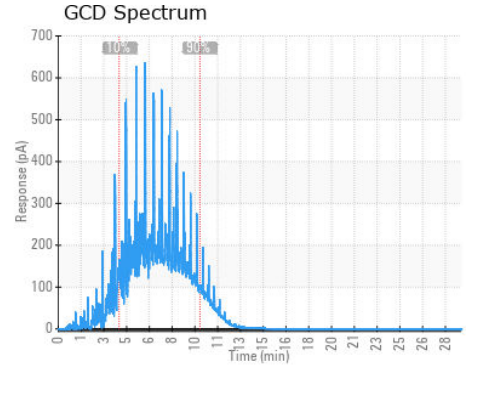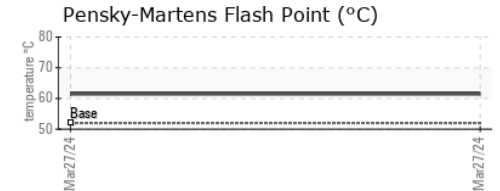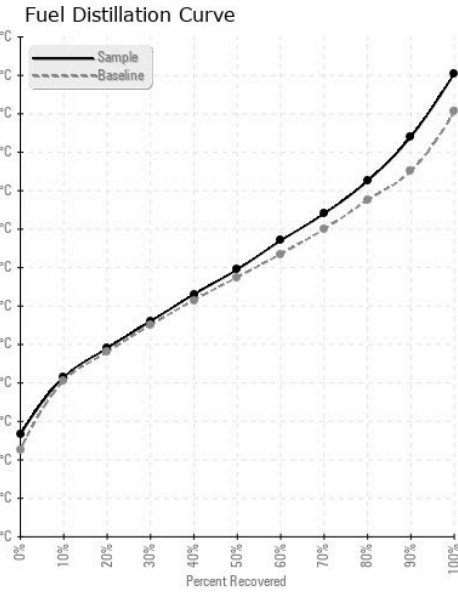

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC06139440 **Received** : 04 Apr 2024
Lab Number : **06139440** **Tested** : 15 Apr 2024
Unique Number : 10964248 **Diagnosed** : 15 Apr 2024 - Doug Bogart
Test Package : DF-2 (Additional Tests: CldPt, Fuel, Screen)

PETROLEUM RECOVERY SERVICES
 210 POWELL DR
 SUMMERVILLE, SC
 US 29483
 Contact: AJAY EL
 Ajay@prsfuel.com
 T: (843)225-1777
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)