




OIL ANALYSIS REPORT

Sample Rating Trend

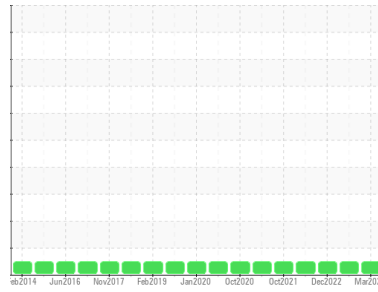

NORMAL



Machine Id
HY/9WM

Component
Gearbox

Fluid
MOBIL MOBILGEAR SHC XMP 320 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0807450	WC0695207	WC0695072
Sample Date	Client Info			19 Mar 2024	14 Jul 2023	20 Dec 2022
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		58680	52704	47460
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	35	32	32
Chromium	ppm	ASTM D5185m	>15	<1	<1	0
Nickel	ppm	ASTM D5185m	>15	<1	<1	0
Titanium	ppm	ASTM D5185m		<1	<1	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	2	2	0
Lead	ppm	ASTM D5185m	>100	<1	<1	0
Copper	ppm	ASTM D5185m	>200	1	6	0
Tin	ppm	ASTM D5185m	>25	<1	<1	0
Vanadium	ppm	ASTM D5185m		<1	<1	0
Cadmium	ppm	ASTM D5185m		<1	<1	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		<1	14	2
Calcium	ppm	ASTM D5185m	0	<1	5	0
Phosphorus	ppm	ASTM D5185m	485	381	399	421
Zinc	ppm	ASTM D5185m	0	21	41	19
Sulfur	ppm	ASTM D5185m		4157	4365	4670






CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	2	2	2
Sodium	ppm	ASTM D5185m	>15	<1	<1	<1
Potassium	ppm	ASTM D5185m	>20	2	2	<1
Water	%	ASTM D6304	>0.2	NEG	NEG	NEG

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	204	271	94
Particles >6µm		ASTM D7647	>5000	53	51	25
Particles >14µm		ASTM D7647	>640	7	10	6
Particles >21µm		ASTM D7647	>160	5	4	2
Particles >38µm		ASTM D7647	>40	1	1	1
Particles >71µm		ASTM D7647	>10	0	1	0
Oil Cleanliness		ISO 4406 (c)	>21/19/16	15/13/10	15/13/10	14/12/10

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.85	1.14	1.13	1.06




OIL ANALYSIS REPORT

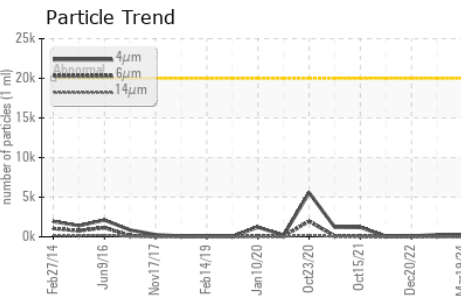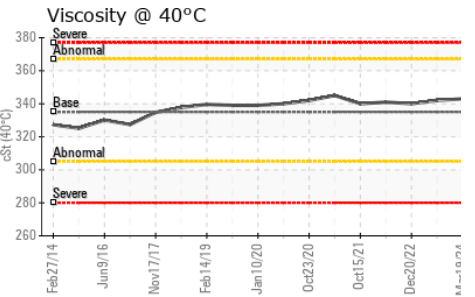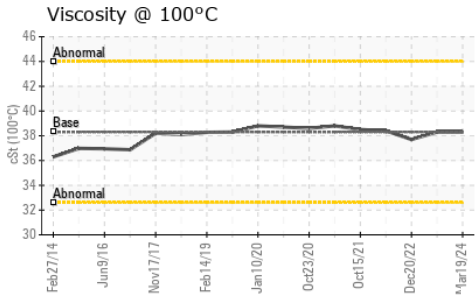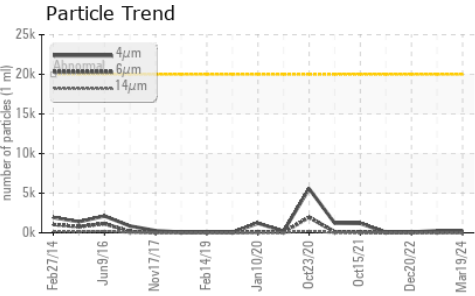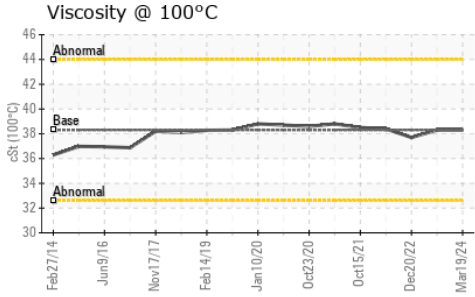





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	335	342	340
Visc @ 100°C	cSt	ASTM D445	38.3	38.3	37.7
Viscosity Index (VI)	Scale	ASTM D2270	164	161	159

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

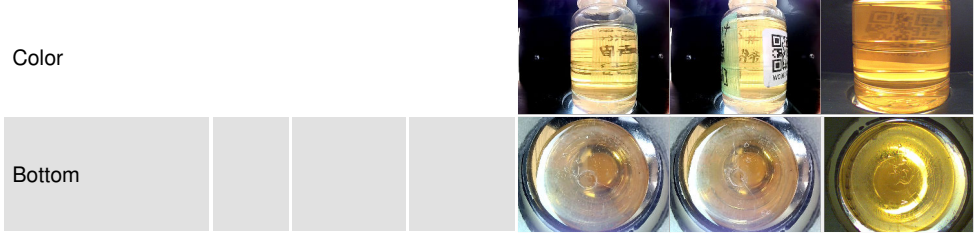

GRAPHS

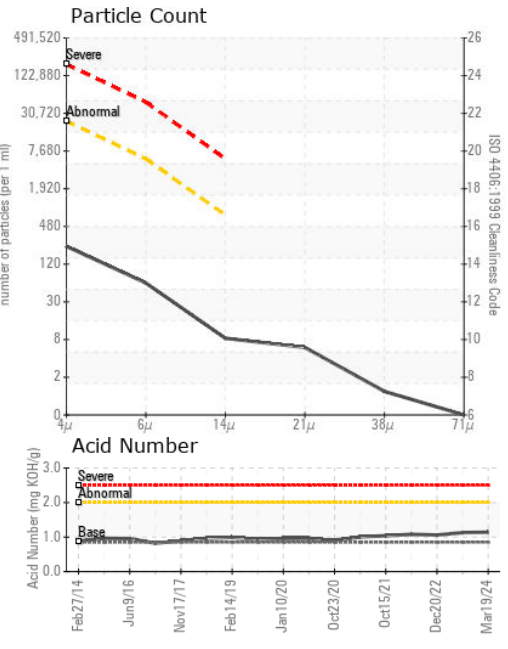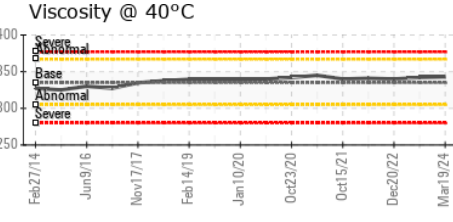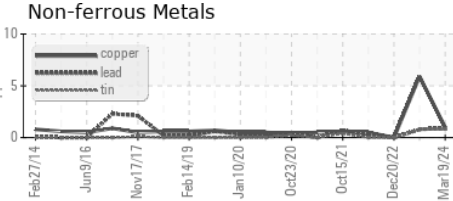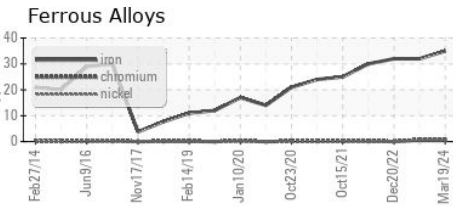

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0807450 **Received** : 05 Apr 2024
Lab Number : 06139781 **Tested** : 08 Apr 2024
Unique Number : 10964589 **Diagnosed** : 08 Apr 2024 - Don Baldrige
Test Package : PLANT (Additional Tests: KV100, VI)

JPHYTEC

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

JP
 Contact: Service

T:
F: