




OIL ANALYSIS REPORT

Sample Rating Trend

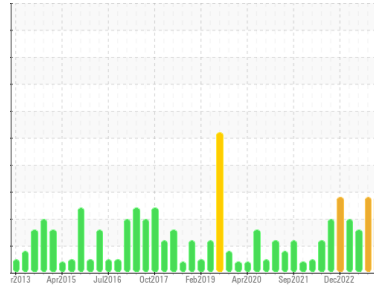

Area
ER-1
 Machine Id
C-11 (S/N S0431TFMCTHAA03)
 Component
Refrigeration Compressor
 Fluid
FRICK COMPRESSOR OIL #3 (130 GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

The iron level is abnormal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			USP0008014	USP0005040	USP0001632
Sample Date	Client Info			28 Mar 2024	02 Jan 2024	26 Sep 2023
Machine Age	hrs	Client Info		29157	29143	27871
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	▲ 86	▲ 89	▲ 74
Chromium	ppm	ASTM D5185m	>2	0	<1	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	<1	0	0
Lead	ppm	ASTM D5185m	>2	<1	0	<1
Copper	ppm	ASTM D5185m	>8	3	4	2
Tin	ppm	ASTM D5185m	>4	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		2	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		<1	0	0
Calcium	ppm	ASTM D5185m		0	<1	<1
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		0	3	17
Sulfur	ppm	ASTM D5185m		0	25	74


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	0	<1	<1
Sodium	ppm	ASTM D5185m		2	3	<1
Potassium	ppm	ASTM D5185m	>20	<1	<1	<1
Water	%	ASTM D6304	>0.01	0.003	0.003	0.002
ppm Water	ppm	ASTM D6304	>100	26	31	25.0

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	▲ 270322	▲ 197107	● 15904
Particles >6µm		ASTM D7647	>2500	▲ 106910	▲ 113368	2407
Particles >14µm		ASTM D7647	>320	▲ 2692	▲ 6019	82
Particles >21µm		ASTM D7647	>80	▲ 270	▲ 579	15
Particles >38µm		ASTM D7647	>20	1	5	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	▲ 25/24/19	▲ 25/24/20	● 21/18/14


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974		0.082	0.073	0.069

OIL ANALYSIS REPORT


Particle Trend

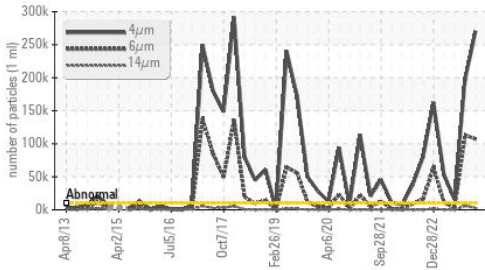


Water (KF)

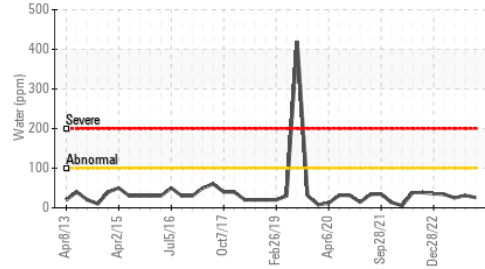


Ferrous Alloys

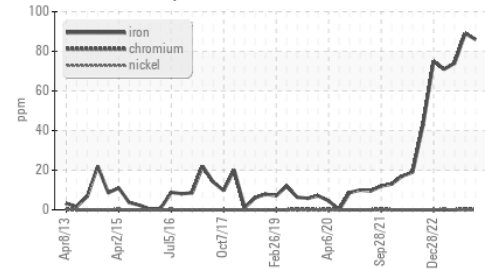

Acid Number

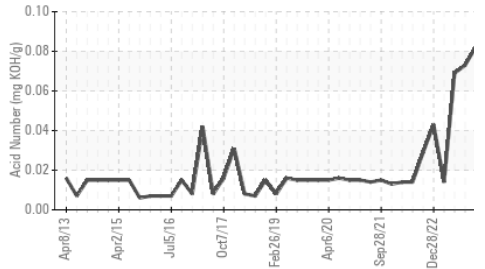


Water (KF)

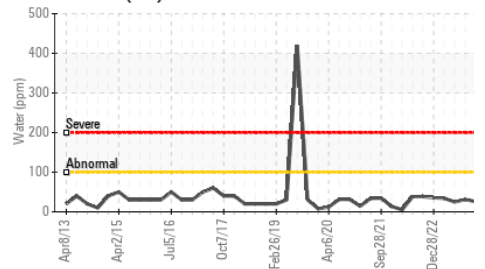

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 73	68.5	66.7	67.8

SAMPLE IMAGES

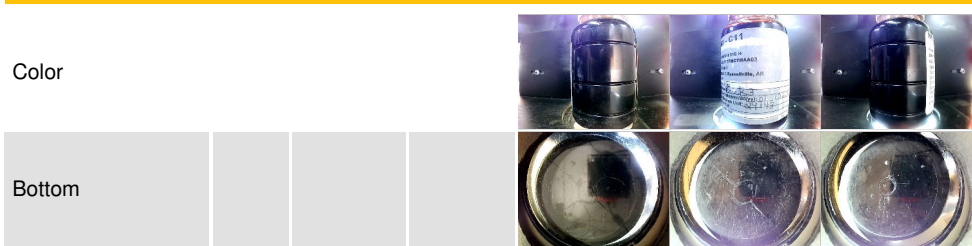


GRAPHS


Ferrous Alloys

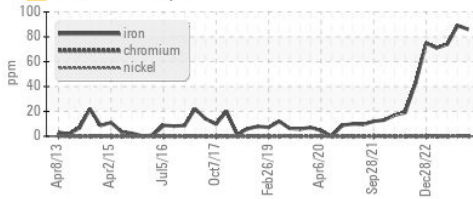


Non-ferrous Metals

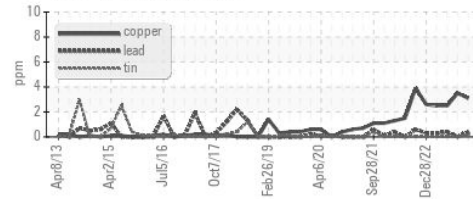


Viscosity @ 40°C

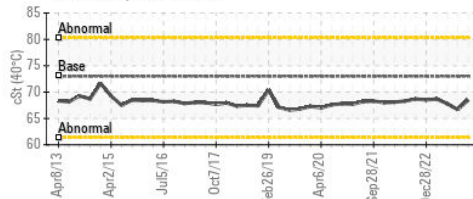

Particle Count

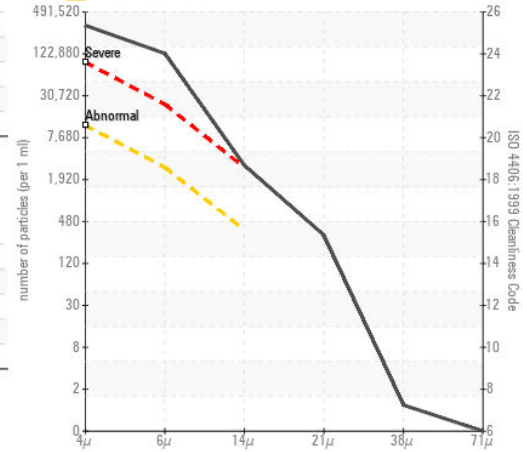

Acid Number

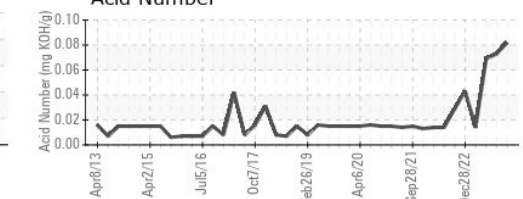

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : USP008014

Lab Number : 06139953

Unique Number : 10964761

Test Package : IND 2

Received : 05 Apr 2024

Tested : 08 Apr 2024

Diagnosed : 08 Apr 2024 - Doug Bogart

CONAGRA FROZEN FOODS CO

RUSSELLVILLE, AR

US

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: