


OIL ANALYSIS REPORT

NOT GIVEN

INGERSOLL RAND CBV832668

Component Compressor

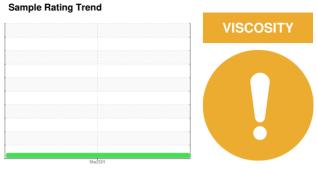

Recommendation

The oil change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition


The oil viscosity is higher than normal. The AN level is acceptable for this fluid.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UAC06140013		
Sample Date		Client Info		15 Mar 2024		
Machine Age	hrs	Client Info		3569		
Oil Age	hrs	Client Info		3569		
Oil Changed		Client Info		Changed		
Sample Status				ATTENTION		
CONTAMINATIO	V	method	limit/base	current	history1	history2
Water		WC Method	>0.8	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	<1		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>15	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	2	0		
Barium	ppm	ASTM D5185m	525	397		
Molybdenum	ppm	ASTM D5185m	10	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	5	2		
Calcium	ppm	ASTM D5185m	10	4		
Phosphorus	ppm	ASTM D5185m	250	7		
Zinc	ppm	ASTM D5185m	100	0		
Sulfur	ppm	ASTM D5185m	400	386		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	4		
Sodium	ppm	ASTM D5185m		34		
Potassium	ppm	ASTM D5185m	>20	4		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.52		





OIL ANALYSIS REPORT

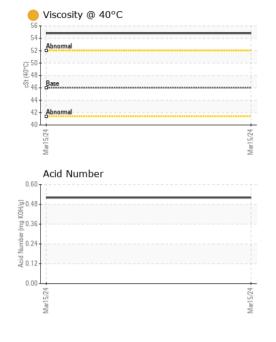

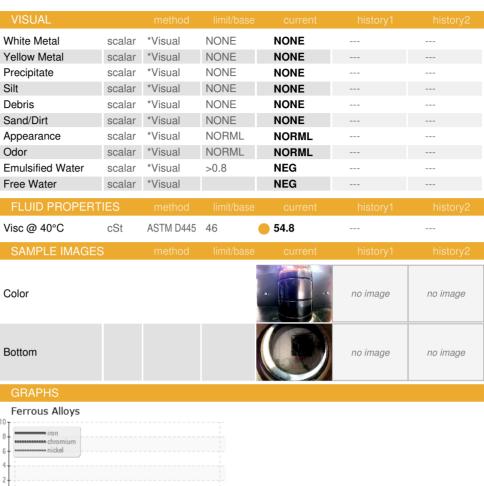











Laboratory Sample No.

Lab Number : 06140013

: UAC06140013 Unique Number : 10964821

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 05 Apr 2024 **Tested** : 08 Apr 2024

Diagnosed : 08 Apr 2024 - Don Baldridge

Test Package : IND 2 Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

ATLANTA AIR COMPRESSOR

123 MERCHANTS PARK DR HOSCHTON, GA

> US 30548 Contact: Derik Bray

Derik@atlantaaircompressor.com T: (470)252-9952

Contact/Location: Derik Bray - UCATLHOS

F: x: