



OIL ANALYSIS REPORT

HC SYN 5





Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UAC06140017	UCH05806400	
Sample Date		Client Info		11 Mar 2024	24 Feb 2023	
Machine Age	hrs	Client Info		7776	7151	
Oil Age	hrs	Client Info		652	0	
Oil Changed		Client Info		Changed	Changed	
Sample Status				NORMAL	NORMAL	
CONTAMINATIO	V	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m		0	<1	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m		0	0	
Aluminum	ppm	ASTM D5185m	>25	<1	0	
Lead	ppm	ASTM D5185m	>25	0	0	
Copper	ppm	ASTM D5185m	>50	<1	<1	
Tin	ppm	ASTM D5185m	>15	0	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m		<1	521	
Molybdenum	ppm	ASTM D5185m		0	<1	
Manganese	ppm	ASTM D5185m		<1	0	
Magnesium	ppm	ASTM D5185m		<1	2	
Calcium	ppm	ASTM D5185m		2	3	
Phosphorus	ppm	ASTM D5185m		304	4	
Zinc	ppm	ASTM D5185m		105	29	
Sulfur	ppm	ASTM D5185m		998	347	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	3	
Sodium	ppm	ASTM D5185m		2	16	
Potassium	ppm	ASTM D5185m	>20	<1	2	
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.52	0.15	





OIL ANALYSIS REPORT

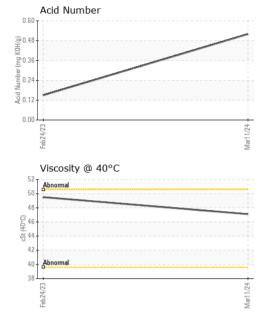
















Laboratory Sample No.

Lab Number : 06140017 Unique Number : 10964825

: UAC06140017

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 05 Apr 2024 **Tested** : 08 Apr 2024

Diagnosed : 08 Apr 2024 - Don Baldridge

Test Package : IND 2 Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

ATLANTA AIR COMPRESSOR

123 MERCHANTS PARK DR HOSCHTON, GA

US 30548 Contact: Derik Bray

Derik@atlantaaircompressor.com T: (470)252-9952

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: x: