




# OIL ANALYSIS REPORT



Machine Id  
**HANM04BE (S/N 4EK00413)**  
 Component  
**Biogas Engine**  
 Fluid  
**CHEVRON HDAX LFG SAE 40 (95 GAL)**

Sample Rating Trend

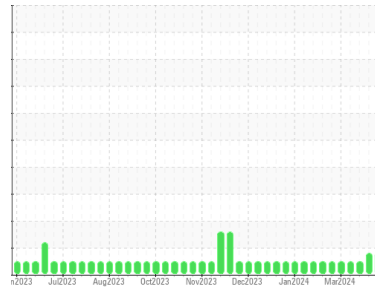

**WEAR**



## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### ▲ Wear

The tin level is abnormal. All other component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0898112</b>	WC0898120	WC0898125
Sample Date	Client Info		<b>03 Apr 2024</b>	29 Mar 2024	19 Mar 2024
Machine Age	hrs	Client Info	<b>74057</b>	73941	73704
Oil Age	hrs	Client Info	<b>635</b>	519	282
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	Not Chngd
Sample Status			<b>ABNORMAL</b>	ABNORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>.11	<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >15	<b>4</b>	2	4
Chromium	ppm	ASTM D5185m >4	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	2	<1
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >6	<b>2</b>	2	3
Lead	ppm	ASTM D5185m >9	<b>&lt;1</b>	<1	1
Copper	ppm	ASTM D5185m >6	<b>2</b>	1	2
Tin	ppm	ASTM D5185m >4	<b>▲ 5</b>	<b>▲ 4</b>	4
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>11</b>	10	6
Barium	ppm	ASTM D5185m	<b>0</b>	0	1
Molybdenum	ppm	ASTM D5185m	<b>2</b>	0	2
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	<b>16</b>	5	11
Calcium	ppm	ASTM D5185m	<b>1934</b>	1821	1932
Phosphorus	ppm	ASTM D5185m 270	<b>305</b>	276	278
Zinc	ppm	ASTM D5185m 310	<b>376</b>	329	366
Sulfur	ppm	ASTM D5185m	<b>2952</b>	2619	2510

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >181	<b>149</b>	138	100
Sodium	ppm	ASTM D5185m >21	<b>&lt;1</b>	5	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	17	3

## INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	<b>0.1</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	<b>7.6</b>	7.4	6.9
Sulfation	Abs/.1mm	*ASTM D7415	<b>22.7</b>	21.9	20.0


## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	<b>19.2</b>	18.1	15.0
Acid Number (AN)	mg KOH/g	ASTM D8045 1.8	<b>1.89</b>	1.99	1.73
Base Number (BN)	mg KOH/g	ASTM D2896 6.0	<b>3.51</b>	3.40	3.76




# OIL ANALYSIS REPORT


### ▲ Non-ferrous Metals

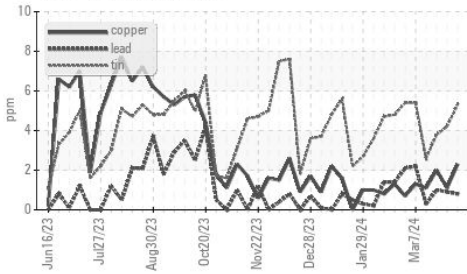


### FT-IR (Direct Trend)

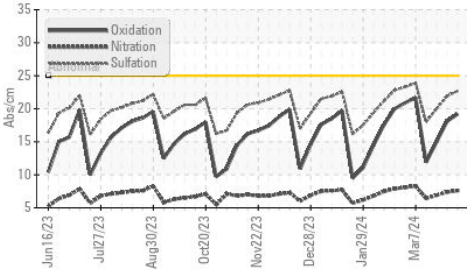


### Acid Number

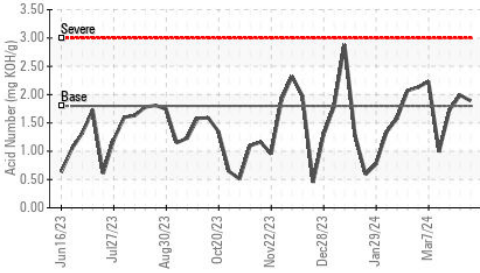

### Base Number

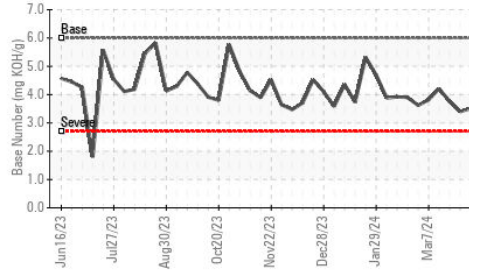

### Viscosity @ 100°C

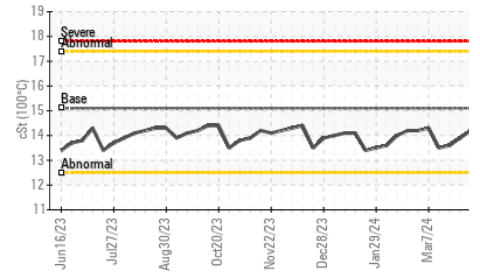


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.11	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	15.1	<b>14.2</b>	13.9	13.6

### GRAPHS


#### Iron (ppm)

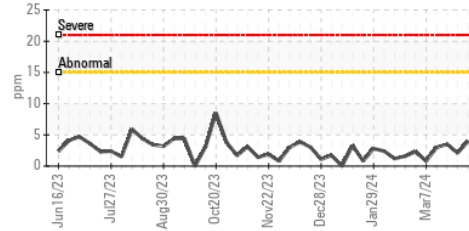


#### Aluminum (ppm)

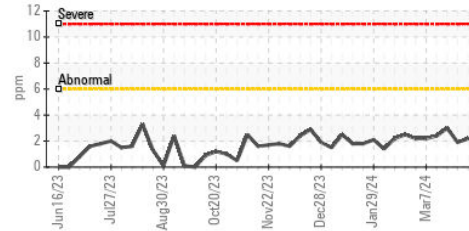


#### Copper (ppm)

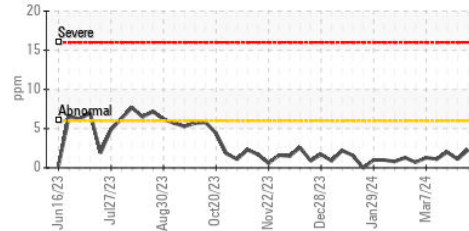


#### Viscosity @ 100°C

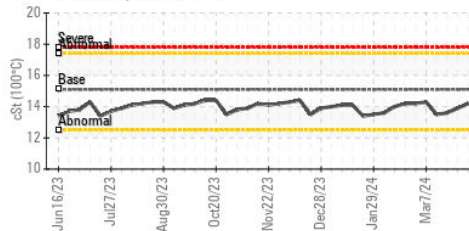


#### Lead (ppm)

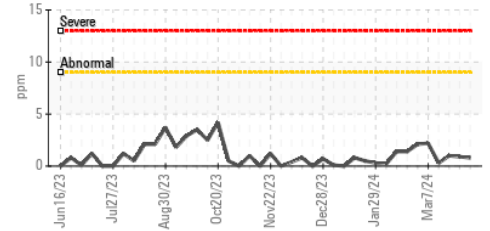


#### Chromium (ppm)

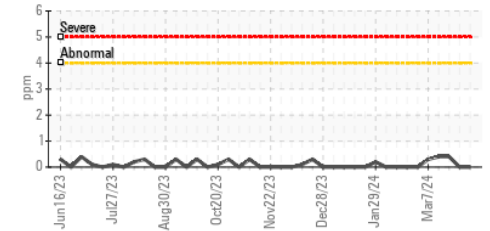

#### Silicon (ppm)

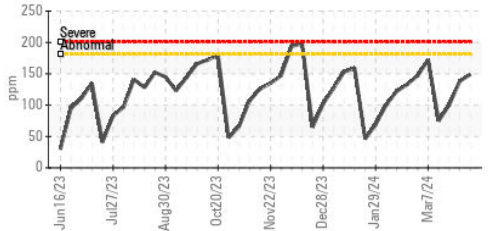

#### Base Number

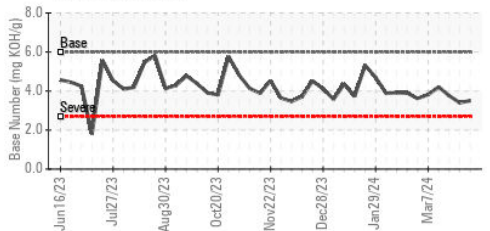

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0898112  
**Lab Number** : 06140095  
**Unique Number** : 10964903  
**Test Package** : MOB 2

**Received** : 05 Apr 2024  
**Tested** : 08 Apr 2024  
**Diagnosed** : 08 Apr 2024 - Don Baldrige

**EDL NA Recips-Hancock County**  
 HANCOCK COUNTY POWER STATION, 3574 TOWNSHIP ROAD 142  
 FINDLAY, OH  
 US 45840

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact: TIM CUSICK  
 tim.cusick@edlenergy.com

T:  
 F: