




# OIL ANALYSIS REPORT

Sample Rating Trend

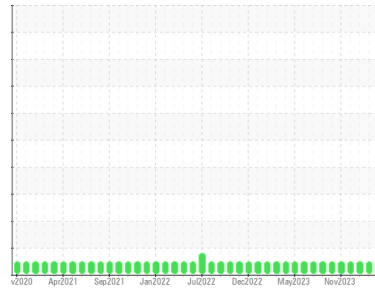

**NORMAL**



Area

**Paul G. Blazer**

Machine Id

**[Paul G. Blazer] Oil - Starboard Genset**

Component

**Starboard Genset**

Fluid

**DIESEL ENGINE OIL SAE 15W40 (8 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0719257</b>	WC0845920	WC0845764
Sample Date	Client Info		<b>20 Mar 2024</b>	10 Feb 2024	25 Jan 2024
Machine Age	hrs	Client Info	<b>13342</b>	12834	12677
Oil Age	hrs	Client Info	<b>1</b>	500	382
Oil Changed	Client Info		<b>N/A</b>	Changed	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>50	<b>2</b>	10	7
Chromium	ppm	ASTM D5185m	>4	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185m	>2	<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>0</b>	<1	<1
Silver	ppm	ASTM D5185m	>5	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>12	<b>2</b>	1	2
Lead	ppm	ASTM D5185m	>17	<b>0</b>	<1	3
Copper	ppm	ASTM D5185m	>70	<b>&lt;1</b>	2	2
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	<1

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	250	<b>43</b>	40	45
Barium	ppm	ASTM D5185m	10	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	100	<b>58</b>	65	66
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	2
Magnesium	ppm	ASTM D5185m	450	<b>1317</b>	1438	1339
Calcium	ppm	ASTM D5185m	3000	<b>1119</b>	1293	1193
Phosphorus	ppm	ASTM D5185m	1150	<b>927</b>	1003	947
Zinc	ppm	ASTM D5185m	1350	<b>1102</b>	1234	1154
Sulfur	ppm	ASTM D5185m	4250	<b>3639</b>	3180	2958

## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>25	<b>5</b>	3	4
Sodium	ppm	ASTM D5185m	>158	<b>1</b>	2	4
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	0	3

## INFRA-RED




	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844		<b>0.1</b>	0.2	0.2
Nitration	Abs/cm	*ASTM D7624	>20	<b>6.0</b>	10.4	9.3
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>18.5</b>	21.1	20.7

## FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>14.7</b>	20.1	18.6
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	<b>11.49</b>	12.29	12.52







# OIL ANALYSIS REPORT

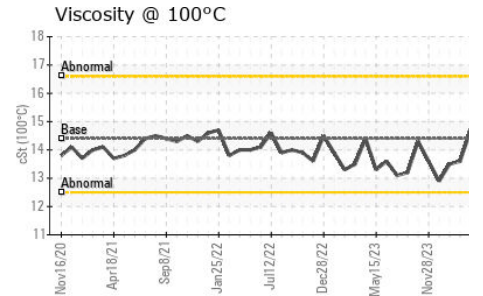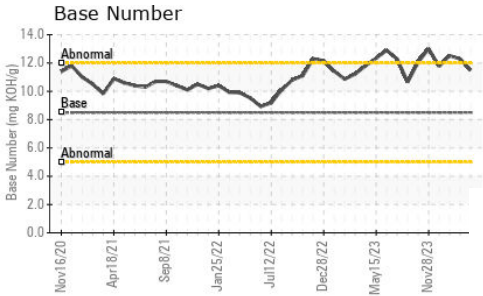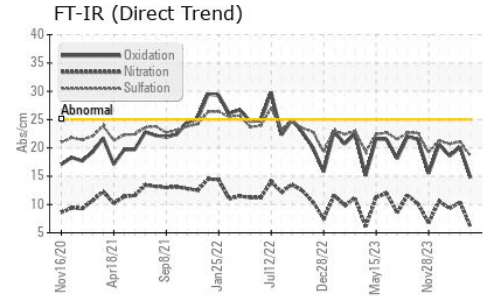

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	14.4	<b>14.7</b>	13.6	13.5

## GRAPHS

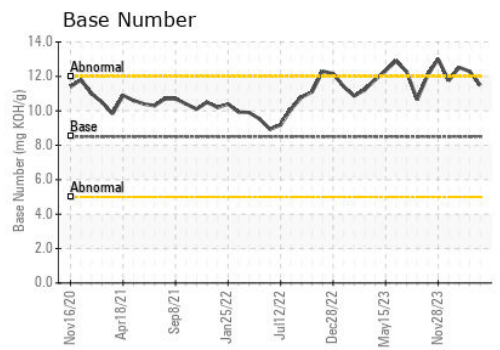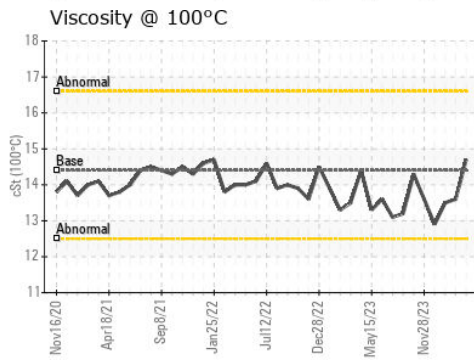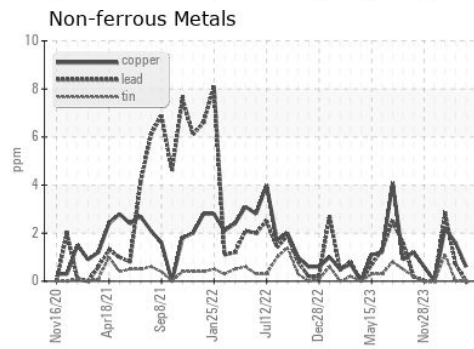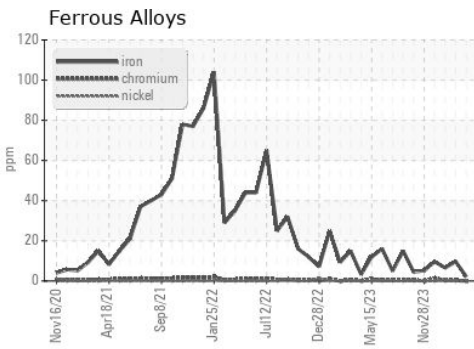

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0719257  
**Lab Number** : **06140106**  
**Unique Number** : 10964914  
**Test Package** : IND 2  
**Received** : 05 Apr 2024  
**Tested** : 08 Apr 2024  
**Diagnosed** : 09 Apr 2024 - Sean Felton

**MARATHON PETROLEUM CO.**  
 101 12TH ST  
 CATLETTSBURG, KY  
 US 41169  
 Contact: CORY GUMBERT  
 cagumbert@marathonpetroleum.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)