




OIL ANALYSIS REPORT

Sample Rating Trend

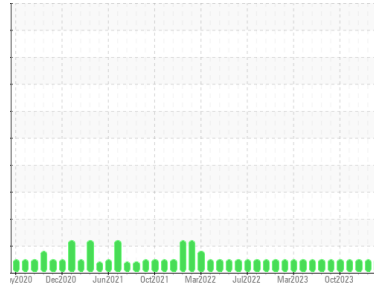

NORMAL



Area

Speedway

Machine Id

[Speedway] Oil - Aft Genset

Component

Aft Genset

Fluid

MOBIL 15W40 (8 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. (Customer Sample Comment: Top Up Amount: 1 GAL)

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0860042	WC0845770	WC0845779
Sample Date	Client Info		20 Mar 2024	03 Feb 2024	23 Jan 2024
Machine Age	hrs	Client Info	12140	11602	11347
Oil Age	hrs	Client Info	12033	11501	11246
Oil Changed	Client Info		Oil Added	Filtered	Oil Added
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>50	37	43	36
Chromium	ppm	ASTM D5185m	>4	<1	<1	<1
Nickel	ppm	ASTM D5185m	>2	0	0	<1
Titanium	ppm	ASTM D5185m		0	<1	<1
Silver	ppm	ASTM D5185m	>5	0	0	<1
Aluminum	ppm	ASTM D5185m	>12	1	<1	2
Lead	ppm	ASTM D5185m	>17	0	0	3
Copper	ppm	ASTM D5185m	>70	1	1	3
Tin	ppm	ASTM D5185m	>15	<1	<1	1
Vanadium	ppm	ASTM D5185m		0	0	<1
Cadmium	ppm	ASTM D5185m		0	0	<1

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		7	6	9
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		65	65	66
Manganese	ppm	ASTM D5185m		<1	<1	2
Magnesium	ppm	ASTM D5185m		1536	1559	1458
Calcium	ppm	ASTM D5185m		1179	1197	1080
Phosphorus	ppm	ASTM D5185m		1133	1119	1063
Zinc	ppm	ASTM D5185m		1397	1398	1313
Sulfur	ppm	ASTM D5185m		3889	3309	3139

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>25	6	7	6
Sodium	ppm	ASTM D5185m	>118	13	13	14
Potassium	ppm	ASTM D5185m	>20	0	0	4
Water	%	ASTM D6304	>0.1	NEG	NEG	NEG

INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844		0.3	0.3	0.3
Nitration	Abs/cm	*ASTM D7624	>20	12.7	13.3	11.7
Sulfation	Abs/.1mm	*ASTM D7415	>30	22.6	23.1	22.0


FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414	>25	24.4	25.6	22.8
Base Number (BN)	mg KOH/g	ASTM D2896		11.41	11.34	11.85




OIL ANALYSIS REPORT


FT-IR (Direct Trend)

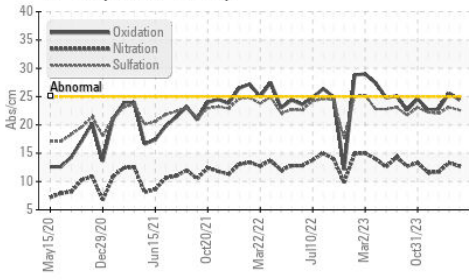


Water (KF)

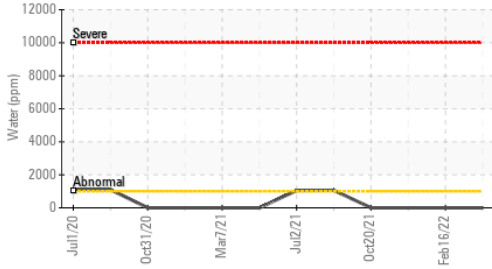

Base Number

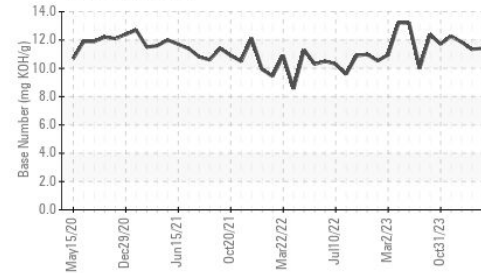

Water (KF)

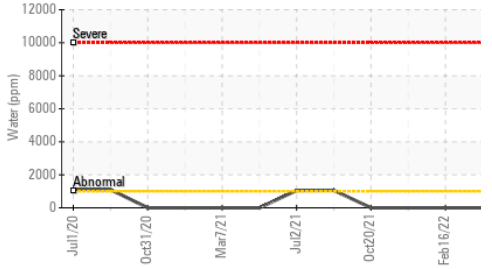


VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	LIGHT	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.1	13.1	13.1

GRAPHS


Ferrous Alloys

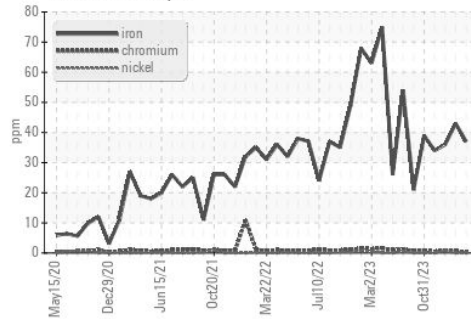


Non-ferrous Metals

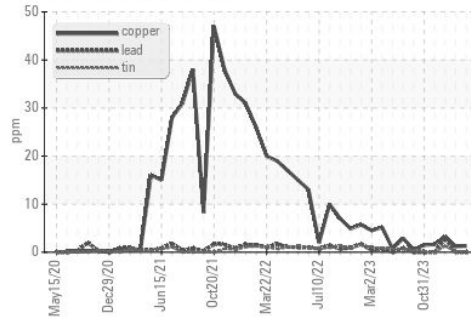

Viscosity @ 100°C

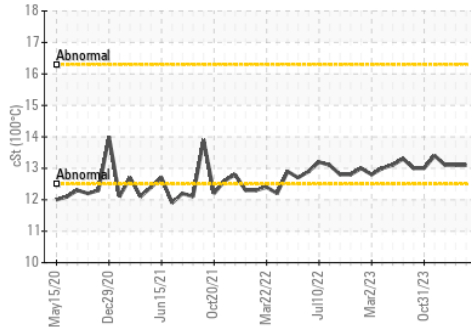

Base Number

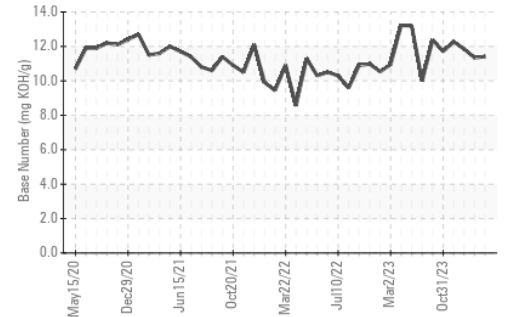

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0860042

Lab Number : **06140107**

Unique Number : 10964915

Test Package : IND 2 (Additional Tests: KF)

Received : 05 Apr 2024

Tested : 09 Apr 2024

Diagnosed : 09 Apr 2024 - Sean Felton

MARATHON PETROLEUM CO.

101 12TH ST

CATLETTSBURG, KY

US 41169

Contact: CORY GUMBERT

cagumbert@marathonpetroleum.com

T: (606)585-3950

F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)