




# OIL ANALYSIS REPORT

Sample Rating Trend

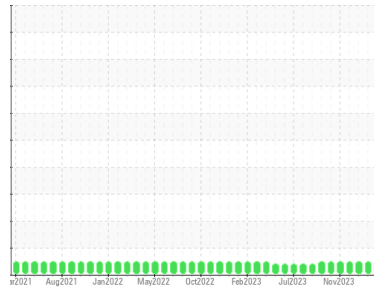

**NORMAL**



Area  
**Findlay**  
 Machine Id  
**[Findlay] Oil - Port Genset**  
 Component  
**Port Genset**  
 Fluid  
**MARATHON 15W40 (8 GAL)**

## DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is no indication of any contamination in the oil.

**Fluid Condition**  
 The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION |             | method      | limit/base | current            | history1    | history2    |
|--------------------|-------------|-------------|------------|--------------------|-------------|-------------|
| Sample Number      | Client Info |             |            | <b>WC0845862</b>   | WC0859880   | WC0859883   |
| Sample Date        | Client Info |             |            | <b>19 Mar 2024</b> | 23 Feb 2024 | 24 Jan 2024 |
| Machine Age        | hrs         | Client Info |            | <b>10800</b>       | 10783       | 10267       |
| Oil Age            | hrs         | Client Info |            | <b>2302</b>        | 2285        | 1769        |
| Oil Changed        | Client Info |             |            | <b>Filtered</b>    | Not Changd  | Filtered    |
| Sample Status      |             |             |            | <b>NORMAL</b>      | NORMAL      | NORMAL      |

| CONTAMINATION |           | method | limit/base | current        | history1 | history2 |
|---------------|-----------|--------|------------|----------------|----------|----------|
| Fuel          | WC Method | >4.0   |            | <b>&lt;1.0</b> | <1.0     | <1.0     |
| Glycol        | WC Method |        |            | <b>NEG</b>     | NEG      | NEG      |

| WEAR METALS |     | method      | limit/base | current      | history1 | history2 |
|-------------|-----|-------------|------------|--------------|----------|----------|
| Iron        | ppm | ASTM D5185m | >50        | <b>15</b>    | 10       | 8        |
| Chromium    | ppm | ASTM D5185m | >4         | <b>&lt;1</b> | 0        | <1       |
| Nickel      | ppm | ASTM D5185m | >2         | <b>0</b>     | 0        | 0        |
| Titanium    | ppm | ASTM D5185m |            | <b>0</b>     | 0        | <1       |
| Silver      | ppm | ASTM D5185m | >5         | <b>0</b>     | 0        | 0        |
| Aluminum    | ppm | ASTM D5185m | >12        | <b>&lt;1</b> | 0        | <1       |
| Lead        | ppm | ASTM D5185m | >17        | <b>0</b>     | 0        | <1       |
| Copper      | ppm | ASTM D5185m | >70        | <b>3</b>     | 0        | <1       |
| Tin         | ppm | ASTM D5185m | >15        | <b>&lt;1</b> | 0        | 0        |
| Vanadium    | ppm | ASTM D5185m |            | <b>0</b>     | 0        | 0        |
| Cadmium     | ppm | ASTM D5185m |            | <b>0</b>     | 0        | 0        |

| ADDITIVES  |     | method      | limit/base | current      | history1 | history2 |
|------------|-----|-------------|------------|--------------|----------|----------|
| Boron      | ppm | ASTM D5185m |            | <b>26</b>    | 22       | 22       |
| Barium     | ppm | ASTM D5185m |            | <b>0</b>     | 0        | 0        |
| Molybdenum | ppm | ASTM D5185m |            | <b>51</b>    | 52       | 53       |
| Manganese  | ppm | ASTM D5185m |            | <b>&lt;1</b> | 0        | <1       |
| Magnesium  | ppm | ASTM D5185m |            | <b>1249</b>  | 1376     | 1342     |
| Calcium    | ppm | ASTM D5185m |            | <b>1358</b>  | 1362     | 1309     |
| Phosphorus | ppm | ASTM D5185m |            | <b>1050</b>  | 960      | 1057     |
| Zinc       | ppm | ASTM D5185m |            | <b>1285</b>  | 1252     | 1292     |
| Sulfur     | ppm | ASTM D5185m |            | <b>3619</b>  | 3540     | 3287     |

| CONTAMINANTS |     | method      | limit/base | current      | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon      | ppm | ASTM D5185m | >25        | <b>3</b>     | 2        | 3        |
| Sodium       | ppm | ASTM D5185m |            | <b>6</b>     | 3        | 4        |
| Potassium    | ppm | ASTM D5185m | >20        | <b>&lt;1</b> | 0        | 0        |
| Water        | %   | ASTM D6304  | >0.1       | <b>NEG</b>   | NEG      | NEG      |


| INFRA-RED |          | method      | limit/base | current     | history1 | history2 |
|-----------|----------|-------------|------------|-------------|----------|----------|
| Soot %    | %        | *ASTM D7844 |            | <b>0.3</b>  | 0.2      | 0.2      |
| Nitration | Abs/cm   | *ASTM D7624 | >20        | <b>15.7</b> | 14.9     | 13.3     |
| Sulfation | Abs/.1mm | *ASTM D7415 | >30        | <b>27.3</b> | 25.9     | 23.9     |

| FLUID DEGRADATION |          | method      | limit/base | current     | history1 | history2 |
|-------------------|----------|-------------|------------|-------------|----------|----------|
| Oxidation         | Abs/.1mm | *ASTM D7414 | >25        | <b>34.5</b> | 31.4     | 27.0     |
| Base Number (BN)  | mg KOH/g | ASTM D2896  |            | <b>8.27</b> | 8.92     | 10.19    |




# OIL ANALYSIS REPORT


FT-IR (Direct Trend)

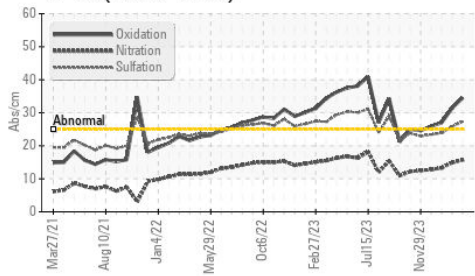


Water (KF)

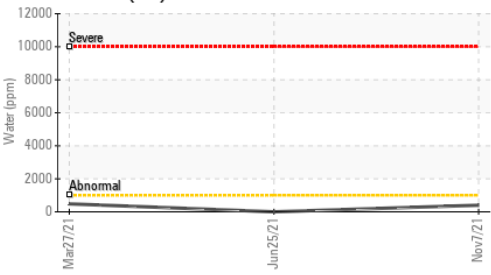

Base Number

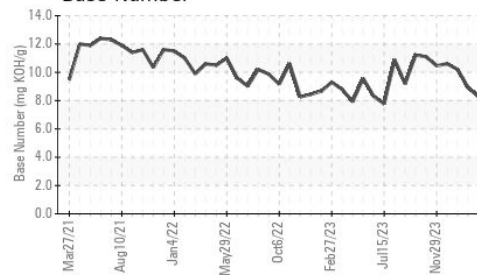

Water (KF)

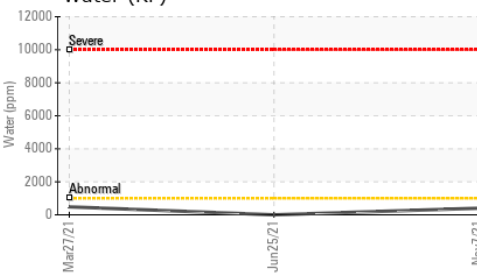


| VISUAL           | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Yellow Metal     | scalar | *Visual    | NONE    | NONE     | NONE     |
| Precipitate      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Silt             | scalar | *Visual    | NONE    | NONE     | NONE     |
| Debris           | scalar | *Visual    | NONE    | NONE     | NONE     |
| Sand/Dirt        | scalar | *Visual    | NONE    | NONE     | NONE     |
| Appearance       | scalar | *Visual    | NORML   | NORML    | NORML    |
| Odor             | scalar | *Visual    | NORML   | NORML    | NORML    |
| Emulsified Water | scalar | *Visual    | >0.1    | NEG      | NEG      |
| Free Water       | scalar | *Visual    |         | NEG      | NEG      |


| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 100°C     | cSt    | ASTM D445  | 16.7    | 16.2     | 15.0     |

## GRAPHS


Ferrous Alloys

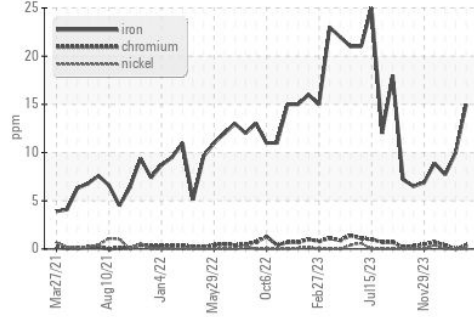


Non-ferrous Metals

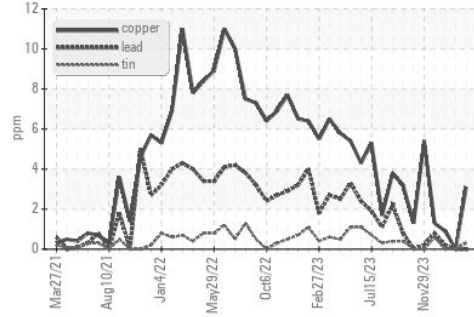

Viscosity @ 100°C

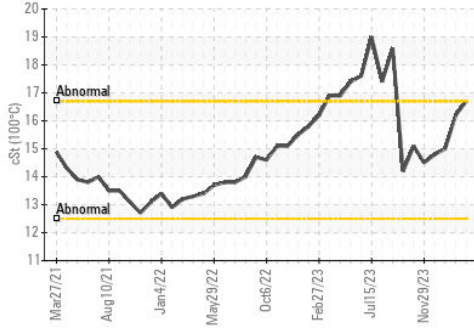

Base Number

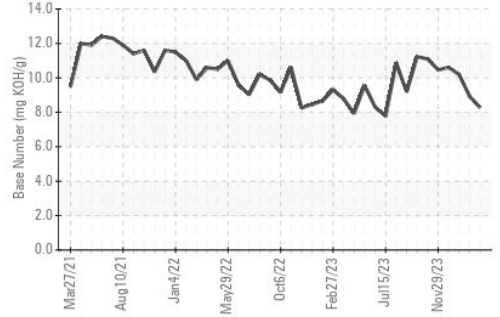

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0845862      **Received** : 05 Apr 2024  
**Lab Number** : 06140122      **Tested** : 09 Apr 2024  
**Unique Number** : 10964930      **Diagnosed** : 09 Apr 2024 - Sean Felton  
**Test Package** : IND 2 ( Additional Tests: KF )

**MARATHON PETROLEUM CO.**  
 101 12TH ST  
 CATLETTSBURG, KY  
 US 41169  
 Contact: SHAWN MCCLASKEY  
 stmccclaskey@marathonpetroleum.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (606)739-2416

F: x: