




OIL ANALYSIS REPORT

Sample Rating Trend

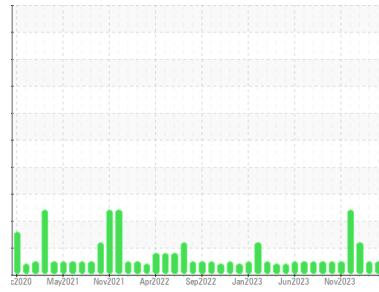

NORMAL



Area

Detroit

Machine Id

[Detroit] Oil - Starboard Genset

Component

Starboard Genset

Fluid

MOBIL 15W40 (7 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. (Customer Sample Comment: Chris Wray)

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0804781	WC0804773	WC0804820
Sample Date	Client Info		25 Mar 2024	05 Feb 2024	01 Jan 2024
Machine Age	hrs	Client Info	9072	8531	8031
Oil Age	hrs	Client Info	1045	505	4
Oil Changed	Client Info		Not Chngd	Not Chngd	N/A
Sample Status			NORMAL	NORMAL	ABNORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	0.7	▲ 3.4
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>50	33	20	4
Chromium	ppm	ASTM D5185m	>4	<1	<1	0
Nickel	ppm	ASTM D5185m	>2	0	0	<1
Titanium	ppm	ASTM D5185m		0	<1	<1
Silver	ppm	ASTM D5185m	>5	0	0	<1
Aluminum	ppm	ASTM D5185m	>12	3	3	3
Lead	ppm	ASTM D5185m	>17	0	0	3
Copper	ppm	ASTM D5185m	>70	2	<1	2
Tin	ppm	ASTM D5185m	>15	0	0	1
Vanadium	ppm	ASTM D5185m		0	0	<1
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		78	85	86
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		23	22	22
Manganese	ppm	ASTM D5185m		<1	<1	2
Magnesium	ppm	ASTM D5185m		278	267	251
Calcium	ppm	ASTM D5185m		2446	2378	2131
Phosphorus	ppm	ASTM D5185m		460	452	413
Zinc	ppm	ASTM D5185m		558	557	499
Sulfur	ppm	ASTM D5185m		4692	3993	3656

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>25	2	5	8
Sodium	ppm	ASTM D5185m	>118	3	2	4
Potassium	ppm	ASTM D5185m	>20	0	0	4
Water	%	ASTM D6304	>0.1	NEG	NEG	NEG

INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844		0.3	0.2	0.1
Nitration	Abs/cm	*ASTM D7624	>20	10.3	8.7	6.5
Sulfation	Abs/.1mm	*ASTM D7415	>30	21.4	20.7	20.0


FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414	>25	18.9	16.1	13.6
Base Number (BN)	mg KOH/g	ASTM D2896		8.25	9.15	9.19




OIL ANALYSIS REPORT


FT-IR (Direct Trend)

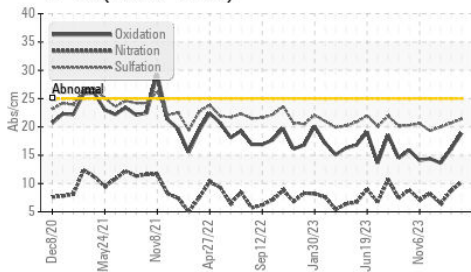


Water (KF)

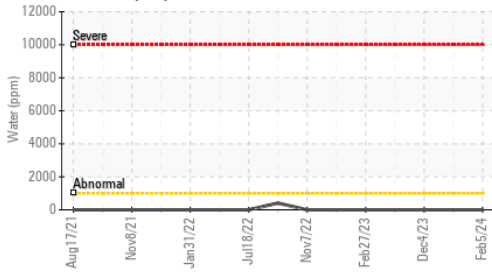

Base Number

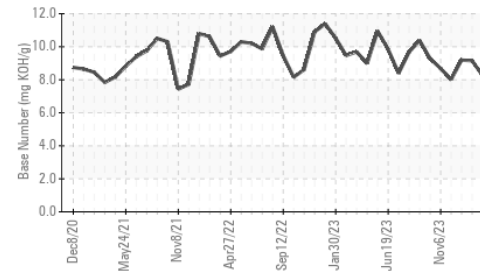

Water (KF)

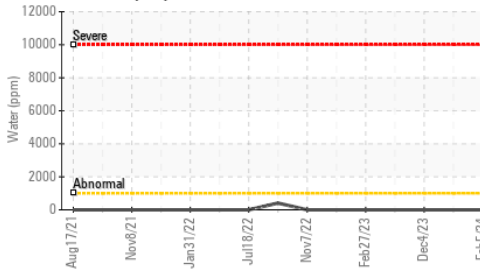


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.9	13.5	▲ 12.4

GRAPHS


Ferrous Alloys

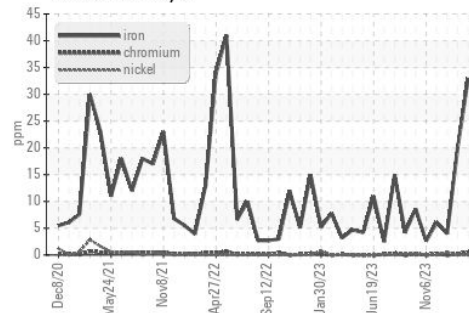


Non-ferrous Metals

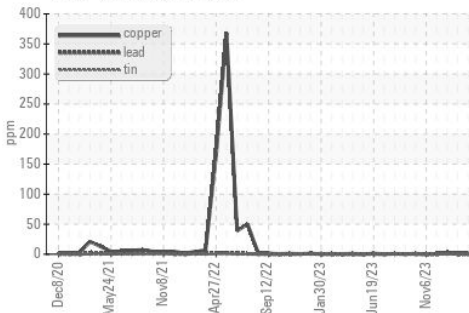

Viscosity @ 100°C

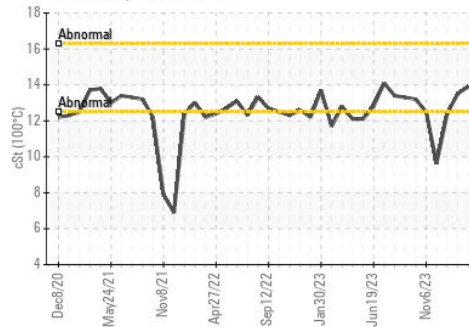

Base Number

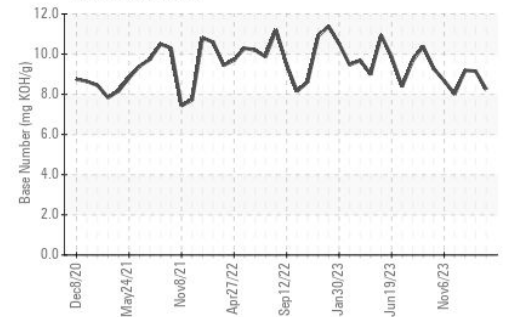

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0804781

Lab Number : 06140128

Unique Number : 10964936

Test Package : IND 2 (Additional Tests: KF)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received : 05 Apr 2024

Tested : 09 Apr 2024

Diagnosed : 09 Apr 2024 - Sean Felton

MARATHON PETROLEUM CO.

101 12TH ST

CATLETTSBURG, KY

US 41169

Contact: SHAWN MCCLASKEY

stmccclaskey@marathonpetroleum.com

T: (606)739-2416

F: x: