




# FUEL REPORT

Sample Rating Trend

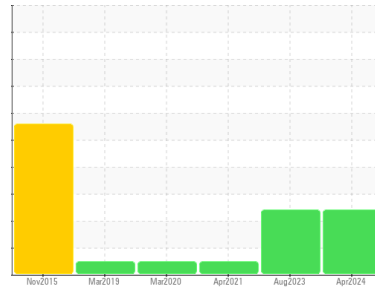

ISO



Machine Id

## LORD CORP

Component

### Diesel Fuel

Fluid

#### No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)

#### DIAGNOSIS

##### Recommendation

We advise that you filter this fluid before use. All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

##### Corrosion

All metal levels are normal indicating no corrosion in the system.

##### Contaminants

There is a high amount of particulates present in the fuel. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The water content is negligible.

##### Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC06140413</b>	WC05925214	WC05223440
Sample Date	Client Info			<b>04 Apr 2024</b>	15 Aug 2023	06 Apr 2021
Machine Age	mls	Client Info		<b>0</b>	0	0
Sample Status				<b>ABNORMAL</b>	ATTENTION	NORMAL

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298	0.839	---	0.844	0.844
Fuel Color	text	*Visual Screen	Yellow	<b>Red</b>	Red	Red
ASTM Color	scalar	*ASTM D1500		<b>L4.5</b>	L4.0	L5.5
Visc @ 40°C	cSt	ASTM D445	3.0	<b>2.53</b>	2.53	2.56
Pensky-Martens Flash Point	°C	*PMCC Calculated	52	<b>62.6</b>	55	66

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	<b>0</b>	0	13
Sulfur (UVF)	ppm	ASTM D5453		<b>15</b>	17	15






DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86	165	<b>174</b>	154	168
5% Distillation Point	°C	ASTM D86		<b>197</b>	188	193
10% Distill Point	°C	ASTM D86	201	<b>207</b>	201	204
15% Distillation Point	°C	ASTM D86		<b>215</b>	209	212
20% Distill Point	°C	ASTM D86	216	<b>223</b>	218	220
30% Distill Point	°C	ASTM D86	230	<b>238</b>	233	235
40% Distill Point	°C	ASTM D86	243	<b>251</b>	247	249
50% Distill Point	°C	ASTM D86	255	<b>264</b>	261	263
60% Distill Point	°C	ASTM D86	267	<b>278</b>	275	276
70% Distill Point	°C	ASTM D86	280	<b>291</b>	289	290
80% Distill Point	°C	ASTM D86	295	<b>306</b>	305	306
85% Distillation Point	°C	ASTM D86		<b>317</b>	314	315
90% Distill Point	°C	ASTM D86	310	<b>327</b>	325	326
95% Distillation Point	°C	ASTM D86		<b>344</b>	342	342
Final Boiling Point	°C	ASTM D86	341	<b>358</b>	348	349
Distillation Residue	%	ASTM D86	3.0	---	1.4	1.4
Distillation Loss	%	ASTM D86	3.0	---	0.5	0.7

IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D7777	37.7	<b>36</b>	36.2	36.2
Cetane Index		ASTM D4737	<40.0	<b>48</b>	47.0	47.4

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<b>0</b>	<1	0
Sodium	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	0	0
Potassium	ppm	ASTM D5185m	<0.1	<b>0</b>	<1	0
Water	%	ASTM D6304	<0.05	<b>0.004</b>	0.006	0.003
ppm Water	ppm	ASTM D6304	<500	<b>44</b>	61.9	39.2
% Gasoline	%	*In-House	<0.50	<b>0.0</b>	0.0	0.0
% Biodiesel	%	*In-House	<20.0	<b>0.0</b>	0.0	0.6



# FUEL REPORT

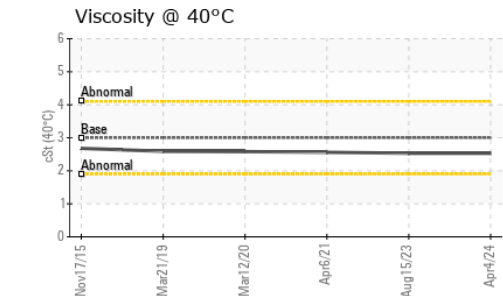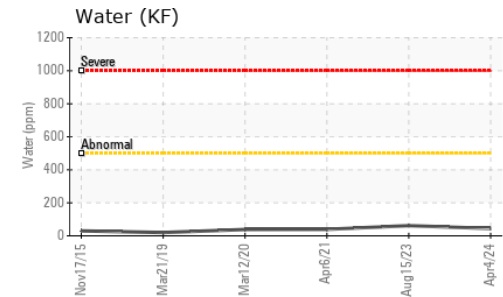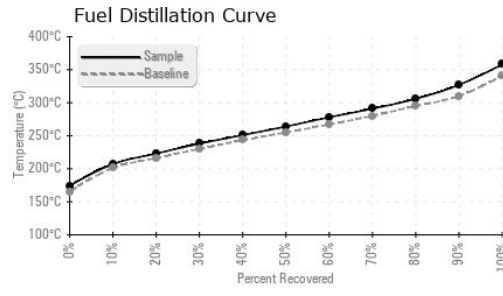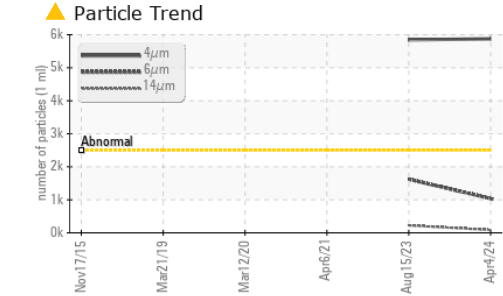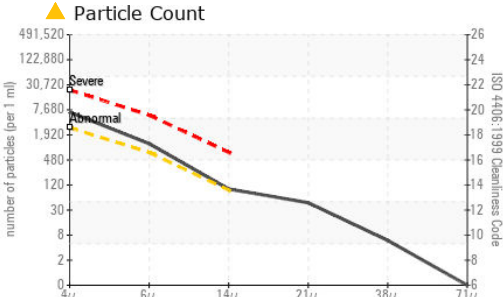

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	▲ 5875	● 5845	---
Particles >6µm	ASTM D7647	>640	● 1038	● 1623	---
Particles >14µm	ASTM D7647	>80	● 85	● 225	---
Particles >21µm	ASTM D7647	>20	● 40	● 84	---
Particles >38µm	ASTM D7647	>4	● 5	● 9	---
Particles >71µm	ASTM D7647	>3	0	1	---
Oil Cleanliness	ISO 4406 (c)	>18/16/13	▲ 20/17/14	● 20/18/15	---

HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m <0.1	0	0	0
Nickel	ppm	ASTM D5185m <0.1	0	0	0
Lead	ppm	ASTM D5185m <0.1	0	0	0
Vanadium	ppm	ASTM D5185m <0.1	0	0	1
Iron	ppm	ASTM D5185m <0.1	0	0	<1
Calcium	ppm	ASTM D5185m <0.1	0	0	0
Magnesium	ppm	ASTM D5185m <0.1	0	0	<1
Phosphorus	ppm	ASTM D5185m <0.1	0	<1	0
Zinc	ppm	ASTM D5185m <0.1	0	0	2

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					



**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC06140413      **Received** : 05 Apr 2024  
**Lab Number** : 06140413      **Tested** : 15 Apr 2024  
**Unique Number** : 10965221      **Diagnosed** : 15 Apr 2024 - Doug Bogart  
**Test Package** : DF-2 ( Additional Tests: Fuel, Screen )

**COUCH OIL COMPANY**  
 2907 HILLSBOROUGH RD  
 DURHAM, NC  
 US 27705  
 Contact: JESSE BROWN  
 jesse@couchoilcompany.com  
 T: (919)285-5408  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)