



OIL ANALYSIS REPORT

Sample Rating Trend



WATER



Machine Id

KAESER 7627615

Component

Compressor

Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

▲ Contamination

There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA016297	---	---
Sample Date	Client Info	28 Mar 2024	---	---
Machine Age	hrs Client Info	785	---	---
Oil Age	hrs Client Info	57	---	---
Oil Changed	Client Info	Changed	---	---
Sample Status		ABNORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>50	<1	---	---
Chromium ppm ASTM D5185m	>10	0	---	---
Nickel ppm ASTM D5185m	>3	<1	---	---
Titanium ppm ASTM D5185m	>3	0	---	---
Silver ppm ASTM D5185m	>2	0	---	---
Aluminum ppm ASTM D5185m	>10	2	---	---
Lead ppm ASTM D5185m	>10	<1	---	---
Copper ppm ASTM D5185m	>50	0	---	---
Tin ppm ASTM D5185m	>10	<1	---	---
Vanadium ppm ASTM D5185m		0	---	---
Cadmium ppm ASTM D5185m		0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m	0	0	---	---
Barium ppm ASTM D5185m	90	22	---	---
Molybdenum ppm ASTM D5185m	0	0	---	---
Manganese ppm ASTM D5185m		<1	---	---
Magnesium ppm ASTM D5185m	100	41	---	---
Calcium ppm ASTM D5185m	0	2	---	---
Phosphorus ppm ASTM D5185m	0	10	---	---
Zinc ppm ASTM D5185m	0	19	---	---
Sulfur ppm ASTM D5185m	23500	24185	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>25	2	---	---
Sodium ppm ASTM D5185m		5	---	---
Potassium ppm ASTM D5185m	>20	13	---	---
Water % ASTM D6304	>0.05	▲ 0.064	---	---
ppm Water ppm ASTM D6304	>500	▲ 645	---	---






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm ASTM D7647		2447	---	---
Particles >6µm ASTM D7647	>1300	998	---	---
Particles >14µm ASTM D7647	>80	49	---	---
Particles >21µm ASTM D7647	>20	19	---	---
Particles >38µm ASTM D7647	>4	1	---	---
Particles >71µm ASTM D7647	>3	0	---	---
Oil Cleanliness ISO 4406 (c)	>--/17/13	18/17/13	---	---

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045	1.0	0.29	---	---


OIL ANALYSIS REPORT

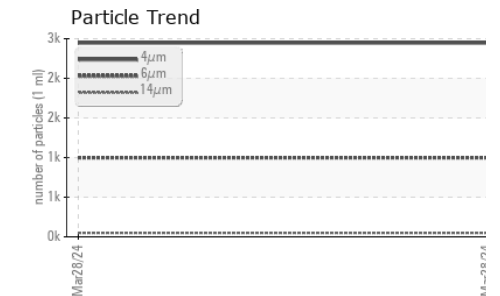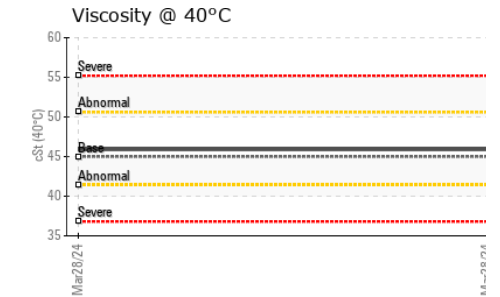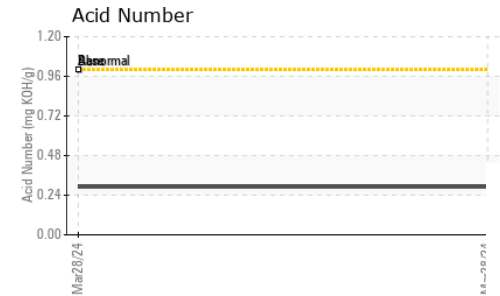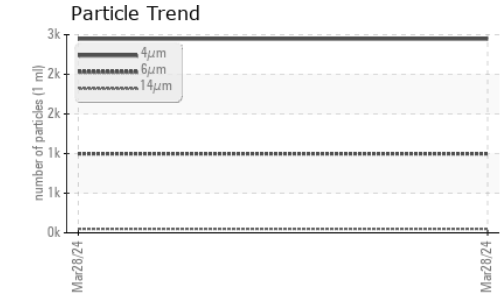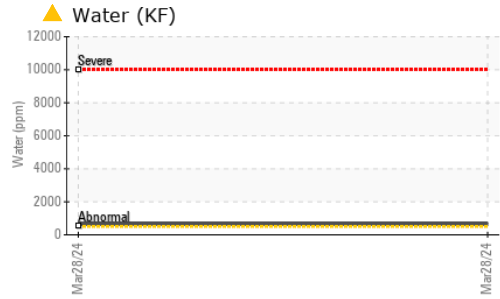






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	45.9	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

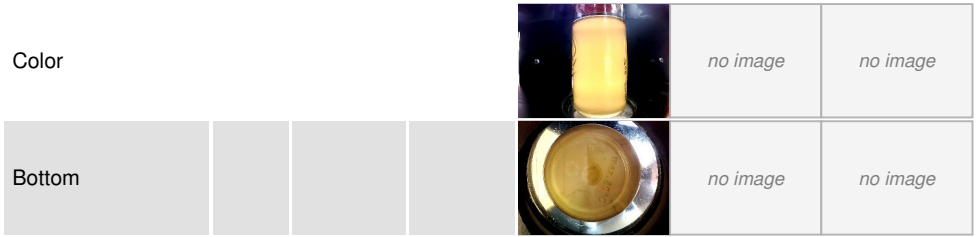

GRAPHS

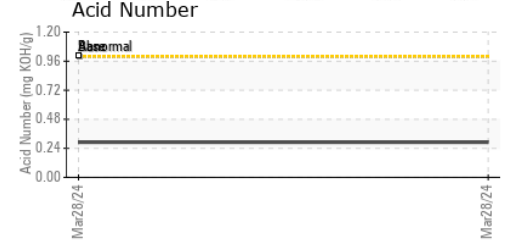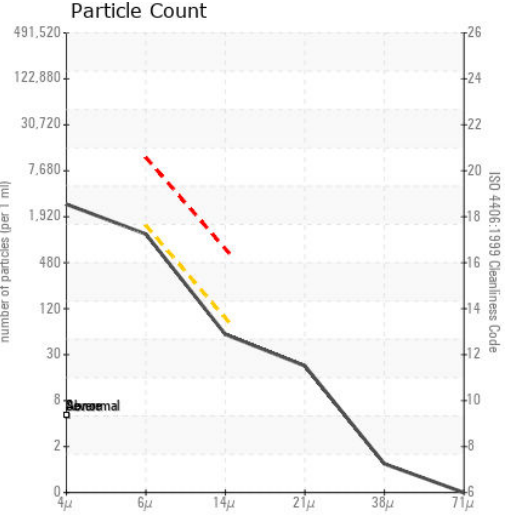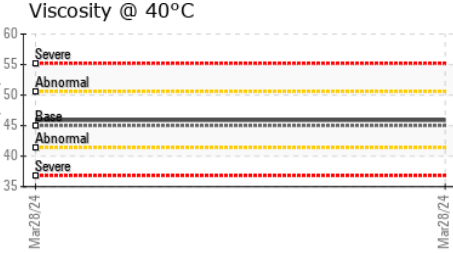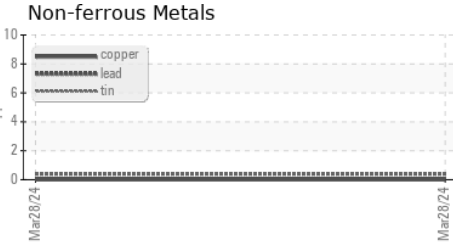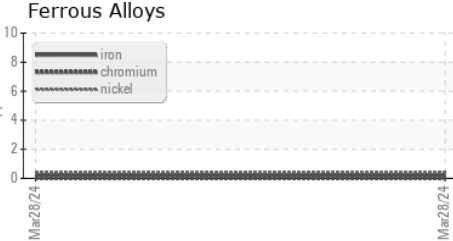

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA016297
Lab Number : 06140637
Unique Number : 10965445
Test Package : IND 2 (Additional Tests: KF, PrtCount)

24 HOUR RECREATIONAL STORAGE
 3500 CINCINNATI AVE
 ROCKIN, CA
 US 95765
 Contact: Service Manager
 gm@indoorry.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)