




OIL ANALYSIS REPORT

Sample Rating Trend

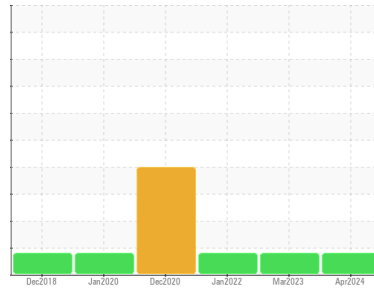

WEAR



Machine Id
KAESER SFC 45 6090059 (S/N 1029)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) FG-460 (--- QTS)

DIAGNOSIS

Recommendation
 No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear
 The aluminum level is abnormal. All other component wear rates are normal.

Contamination
 There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA013503	KCP54533	KCP48672
Sample Date	Client Info			02 Apr 2024	04 Mar 2023	26 Jan 2022
Machine Age	hrs	Client Info		10343	8375	6638
Oil Age	hrs	Client Info		3500	3000	2100
Oil Changed	Client Info			Changed	Changed	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	2	3
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	▲ 22	▲ 26	▲ 28
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m	>50	0	0	<1
Tin	ppm	ASTM D5185m	>10	<1	0	<1
Antimony	ppm	ASTM D5185m		---	---	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	2
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		2	2	2
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m	500	438	392	391
Zinc	ppm	ASTM D5185m		225	224	202
Sulfur	ppm	ASTM D5185m		2052	1647	1766


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	<1
Sodium	ppm	ASTM D5185m		2	3	6
Potassium	ppm	ASTM D5185m	>20	3	2	5
Water	%	ASTM D6304	>0.05	0.007	0.005	0.044
ppm Water	ppm	ASTM D6304	>500	74	53.8	447.9

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		380	1708	3987
Particles >6µm		ASTM D7647	>1300	102	260	697
Particles >14µm		ASTM D7647	>80	12	19	73
Particles >21µm		ASTM D7647	>20	5	5	28
Particles >38µm		ASTM D7647	>4	0	1	5
Particles >71µm		ASTM D7647	>3	0	1	0
Oil Cleanliness		ISO 4406 (c)	>17/13	14/11	15/11	17/13


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	1.28	1.03	0.99

OIL ANALYSIS REPORT


▲ Aluminum (ppm)

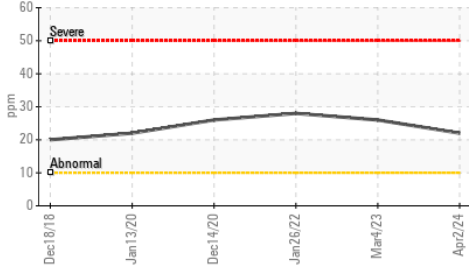


Water (KF)

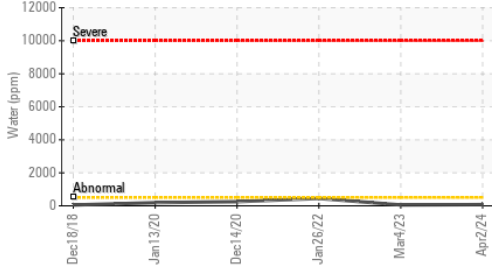


Particle Trend

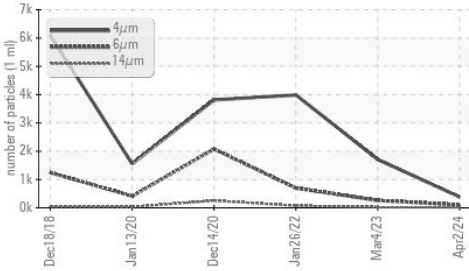

Water (KF)

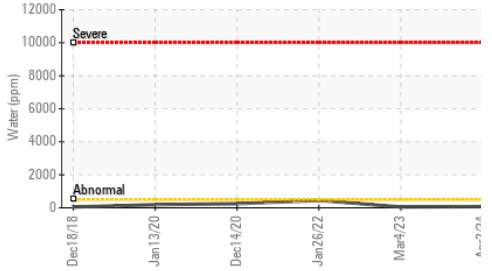


Viscosity @ 40°C

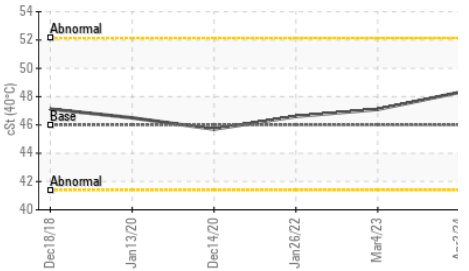




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	48.3	47.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

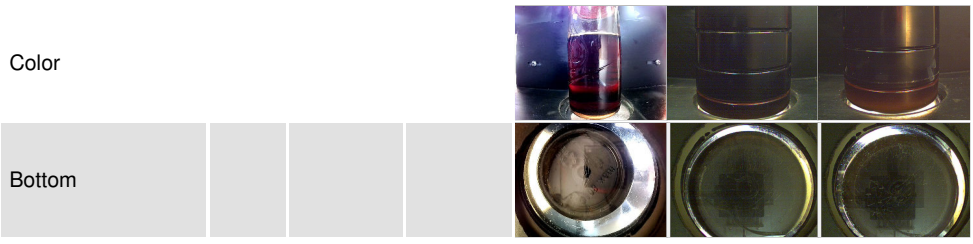

GRAPHS

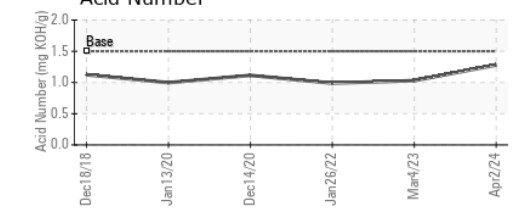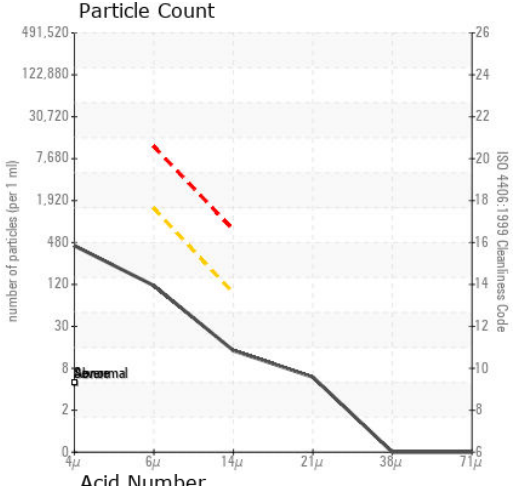

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA013503
Lab Number : 06140657
Unique Number : 10965465
Test Package : IND 2 (Additional Tests: KF, PrtCount)
Received : 05 Apr 2024
Tested : 08 Apr 2024
Diagnosed : 09 Apr 2024 - Don Baldrige

THE SPICE HUNTER
 184 SUBURBAN RD
 SAN LUIS OBISPO, CA
 US 93401
 Contact: K. KREYENNAGEN
 kkreynnagen@sauerbrands.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)