




# OIL ANALYSIS REPORT

Sample Rating Trend

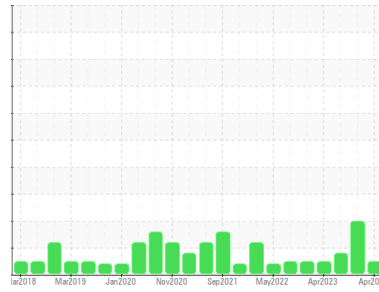

NORMAL

✓

Machine Id  
**1058340**  
 Component  
**Air Compressor**  
 Fluid  
**USPI AIR 46 (--- GAL)**

## DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USPM36639</b>	USPM30715	USPM29440
Sample Date	Client Info	<b>04 Apr 2024</b>	21 Jan 2024	29 Aug 2023
Machine Age	hrs	Client Info	<b>0</b>	0
Oil Age	hrs	Client Info	<b>0</b>	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	ATTENTION	ATTENTION

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m >4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >4	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	1
Lead	ppm	ASTM D5185m >20	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >40	<b>0</b>	0	0
Tin	ppm	ASTM D5185m >5	<b>&lt;1</b>	<1	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	0
Calcium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m 1	<b>31</b>	57	194
Zinc	ppm	ASTM D5185m 0	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m 0	<b>90</b>	219	1128

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	0
Water	%	ASTM D6304 >0.2	<b>0.042</b>	0.022	0.013
ppm Water	ppm	ASTM D6304 >2000	<b>427</b>	228	130.3

## FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	<b>3107</b>	11734	8260
Particles >6µm	ASTM D7647 >2500	<b>544</b>	2611	1342
Particles >14µm	ASTM D7647 >320	<b>23</b>	110	32
Particles >21µm	ASTM D7647 >80	<b>5</b>	26	8
Particles >38µm	ASTM D7647 >20	<b>0</b>	2	0
Particles >71µm	ASTM D7647 >4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >20/18/15	<b>19/16/12</b>	21/19/14	20/18/12

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.05	<b>0.16</b>	0.12	0.23




# OIL ANALYSIS REPORT

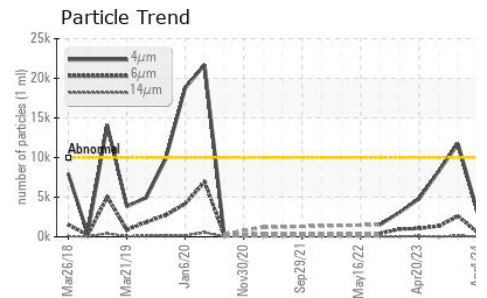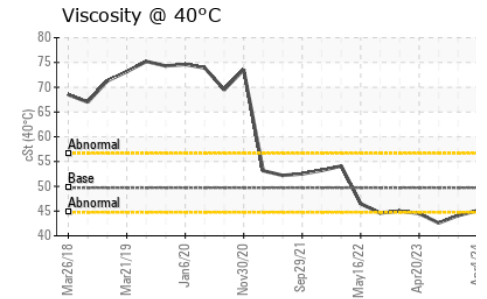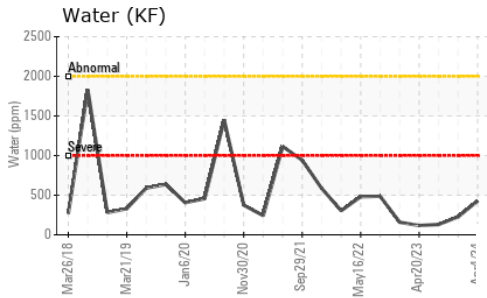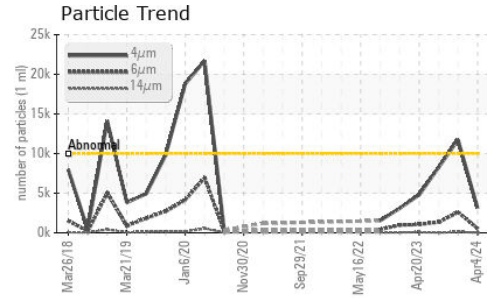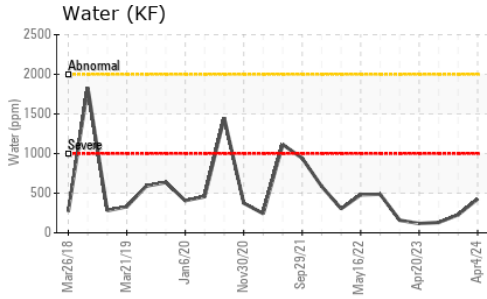






VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>LIGHT</b>	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	49.7	<b>45.1</b>	44.1	42.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

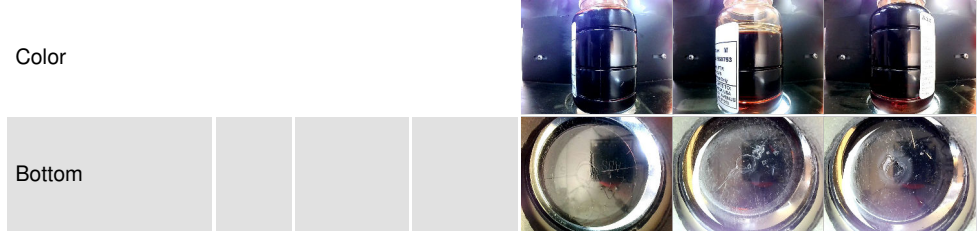

## GRAPHS

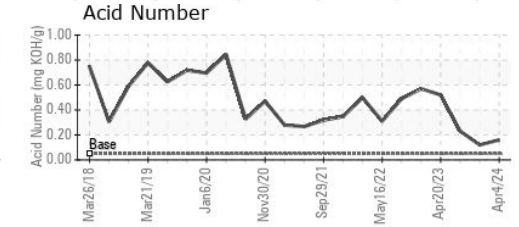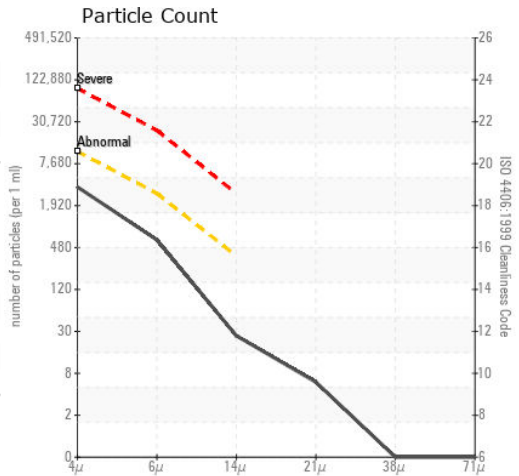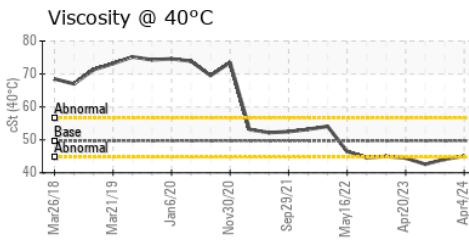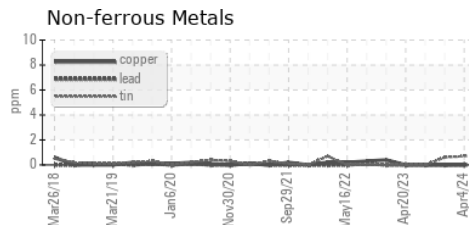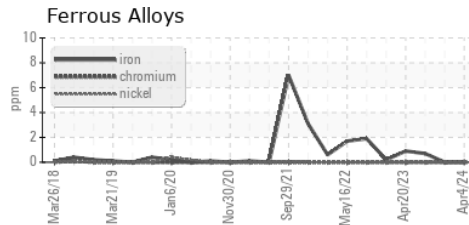

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : USPM36639  
 Lab Number : 06140665  
 Unique Number : 10965473  
 Test Package : IND 2

Received : 05 Apr 2024  
 Tested : 08 Apr 2024  
 Diagnosed : 08 Apr 2024 - Doug Bogart

**TYSCIN**  
 9990 PRINCETON RD.  
 CINCINNATI, OH  
 US 45246

Contact: Russell Schutte  
 russ.schutte@pierfoods.com

T: (800)543-1604

F: (513)874-7180

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)