




FUEL REPORT

Sample Rating Trend

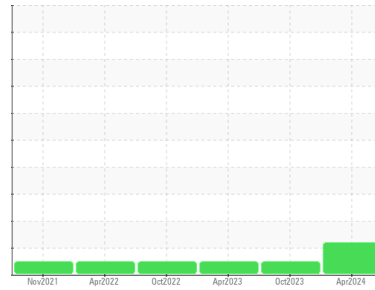

ISO



Machine Id

B1
Component
Diesel Fuel
Fluid

No.1 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

There is a moderate amount of particulates present in the fuel. The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0929845	WC0873529	WC0812015
Sample Date	Client Info			07 Apr 2024	31 Oct 2023	18 Apr 2023
Machine Age	hrs	Client Info		0	0	0
Sample Status				ATTENTION	NORMAL	NORMAL

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
ASTM Color	scalar	*ASTM D1500		L3.5	L4.0	L4.0
Visc @ 40°C	cSt	ASTM D445		2.44	2.46	2.53

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	7	0	0	0
Sulfur (UVF)	ppm	ASTM D5453		10	8	10

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0	<1	0
Sodium	ppm	ASTM D5185m	<0.1	<1	2	0
Potassium	ppm	ASTM D5185m	<0.1	0	<1	<1
Water	%	ASTM D6304	<0.05	0.003	0.004	0.004
ppm Water	ppm	ASTM D6304	<500	28	47.3	41.2
% Gasoline	%	*In-House	<0.50	0.0	0.0	0.0
% Biodiesel	%	*In-House	<20.0	0.0	0.0	0.0

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	2574	4818	4225
Particles >6µm		ASTM D7647	>640	623	613	883
Particles >14µm		ASTM D7647	>80	79	95	92
Particles >21µm		ASTM D7647	>20	29	36	22
Particles >38µm		ASTM D7647	>4	1	1	3
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>18/16/13	19/16/13	19/16/14	19/17/14





HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	0	0	0
Nickel	ppm	ASTM D5185m	<0.1	0	<1	0
Lead	ppm	ASTM D5185m	<0.1	0	<1	0
Vanadium	ppm	ASTM D5185m	<0.1	0	0	0
Iron	ppm	ASTM D5185m	<0.1	0	0	0
Calcium	ppm	ASTM D5185m	<0.1	0	0	0
Magnesium	ppm	ASTM D5185m	<0.1	<1	0	<1
Phosphorus	ppm	ASTM D5185m	<0.1	0	3	0
Zinc	ppm	ASTM D5185m	<0.1	0	0	0

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------






FUEL REPORT

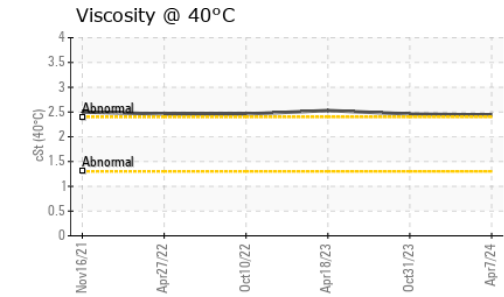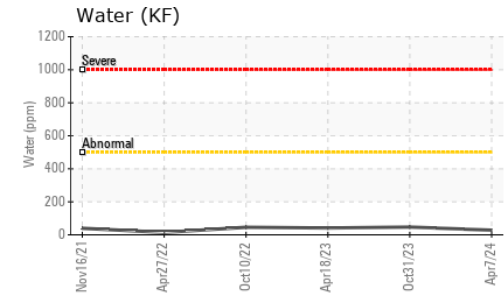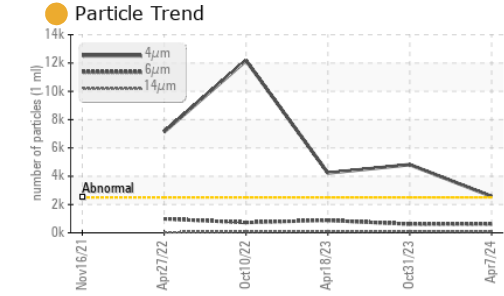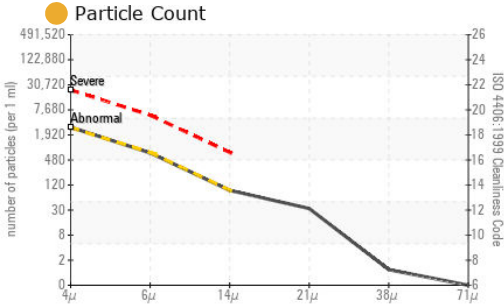

GRAPHS

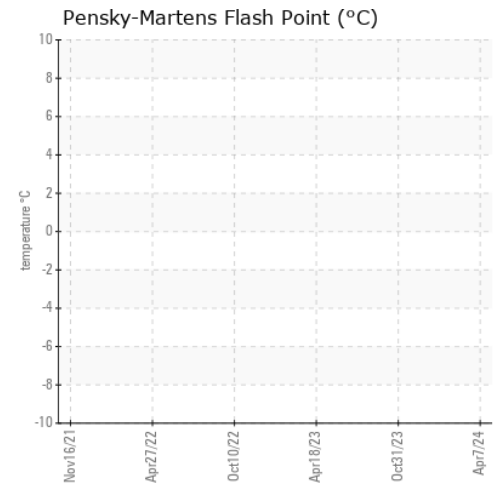

Certificate L2367

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0929845
Lab Number : 06140756
Unique Number : 10965564
Test Package : DF-5 (Additional Tests: Screen)

Received : 05 Apr 2024
Tested : 15 Apr 2024
Diagnosed : 15 Apr 2024 - Doug Bogart

NALCO AN ECOLAB COMPANY
 1304 SEATON ROAD UNIT 8
 DURHAM, NC
 US 27707
 Contact: SHAWN SMITH
 shawn.smith@ecolab.com

T:
F: