


# OIL ANALYSIS REPORT

## Sample Rating Trend



**NORMAL**

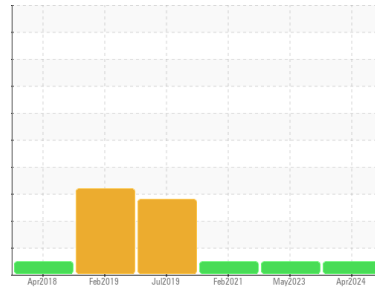

Area  
**FM PLANT**  
Machine Id  
**FRESH AIR BLOWER F2211**  
Component  
**Inboard Blower**  
Fluid  
**MOBIL SHC 629 (6 LTR)**

### DIAGNOSIS

#### Recommendation

No corrective actions. Resample in 3 months.

#### Wear

Wear rate is low and steady.

#### Contamination

Particulate is below typical new oil conditions.

Moisture is nil.

#### Fluid Condition

Oil health indicators suggest the oil is acceptable for continued use.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>PLS0000518</b>	PLS0000509	PLS05189320
Sample Date	Client Info			<b>07 Apr 2024</b>	11 May 2023	02 Feb 2021
Machine Age	mths	Client Info		<b>0</b>	0	0
Oil Age	mths	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method			<b>NEG</b>	NEG	NEG


WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		<b>17</b>	12	14
Iron	ppm	ASTM D5185m	>20	<b>2</b>	2	2
Chromium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	0
Nickel	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	0
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>20	<b>2</b>	<1	0
Lead	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	0
Tin	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	<1
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	2	<1
Calcium	ppm	ASTM D5185m		<b>0</b>	0	<1
Phosphorus	ppm	ASTM D5185m		<b>396</b>	473	409
Zinc	ppm	ASTM D5185m		<b>4</b>	0	0
Sulfur	ppm	ASTM D5185m		<b>0</b>	60	19

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>2</b>	2	0
Sodium	ppm	ASTM D5185m		<b>0</b>	<1	0
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	0

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		<b>0</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624		<b>4.7</b>	4.7	4.9
Sulfation	Abs.1mm	*ASTM D7415		<b>10.7</b>	11.5	11.7

# OIL ANALYSIS REPORT

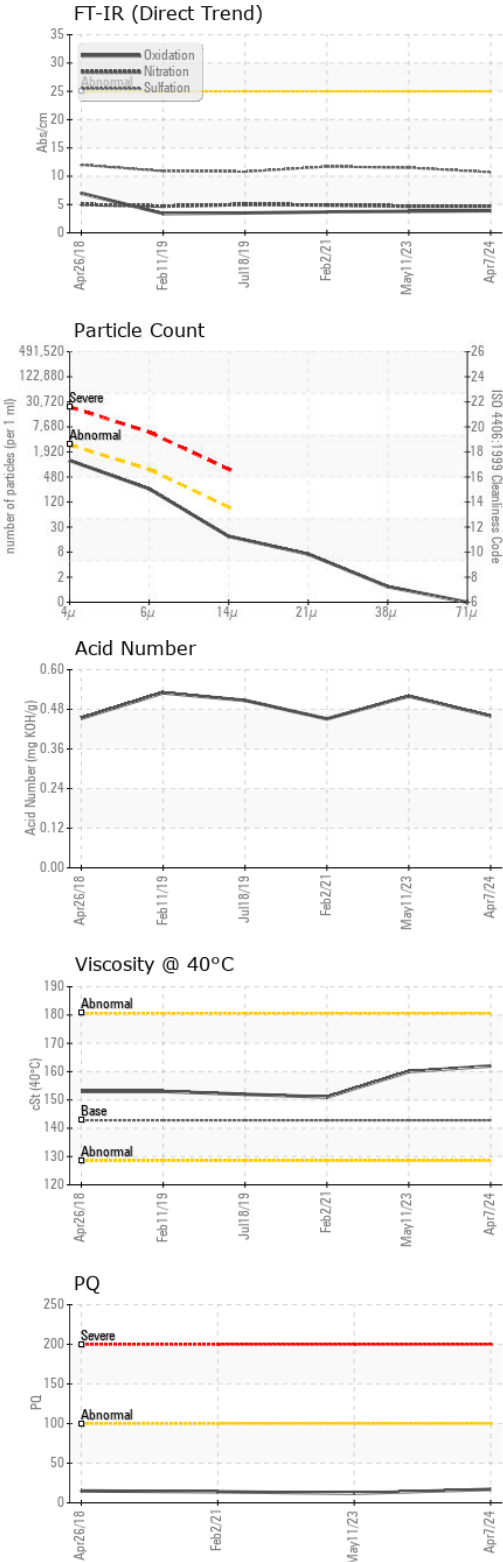


FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	<b>1050</b>	6976	7952
Particles >6µm	ASTM D7647	>640	<b>219</b>	1632	865
Particles >14µm	ASTM D7647	>80	<b>16</b>	137	21
Particles >21µm	ASTM D7647	>20	<b>6</b>	32	4
Particles >38µm	ASTM D7647	>4	<b>1</b>	4	0
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>18/16/13	<b>17/15/11</b>	20/18/14	20/17/12

FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs./1mm *ASTM D7414		<b>3.9</b>	3.8	3.7
Acid Number (AN)	mg KOH/g ASTM D8045		<b>0.46</b>	0.52	0.451

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar *Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar *Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar *Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar *Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar *Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar *Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar *Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar *Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar *Visual		<b>NEG</b>	NEG	NEG
Free Water	scalar *Visual		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D445	142.8	<b>162</b>	160	151

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

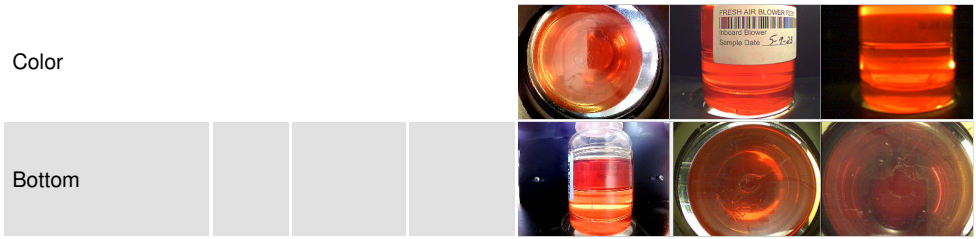

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PLS0000518  
**Lab Number** : **06141137**  
**Unique Number** : 10965945  
**Test Package** : IND 2 ( Additional Tests: FT-IR, PQ, PrtCount )

**Received** : 08 Apr 2024  
**Tested** : 09 Apr 2024  
**Diagnosed** : 30 May 2024 - Mike Johnson

**HEXION INC - LULING PLANT**  
 12513 QUEENIE RD  
 LULING, LA  
 US 70070  
 Contact: JEFF RENTFROW  
 jeff.rentfrow@hexion.com;mike.johnson@amri.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)