

OIL ANALYSIS REPORT



Machine Id

REFINER 3

Component Hydraulic System Fluid AW HYDRAULIC OIL ISO 150 (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0873121		
Sample Date		Client Info		04 Apr 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
CONTAMINATION		method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	1		
Chromium	ppm	ASTM D5185m	>20	<1		
Nickel	ppm	ASTM D5185m	>20	<1		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>20	6		
Lead	ppm	ASTM D5185m	>20	0		
Copper	ppm	ASTM D5185m	>20	<1		
Tin	ppm	ASTM D5185m	>20	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	0		
Barium	ppm	ASTM D5185m	5	0		
Molybdenum	ppm	ASTM D5185m	5	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	25	<1		
Calcium	ppm	ASTM D5185m	200	13		
Phosphorus	ppm	ASTM D5185m	300	10		
Zinc	ppm	ASTM D5185m	370	10		
Sulfur	ppm	ASTM D5185m	2500	954		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	2		
Sodium	ppm	ASTM D5185m		6		
Potassium	ppm	ASTM D5185m	>20	2		
FLUID CLEANLINE	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	6 53501		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>160	<u> </u>		
Particles >21µm		ASTM D7647	>40	<u> </u>		
Particles >38µm		ASTM D7647	>10	5		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>19/17/14	A 23/20/16		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.57	0.19		
00:55) Rev: 1	5 0		Contact/Location: Jerald Caldwell - BLUDAN			

Report Id: BLUDAN [WUSCAR] 06141268 (Generated: 04/10/2024 18:00:55) Rev: 1

Contact/Location: Jerald Caldwell - BLUDAN Page 1 of 2



Par of

pe []

P

OIL ANALYSIS REPORT

limit/base

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

limit/base

limit/base

>0.05

150

current

NONE

NONE

NONE

NONE

LIGHT

NONE

NORML

NORML


current


current

NEG

NEG

129

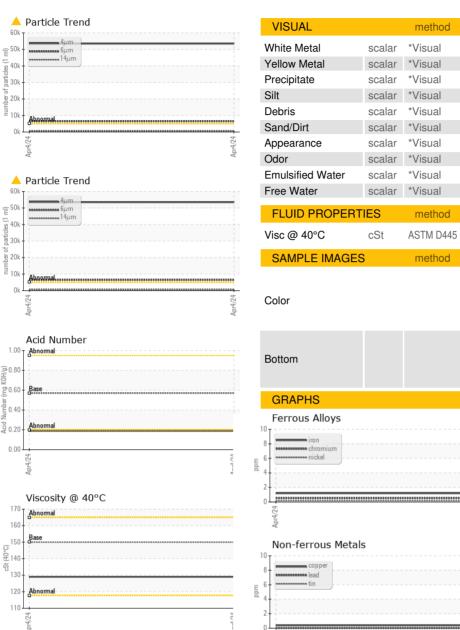

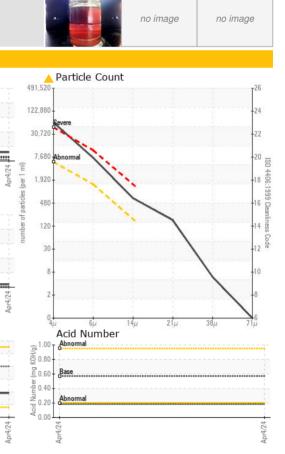

history1

history

history1

no image

history2

history2

history2

no image

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513 **BLUE RIDGE FIBERBOARD** Sample No. : WC0873121 Received : 08 Apr 2024 250 KNIGHT CELOTEX DR Lab Number : 06141268 Tested DANVILLE, VA : 09 Apr 2024 Unique Number : 10966076 Diagnosed : 10 Apr 2024 - Don Baldridge US 24541 Test Package : IND 2 Contact: Jerald Caldwell Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369. JCaldwell@blueridgefiberboard.com * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: F:

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Viscosity @ 40°C

Abnormal

170

160 ເວີ150 ອີ£140 B

충₁₃₀.

120-Abnormal

110-

20

Report Id: BLUDAN [WUSCAR] 06141268 (Generated: 04/10/2024 18:00:55) Rev: 1

Contact/Location: Jerald Caldwell - BLUDAN Page 2 of 2