




OIL ANALYSIS REPORT

Sample Rating Trend

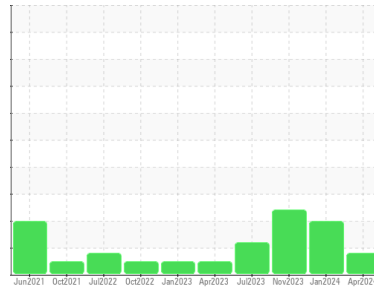

Area
COLD MILL/CM-3STD-2N
 Machine Id
S2 WEST MOTOR BEARING 3ST2_S2 West Motor Bearing
 Component
Bearing
 Fluid
ROYAL PURPLE SYNFILM GT 68 (50 GAL)

DIAGNOSIS

Recommendation
 No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a high amount of silt (particulates < 6 microns in size) present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KFS0005216	KFS0003652	KFS0003646
Sample Date	Client Info	04 Apr 2024	12 Jan 2024	15 Nov 2023
Machine Age	hrs	0	0	0
Oil Age	hrs	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >2	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >20	<1	0	<1
Chromium	ppm	ASTM D5185m >20	<1	<1	<1
Nickel	ppm	ASTM D5185m >20	0	0	0
Titanium	ppm	ASTM D5185m	<1	0	<1
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >20	2	2	<1
Lead	ppm	ASTM D5185m >20	0	0	0
Copper	ppm	ASTM D5185m >20	<1	<1	2
Tin	ppm	ASTM D5185m >20	11	5	10
Vanadium	ppm	ASTM D5185m	<1	0	<1
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<1	0	0
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	<1
Magnesium	ppm	ASTM D5185m 90	3	14	10
Calcium	ppm	ASTM D5185m	4	1	0
Phosphorus	ppm	ASTM D5185m	90	28	0
Zinc	ppm	ASTM D5185m	1	0	0
Sulfur	ppm	ASTM D5185m	2867	7341	13437

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >15	2	1	2
Sodium	ppm	ASTM D5185m	1	0	2
Potassium	ppm	ASTM D5185m >20	<1	<1	1





FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	▲ 20081	▲ 45930	▲ 49409
Particles >6µm	ASTM D7647 >2500	2326	▲ 7460	▲ 8494
Particles >14µm	ASTM D7647 >160	96	▲ 593	▲ 674
Particles >21µm	ASTM D7647 >40	21	▲ 190	▲ 217
Particles >38µm	ASTM D7647 >10	0	9	▲ 12
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >20/18/14	▲ 22/18/14	▲ 23/20/16	▲ 23/20/17

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	0.34	0.25	0.31


OIL ANALYSIS REPORT

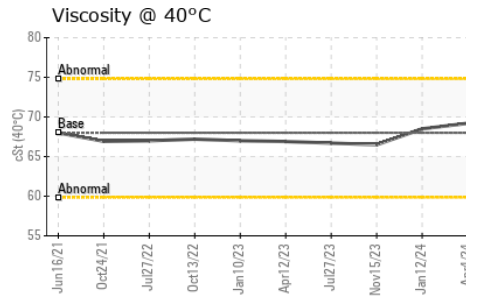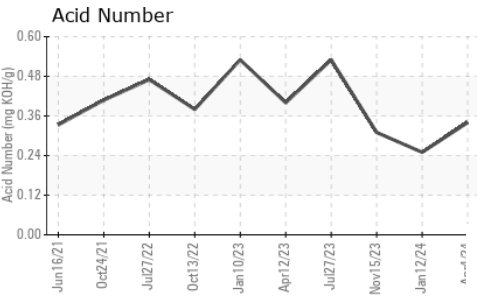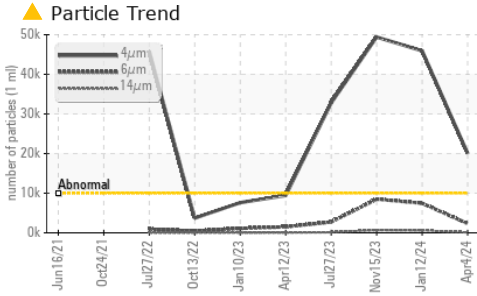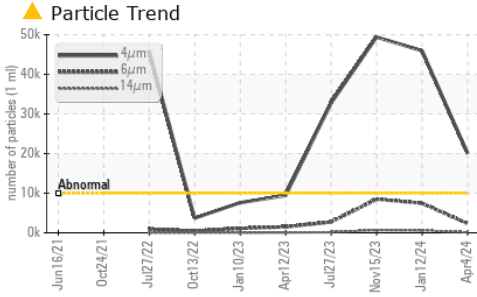




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 68	69.2	68.5	66.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

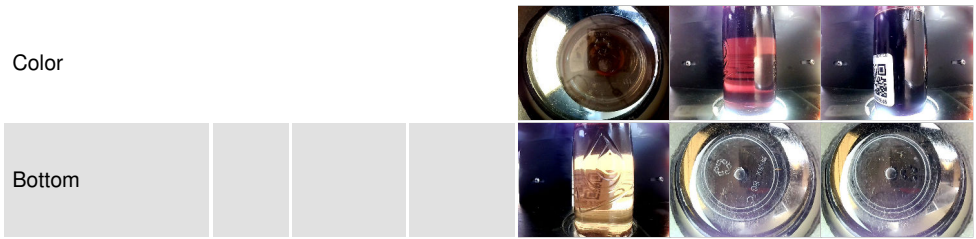

GRAPHS

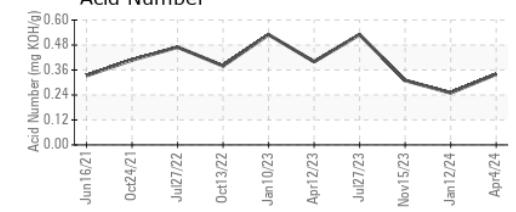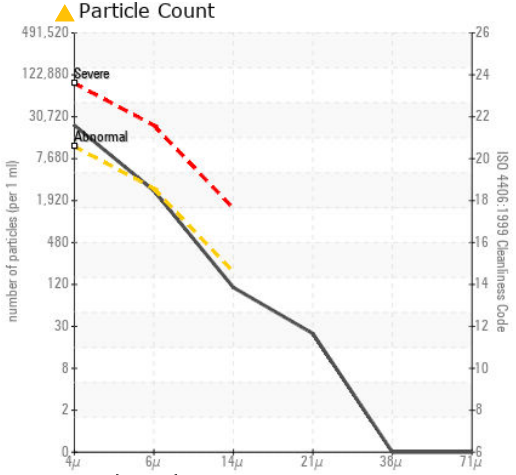

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KFS0005216 **Received** : 08 Apr 2024
Lab Number : 06141308 **Tested** : 09 Apr 2024
Unique Number : 10966116 **Diagnosed** : 10 Apr 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: PrtCount)

CONSTELLIUM
 4805 SECOND STREET
 MUSCLE SHOALS, AL
 US 35661
 Contact: Randy Nichols
 randall.nichols@constellium.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (256)386-6956
 F: