




OIL ANALYSIS REPORT

Sample Rating Trend

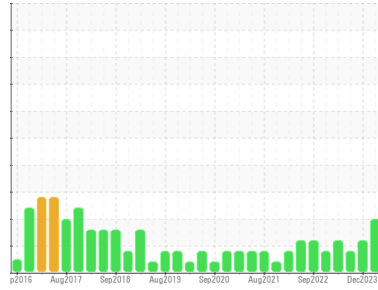

ISO



Area

RP-101 [10023985088]

Machine Id

B57008 - LOW LEVEL FEED SCREW

Component

Gearbox

Fluid

PETRO CANADA PURITY FG EP GEAR FLUID 460 (--- QTS)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0894946	WC06029351	WC0781516
Sample Date	Client Info		07 Apr 2024	02 Dec 2023	22 May 2023
Machine Age	mls	Client Info	0	0	0
Oil Age	mls	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	ATTENTION

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.2	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>200	9	4	9
Chromium	ppm	ASTM D5185m	>15	<1	<1	0
Nickel	ppm	ASTM D5185m	>15	0	0	<1
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	2	1	0
Lead	ppm	ASTM D5185m	>100	0	0	0
Copper	ppm	ASTM D5185m	>200	5	1	2
Tin	ppm	ASTM D5185m	>25	8	0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		14	17	20
Barium	ppm	ASTM D5185m		0	3	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m		2	<1	<1
Calcium	ppm	ASTM D5185m		4	<1	2
Phosphorus	ppm	ASTM D5185m	135	270	376	346
Zinc	ppm	ASTM D5185m		60	23	11
Sulfur	ppm	ASTM D5185m	660	3951	5155	5088

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>50	4	<1	<1
Sodium	ppm	ASTM D5185m		1	0	1
Potassium	ppm	ASTM D5185m	>20	1	2	2

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 42947	▲ 73153	● 11886
Particles >6µm	ASTM D7647	>2500	▲ 10162	▲ 5020	1279
Particles >14µm	ASTM D7647	>320	▲ 1551	120	30
Particles >21µm	ASTM D7647	>80	▲ 509	49	7
Particles >38µm	ASTM D7647	>20	9	4	1
Particles >71µm	ASTM D7647	>4	0	1	1
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ 23/21/18	▲ 23/20/14	● 21/17/12


FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	0.54	1.39	1.24	1.63




OIL ANALYSIS REPORT


▲ Particle Trend

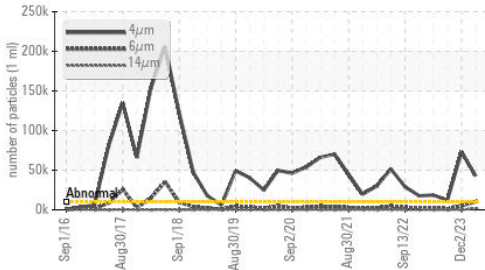


▲ Particle Trend

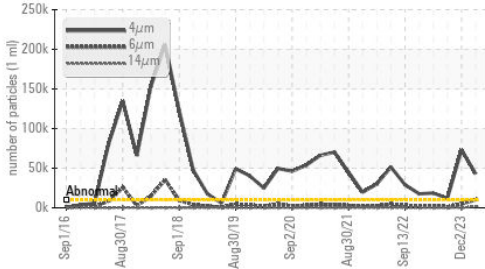

Acid Number

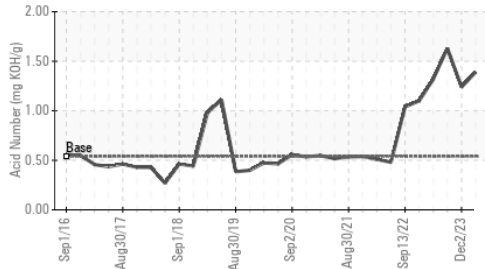


Viscosity @ 40°C

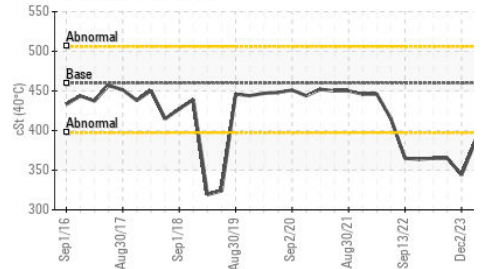

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	460	387.0	344

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

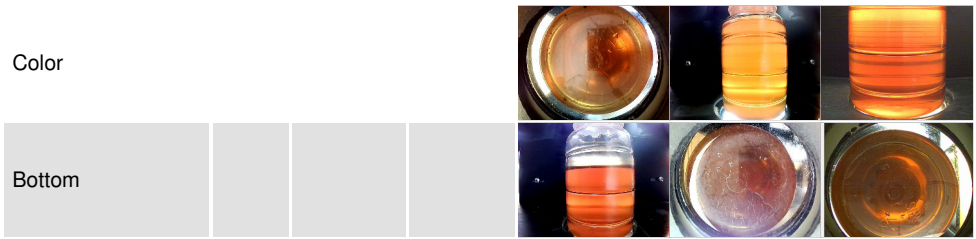


GRAPHS


Ferrous Alloys

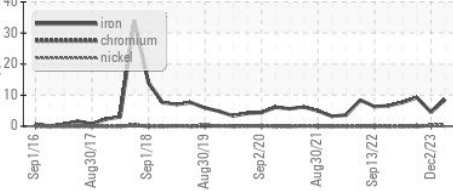


Non-ferrous Metals

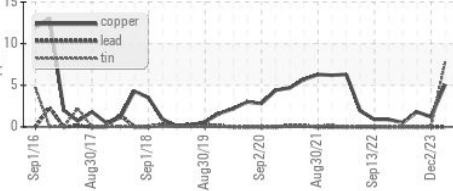


Viscosity @ 40°C

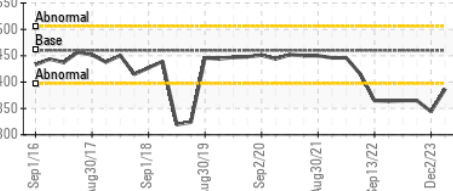

▲ Particle Count

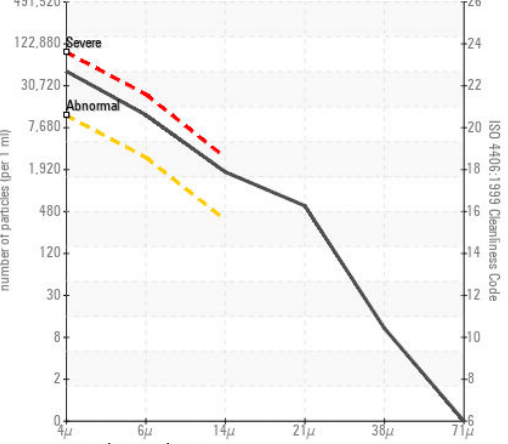

Acid Number

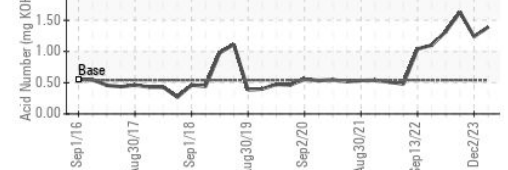

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0894946 **Received** : 08 Apr 2024
Lab Number : 06141313 **Tested** : 15 Apr 2024
Unique Number : 10966121 **Diagnosed** : 15 Apr 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: PrtCount)

HORMEL FOODS - AUSTIN
 1101 NORTH MAIN ST
 AUSTIN, MN
 US 55912
 Contact: RYAN LOWE
 rslowe@hormel.com
 T: (507)437-5674
 F: (507)437-9805

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)