


OIL ANALYSIS REPORT

Sample Rating Trend

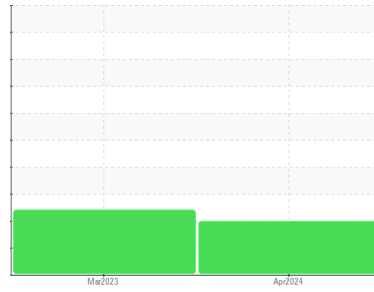

Area
Wax Cups
Machine Id
POS 44
Component
Unknown Component
Fluid
TULCO LUBSOIL INDUSTRIAL GEAR OIL 150 (--- GAL)

DIAGNOSIS

Recommendation
We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is a high amount of particulates present in the sample.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the sample is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		TO50002187	TO50001569	---
Sample Date	Client Info		03 Apr 2024	30 Mar 2023	---
Machine Age	hrs	Client Info	0	0	---
Oil Age	hrs	Client Info	0	0	---
Oil Changed	Client Info		Not Chngd	N/A	---
Sample Status			ABNORMAL	ABNORMAL	---

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	30	21	---
Chromium	ppm	ASTM D5185m	<1	0	---
Nickel	ppm	ASTM D5185m	8	0	---
Titanium	ppm	ASTM D5185m	<1	0	---
Silver	ppm	ASTM D5185m	0	0	---
Aluminum	ppm	ASTM D5185m	2	1	---
Lead	ppm	ASTM D5185m	2	<1	---
Copper	ppm	ASTM D5185m	6	4	---
Tin	ppm	ASTM D5185m	<1	0	---
Vanadium	ppm	ASTM D5185m	<1	0	---
Cadmium	ppm	ASTM D5185m	<1	<1	---






ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 13	3	0	---
Barium	ppm	ASTM D5185m	0	0	---
Molybdenum	ppm	ASTM D5185m	0	0	---
Manganese	ppm	ASTM D5185m	<1	<1	---
Magnesium	ppm	ASTM D5185m	1	9	---
Calcium	ppm	ASTM D5185m	75	2	---
Phosphorus	ppm	ASTM D5185m 170	235	235	---
Zinc	ppm	ASTM D5185m	40	14	---
Sulfur	ppm	ASTM D5185m 6300	5672	6336	---

CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	6680	▲ 2807	---
Sodium	ppm	ASTM D5185m	3	3	---
Potassium	ppm	ASTM D5185m >20	3	<1	---
Water	%	ASTM D6304	0.003	0.002	---
ppm Water	ppm	ASTM D6304	39	23.9	---

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	▲ 81793	---	---
Particles >6µm	ASTM D7647	>1300	▲ 12856	---	---
Particles >14µm	ASTM D7647	>160	▲ 294	---	---
Particles >21µm	ASTM D7647	>40	▲ 54	---	---
Particles >38µm	ASTM D7647	>10	2	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 24/21/15	---	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.51	0.59	---


OIL ANALYSIS REPORT

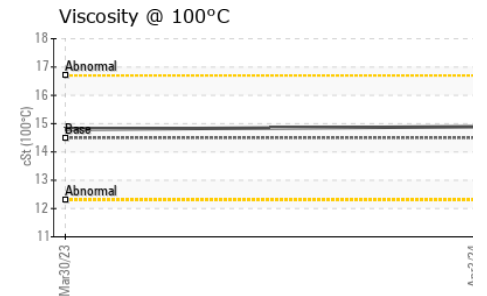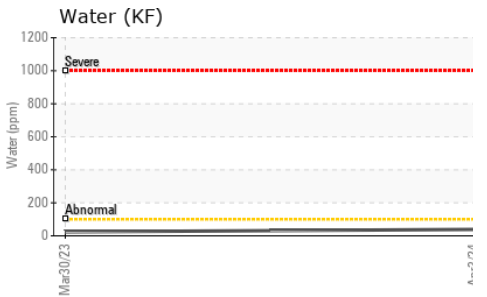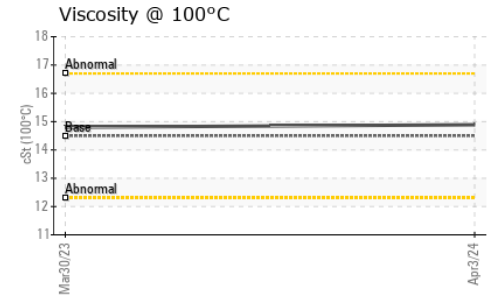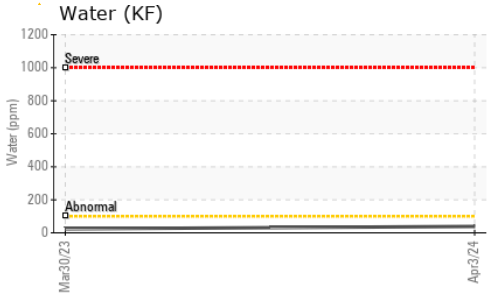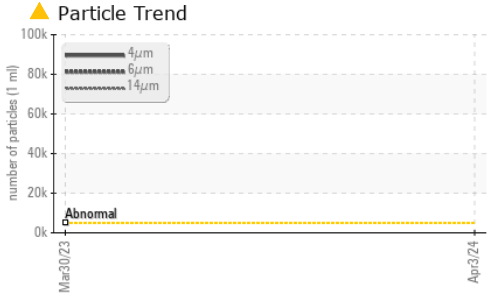



VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	▲ MODER
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	NEG	NEG	---
Free Water	scalar	*Visual	NEG	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	148	153	---
Visc @ 100°C	cSt	ASTM D445	14.5	14.8	---
Viscosity Index (VI)	Scale	ASTM D2270	96	95	---

SAMPLE IMAGES

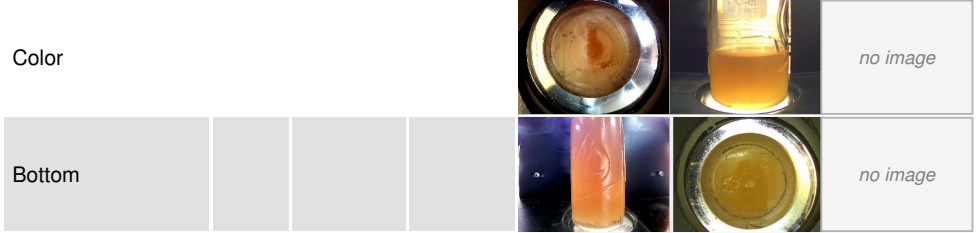

GRAPHS

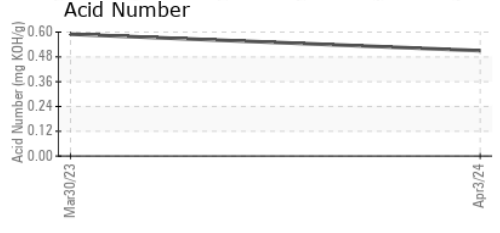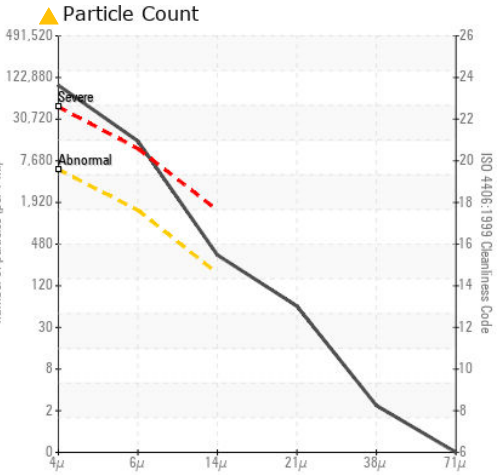

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO50002187 **Received** : 08 Apr 2024
Lab Number : 06141324 **Tested** : 15 Apr 2024
Unique Number : 10966132 **Diagnosed** : 15 Apr 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

DART CONTAINER CORPORATION
 4444 W LEADBETTER DR
 DALLAS, TX
 US 75236

Contact: YON PALOMINO
 yon.palomino@dart.biz
 T: (214)775-5673
 F:
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)