



# OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id  
**8873920 (S/N 1570)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

**Recommendation**  
 No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is a high amount of particulates present in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KC112153</b>	---	---
Sample Date	Client Info	<b>07 Mar 2024</b>	---	---
Machine Age	hrs Client Info	<b>2254</b>	---	---
Oil Age	hrs Client Info	<b>2254</b>	---	---
Oil Changed	Client Info	<b>Changed</b>	---	---
Sample Status		<b>ABNORMAL</b>	---	---

## WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>50	<1	---	---
Chromium ppm ASTM D5185m	>10	0	---	---
Nickel ppm ASTM D5185m	>3	0	---	---
Titanium ppm ASTM D5185m	>3	0	---	---
Silver ppm ASTM D5185m	>2	0	---	---
Aluminum ppm ASTM D5185m	>10	0	---	---
Lead ppm ASTM D5185m	>10	<1	---	---
Copper ppm ASTM D5185m	>50	3	---	---
Tin ppm ASTM D5185m	>10	0	---	---
Vanadium ppm ASTM D5185m		0	---	---
Cadmium ppm ASTM D5185m		0	---	---

## ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		0	---	---
Barium ppm ASTM D5185m	90	<1	---	---
Molybdenum ppm ASTM D5185m		0	---	---
Manganese ppm ASTM D5185m		0	---	---
Magnesium ppm ASTM D5185m	90	52	---	---
Calcium ppm ASTM D5185m	2	0	---	---
Phosphorus ppm ASTM D5185m		0	---	---
Zinc ppm ASTM D5185m		0	---	---

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>25	<1	---	---
Sodium ppm ASTM D5185m		4	---	---
Potassium ppm ASTM D5185m	>20	6	---	---
Water % ASTM D6304	>0.05	<b>0.012</b>	---	---
ppm Water ppm ASTM D6304	>500	<b>126</b>	---	---






## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm ASTM D7647		<b>8934</b>	---	---
Particles >6µm ASTM D7647	>1300	<b>▲ 3982</b>	---	---
Particles >14µm ASTM D7647	>80	<b>▲ 230</b>	---	---
Particles >21µm ASTM D7647	>20	<b>▲ 29</b>	---	---
Particles >38µm ASTM D7647	>4	0	---	---
Particles >71µm ASTM D7647	>3	0	---	---
Oil Cleanliness ISO 4406 (c)	>--/17/13	<b>▲ 20/19/15</b>	---	---

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045	0.4	<b>0.40</b>	---	---

# OIL ANALYSIS REPORT

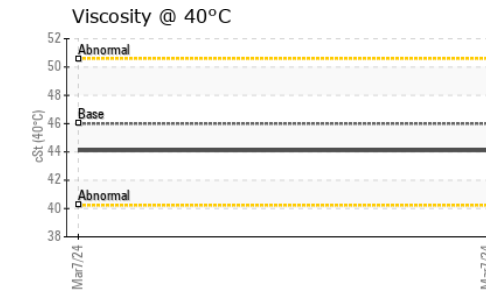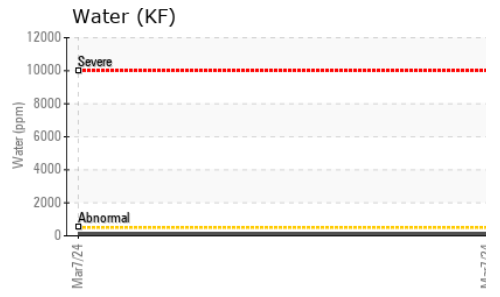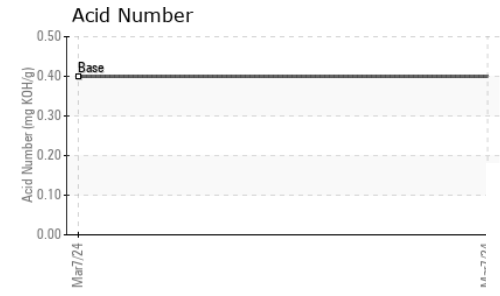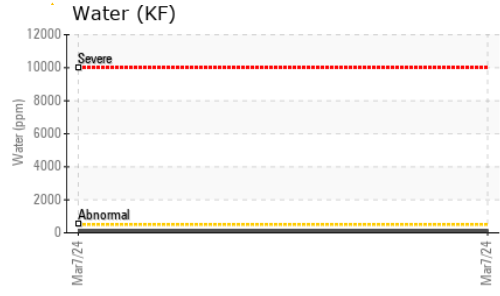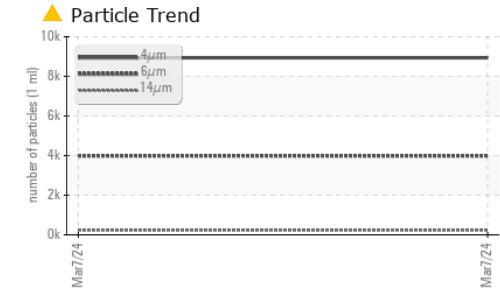





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.1	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

## GRAPHS

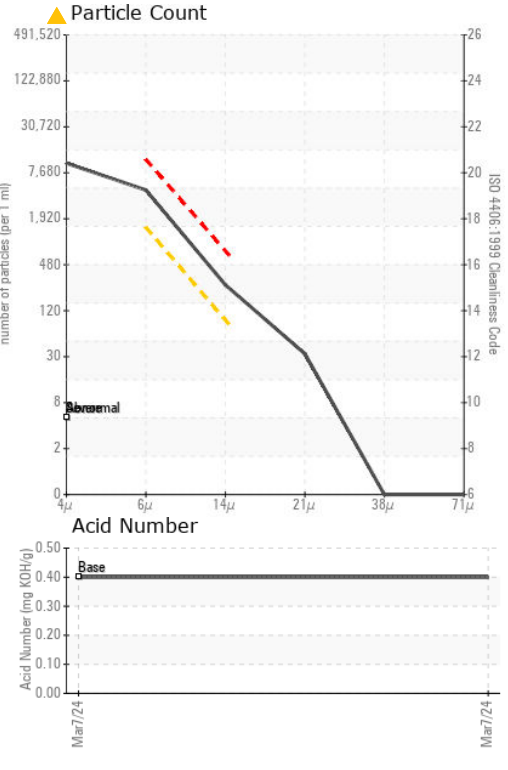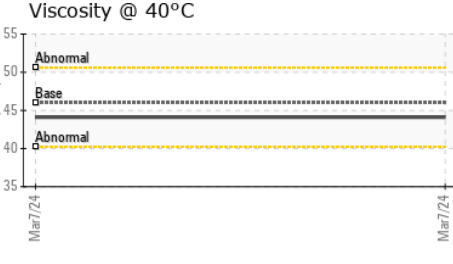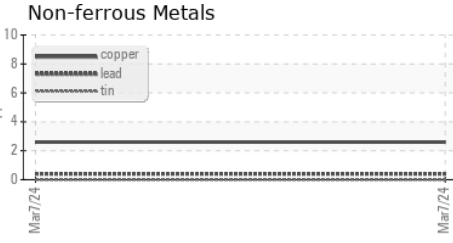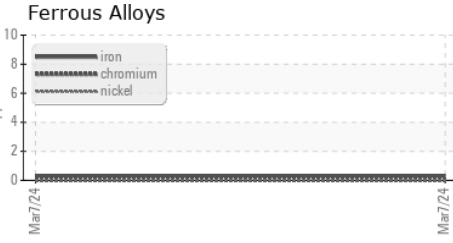

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC112153  
**Lab Number** : 06141330  
**Unique Number** : 10966138  
**Test Package** : IND 2  
**Received** : 08 Apr 2024  
**Tested** : 09 Apr 2024  
**Diagnosed** : 10 Apr 2024 - Don Baldrige

**DUBOSE NATIONAL ENERGY**  
 18737 SHELDON RD  
 CLEVELAND, OH  
 US 44130  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)